


Order Plans @

01 REFLECTED CEILING PLAN

SCALE: 1/8" = 1'-0"

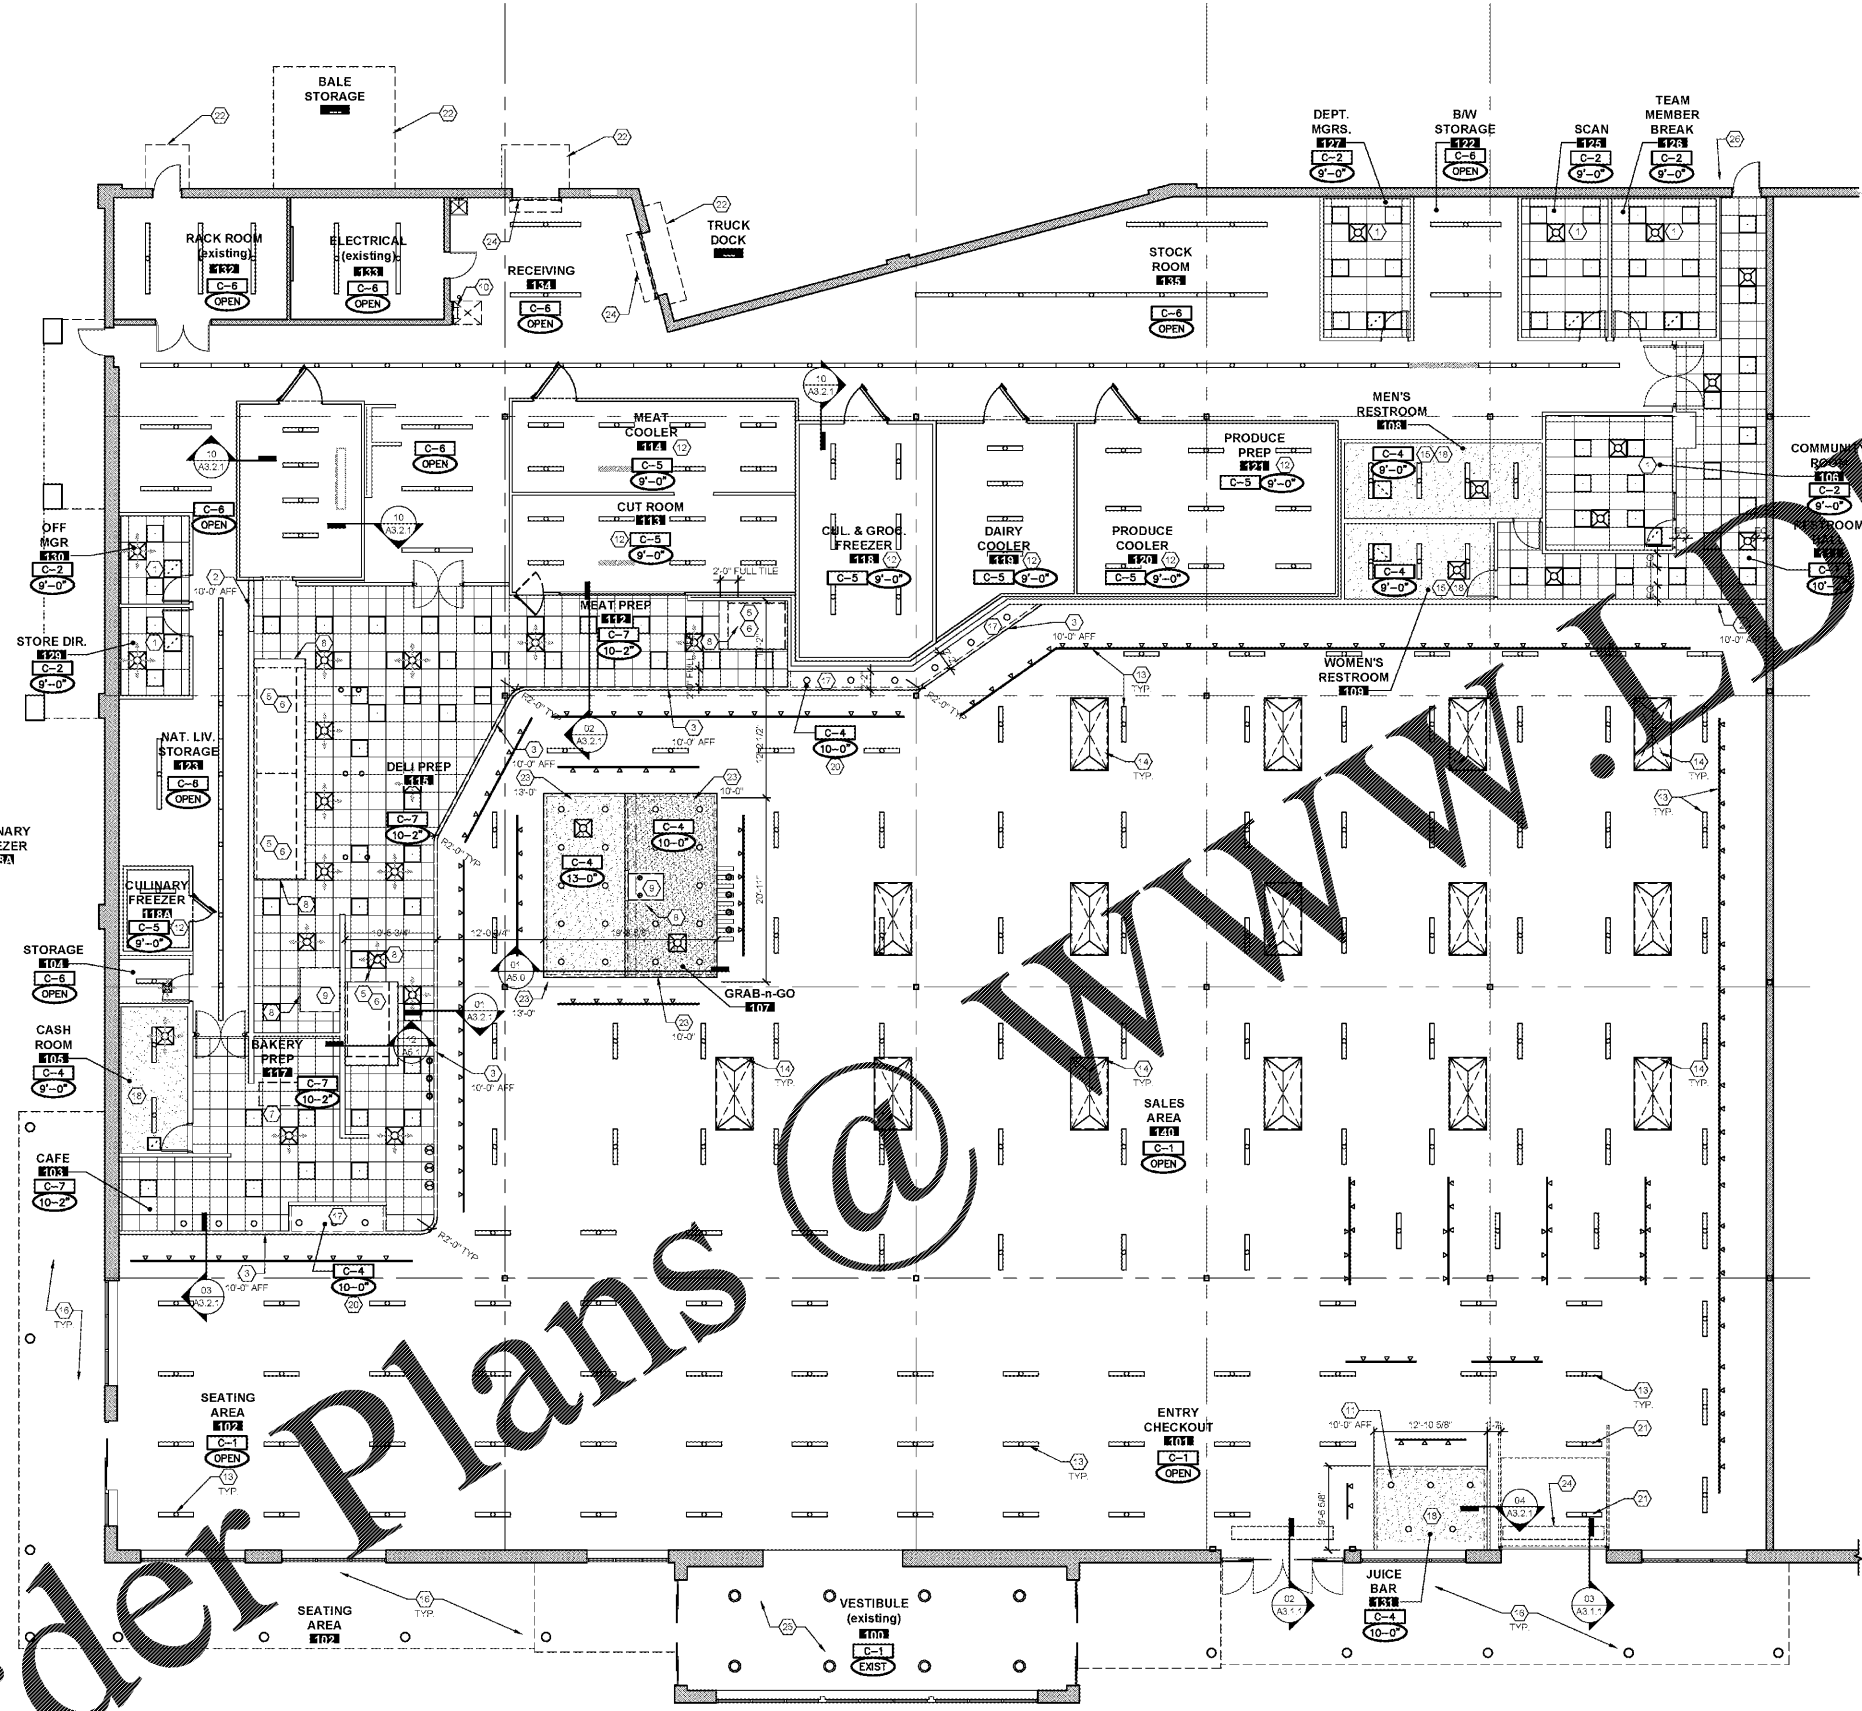

GENERAL NOTES

- A. ALL LIGHTING IS PROVIDED BY THE OWNER AND INSTALLED BY THE O.C. UNLESS OTHERWISE NOTED. THIS DRAWING IS FOR THE PURPOSE OF COORDINATION. SEE LIGHTING LAYOUT AND ELECTRICAL DRAWINGS FOR ACTUAL DESCRIPTION AND LOCATION OF LIGHTING FIXTURES. LIGHT FIXTURE PLACEMENT IS ASSOCIATED WITH THE FUTURE PLAN LAYOUT. COORDINATE FINAL LIGHTING LAYOUT WITH THE LUCKY'S CONSTRUCTION MANAGER.
- B. REFRIGERATION PIPING SHALL BE INSTALLED ABOVE LIGHTING AND SHALL NOT CROSS WITHIN 4 FEET OF SKYLIGHT OPENINGS.
- C. PROVIDE UNISTRUT SUPPORTS AS REQUIRED TO SUPPORT SUSPENDED LIGHTING GRIDS, SUSPENDED CEILING, REFRIGERATION UNITS, ETC. PAINT UNISTRUT OR SUPPORTS TO MATCH COLOR OF STRUCTURE ABOVE. CONNECTIONS AT BAR JOIST SHALL BE MADE AT PANEL POINTS. UNISTRUT SUPPORTS ARE TO BE MANUFACTURED BY UNISTRUT.
- D. ALL OVERHEAD STRUCTURE AND SYSTEMS EXPOSED TO THE SALES AREA SHALL BE PAINTED AS SCHEDULED (INCLUDING BUT NOT LIMITED TO: ROOF BECK, STRUCTURE, PIPES, DUCTS, BRACING, SUPPLEMENTAL SUPPORTS & HANGERS, HARDWARE, CONDUITS AND COVER PLATES, ETC.).
- E. PENDANT LIGHTS TO BE SUPPORTED FROM ROOF STRUCTURE USING WHITE ELECTRICAL CORD SUPPLIED WITH LIGHTS. PROVIDE WHITE CEILING CANOPY @ JUNCTION BOX.
- F. ALL OVERHEAD PIPES, CONDUITS, ETC. SHALL BE INSTALLED BEHIND SOFFIT WALLS IS AT ALL POSSIBLE AND THOSE THAT ARE EXPOSED SHALL BE INSTALLED AS HIGH AS POSSIBLE THRU JOIST'S OPEN WEB SPACE. DUCTWORK SHALL BE INSTALLED AS HIGH AS POSSIBLE BELOW JOISTS.
- G. REFER TO WALL SECTION SHEETS FOR DETAILS RELATED TO SUSPENDING ALL BULKHEADS AND ANCHOR BOLTS FROM THE EXISTING STRUCTURE ABOVE. NOTE THAT SUPPLEMENTAL ANGLES AND UNISTRUT WILL BE REQUIRED.
- H. PROVIDE ULTRA-HIGH TEMPERATURE RATED SPRINKLER HEADS, OF 500°F TO 575°F, WITH IN 1' OF BAKERY OVEN OPERATING TEMPERATURE IS 400°F.
- I. FIRE SPRINKLER DESIGN IS UNDER SEPARATE PERMIT. SPRINKLER SYSTEM DESIGN ELEMENTS/CRIMINALS TO BE SUBMITTED AS A DEFERRED SUBMITTAL BY FIRE SPRINKLER CONTRACTOR'S LICENSED DESIGNER. GENERAL CONTRACTOR TO COORDINATE SUBMITTAL REQUIREMENTS WITH FIRE SPRINKLER CONTRACTOR.
- J. PROVIDE AND INSTALL R-13 SOUND ATTENUATING BATT INSULATION TO CEILING AT OFFICES, RESTROOMS, EMPLOYEE BREAK ROOM, AND ALL BACK OF HOUSE OFFICE. ALL PARTS SHALL NOT HAVE VAPOR BARRIER.
- K. GENERAL CONTRACTOR SHALL PROVIDE ANNUAL REGULAR MAINTENANCE SUPPORTS, TRUCKS, UNISTRUT, ETC. REQUIRED FOR ALL INTERIOR DEPARTMENTAL SIGNS AND GRAPHICS PROVIDED BY THE SIGN CONTRACTOR OR LUCKY'S. THE GC TO PROVIDE PERMITS AND COORDINATE WITH THE SIGN CONTRACTOR.

KEYED NOTES

- 1. SUSPENDED CEILING SHALL BE LAID OUT FROM CENTER POINT OF ROOM OR DEFINING SPACE. TYPICAL UNLESS SPECIFICALLY DIMENSIONED OTHERWISE. SEE DETAILS AS 12.07 ON SHEET A5.1 FOR ADDITIONAL LAY-IN CEILING INSTALLATION REQUIREMENTS.
- 2. HEADER FRAMED WITH (2) 800C162.54 METAL STUD BOX BEAM. SIMILAR TO DETAIL 06A3.2.1
- 3. INDICATES EXTENT OF VALVE ABOVE. FRAME BULKHEAD WITH (2) 800C162.54 METAL STUD BOX BEAM PER DETAIL 06A3.2.1
- 4. INDICATES EXHAUST HOODS MECHANICAL DRAWINGS FOR HOOD TYPE AND DETAIL 12A5.1 FOR REQUIRED FIRE RESISTANCE RATED PARTS.
- 5. PROVIDE AND INSTALL NON-COMBUSTIBLE CEILING WITHIN 18" OF PERIMETER OF HOODS. 24"x24" VINYL FACED GYPSUM BOARD PANELS.
- 6. TYPE II EXHAUST HOOD AT BAKERY OVEN TO BE SUPPLIED WITH OVEN. SEE MECHANICAL DRAWINGS FOR VENTING REQUIREMENTS.
- 7. FINISHES STEEL ENCLOSURE AROUND EXHAUST VENT FROM TOP OF HOOD TO ABOVE CEILING TO BE PROVIDED AND INSTALLED BY GENERAL CONTRACTOR.
- 8. TYPE II EXHAUST HOOD. SEE MECHANICAL DRAWINGS.
- 9. EXISTING ROOF ACCESS HATCH. SEE DETAIL FOR ADDITIONAL INFORMATION.
- 10. HEADER FRAMED WITH (2) 800C162.54 METAL STUD BOX BEAM. SIMILAR TO DETAIL 06A3.2.1
- 11. PRE-FINISH WALK-IN CEILING PANELS AND EVAPORATOR UNIT MOUNTED TO COOLER/FREEZER CEILING. REFER TO WALK-IN BOX DRAWINGS AND REFRIGERATION DRAWINGS.
- 12. LIGHT FIXTURE. REFER TO ARCHITECTURAL LIGHTING PLAN AND ELECTRICAL DRAWINGS.
- 13. PROPOSED SKYLIGHTS ABOVE.
- 14. PROVIDE ACCESS TO SPACE ABOVE GYP BOARD CEILING. MINIMUM 24" X 30" ACCESS PANEL IN GYP. CEILING OR ACCESS FROM LAY-IN CEILING IN ADJACENT SPACE.
- 15. EXISTING ENTRY SOFFIT TO REMAIN CLEAN AND REPAIR AS REQUIRED.
- 16. FRAME GYPSUM BOARD CEILING WITH 362C162-48 METAL STUDS @ 16" OC MAX. WITH CONTINUOUS TRACK AT ALL WALLS. RUN CEILING JOIST'S MINIMUM WIDTH OF ROOM.
- 17. FRAME GYPSUM BOARD CEILING WITH 600C162-48 METAL STUDS @ 16" OC MAX. WITH CONTINUOUS TRACK AT ALL WALLS. RUN CEILING JOIST'S MINIMUM WIDTH OF ROOM.
- 18. not used
- 19. not used
- 20. PAINT TO MATCH WALL ABOVE. SEE INTERIOR FINISH PLAN AND ELEVATIONS.
- 21. COORDINATE IN FIELD - IF REQUIRED - MOUNT LIGHT FIXTURE AT OVERHEAD DOOR TO BE 16" CLEAR ABOVE DOOR IN OPEN POSITION.
- 22. EXISTING METAL CANOPY OVER EXTERIOR DOORS TO REMAIN.
- 23. SEE SECTION D1A5.0 FOR ISLAND CEILING SOFFIT FRAMING NOTES.
- 24. AIR CURTAIN INSTALLED ABOVE DOOR. SEE MECHANICAL PLAN FOR ADDITIONAL NOTES.
- 25. EXISTING ENTRY VESTIBULE TO CEILING TO REMAIN. REMOVE EXISTING LIGHT FIXTURES AND REPLACE WITH NEW IN PLACE. SEE ELECTRICAL LIGHTING PLAN.

CRITICAL NOTE: THERE SHALL BE NO COMBUSTIBLE MATERIALS INSTALLED WITHIN 24" OF THE EXPOSED GREASE DUCT, INCLUDING BUT NOT LIMITED TO FRAMING OR BLOCKING, PLASTIC (COMBUSTIBLE) CONDUIT, DATA CABLING, WIRING ETC. GENERAL CONTRACTOR SHALL ENSURE ALL TRADES MAINTAIN MINIMUM INSTALLATION SEPARATION OF MATERIALS TO THE GREASE DUCTWORK FROM ALL TYPE I EXHAUST HOODS.

NOTE: ALL ITEMS IN EXPOSED PUBLIC AREA, INCLUDING BUT NOT LIMITED TO: ROOF STRUCTURE, HANGERS, BRACING, DUCTWORK, CONDUIT, PIPING ETC. SHALL BE PAINTED C-1. SEE ROOM FINISH SCHEDULE SHEET A6.1.2

CEILING FINISH SCHEDULE

C-1	FINISH- EXPOSED STRUCTURE AND DECK, PAINTED. REMARKS: SEE CEILING FINISH SCHEDULE ON SHEET A6.1.2 FOR ADDITIONAL INFORMATION.
C-2	CEILING TILE. FINISH- 24" CEILING TILE WHITE (ACQUILITA CLASS A). REMARKS: SEE CEILING FINISH SCHEDULE ON SHEET A6.1.2 FOR ADDITIONAL INFORMATION.
C-3	CEILING TILE. FINISH- 24" VINYL FACED CEILING TILE WHITE (CLEAVABLE) CLASS A. REMARKS: SEE CEILING FINISH SCHEDULE ON SHEET A6.1.2 FOR ADDITIONAL INFORMATION.
C-4	FINISH- 58" GYPSUM BOARD ON METAL FRAMING, PAINTED. REMARKS: SEE CEILING FINISH SCHEDULE ON SHEET A6.1.2 FOR ADDITIONAL INFORMATION. PROVIDE MOISTURE RESISTANT WALL BOARD AT RESTROOMS.
C-5	CEILING PANEL. FINISH- PRE MANUFACTURED COOLER/FREEZER CEILING PANELS MANUFACTURER: COOLER/FREEZER MANUFACTURER.
C-6	FINISH- EXPOSED STRUCTURE AND DECK, UNPAINTED. REMARKS: SEE CEILING FINISH SCHEDULE ON SHEET A6.1.2 FOR ADDITIONAL INFORMATION.
C-7	CEILING TILE. FINISH- 30" VINYL FACED CEILING TILE WHITE (CLEAVABLE) CLASS A. REMARKS: SEE CEILING FINISH SCHEDULE ON SHEET A6.1.2 FOR ADDITIONAL INFORMATION.

LEGEND:

- EXISTING WALL CONSTRUCTION TO REMAIN
- METAL STUD WALL CONSTRUCTION
- RATED DEMISING WALL ASSEMBLY
- METAL STUD WALL CONSTRUCTION
- MASONRY WALL CONSTRUCTION
- COOLER OR FREEZER PANELS (PRE-FABRICATED)
- VALANCE, CANOPY, OR HEADER ABOVE
- WALL ABOVE COOLER

wd
NOT DISCLOSED BY BLVD
LIN, OH 4
614.470.00 T
WDP.INDIANACOM.COM

Lucky's Market

LUCKY'S MARKET
PROMENADE AT NAPLES
6424 NAPLES BLVD.
NAPLES, FL 34109

REVISIONS

- 1
- 2
- 3
- 4
- 5
- 6
- 7
- 8
- 9
- 10
- 11
- 12
- 13
- 14
- 15
- 16
- 17
- 18
- 19
- 20
- 21
- 22
- 23
- 24
- 25

PERMIT ISSUE
MAY 7, 2018
BID ISSUE 05/07/18
STORE NUMBER
57
WD PROJECT NUMBER
LKYUF0011

A1.3.1 REFLECTED CEILING PLAN