


PROPOSED UNDERGROUND CONDUIT ROUTING. NOTE MORE THAN ONE CONDUIT MAY BE REQUIRED. COORDINATE UNDERGROUND CONDUITS WITH REFRIGERATION AND PLUMBING CONTRACTOR TO MINIMIZE SLAB TRENCHING.

**GENERAL NOTES**

- COORDINATE ALL EQUIPMENT CONNECTIONS WITH SUPPLIER AND LOCATIONS WITH LUCKY'S CONSTRUCTION MANAGER.
- ELECTRICAL CONTRACTOR SHALL REWIRE EXISTING CIRCUITS FOR EXISTING REMAIN EQUIPMENT. REWIRING CIRCUITING IN FIELD AND UPDATES PANEL SCHEDULES AND CIRCUITING ACCORDINGLY.

**KEYED NOTES**

- COORDINATE LOCATION/MOUNTING HEIGHT WITH LUCKY'S MARKET.
- OUTLET TO BE INSTALLED IN BASE OF FIXTURE.
- PROVIDE CONNECTION TO THE TRASH CHUTE EXHAUST FAN PROVIDED WITH THE COMPACTOR. VERIFY CONNECTION WITH MANUFACTURER'S INSTALLATION INSTRUCTIONS.
- EC TO WIRE TO FACTORY PROVIDED AIR-DOOR DISCONNECT/CONTROL PANEL.
- VERIFY IF AUTOMATIC DOORS ARE EXISTING OR NEED TO CONNECT TO AUTOMATIC DOOR OPERATOR. EXISTING TO REMAIN THE EC SHALL FIELD VERIFY WHAT PANEL(S) THEY EQUIPMENT IS FED FROM AND UPDATE THE PANEL SCHEDULES AND CIRCUITING ACCORDINGLY.
- RECEPTACLE TO BE INSTALLED ON WALL 6" ABOVE GLASS. CIRCUIT IS CONNECTED TO BUILDING EMS TO BE ON DURING OCCUPIED HOURS ONLY.
- COORDINATE EXACT LOCATION OF RECEPTACLES FOR DRINKING FOUNTAIN WITH EQUIPMENT REQUIREMENTS AND PLUMBING CONTRACTOR.
- JUNCTION BOX TO BE INSTALLED UNDER SHELVING UNIT. CONDUITS BETWEEN JUNCTION BOX AND RECEPTACLES TO RUN UNDER SHELVING/EQUIPMENT TO RECEPTACLES.
- RECEPTACLES FOR COFFEE GRINDERS AND HONEY WARMER ARE MOUNTED ON THE FACE OF THE MILLWORK BEHIND THE EQUIPMENT.
- RECEPTACLE FOR TV MOUNTED TO VALENCE AND/OR WALL. COORDINATE LOCATION AND MOUNTING HEIGHT WITH LUCKY'S MARKET PRIOR TO ROUGH-IN.
- COORDINATE EQUIPMENT CIRCUIT REQUIREMENTS WITH WITH EQUIPMENT REQUIREMENTS PRIOR TO INSTALLATION.
- FLOOR BOX TO CONTAIN POWER AND DATA FOR TEMPORARY CHECKOUT. REFER TO SHEET E301 FOR DATA REQUIREMENTS.
- COORDINATE FLOOR BOX LOCATIONS WITH LUCKY'S MARKET PRIOR TO INSTALLATION.
- CONNECTION TO SOUP BAR. REFER TO SHEET E103 FOR REFRIGERATED SALAD BAR LIGHTS AND FAN CIRCUITING.
- RECEPTACLES FOR NUT GRINDERS ARE MOUNTED IN THE BOTTOM OF MILLWORK BELOW THE GRINDERS.
- RECEPTACLES TO BE INSTALLED INSIDE MILLWORK. COORDINATE WITH LUCKY'S MARKET AND MILL WORK MANUFACTURE.
- RECEPTACLE SHALL BE MOUNTED HORIZONTALLY AT 42" A.F.F. UNLESS OTHERWISE NOTED.
- RECEPTACLE SHALL BE MOUNTED HORIZONTALLY AT 48" A.F.F. UNLESS OTHERWISE NOTED.
- CONTRACTOR SHALL RUN 3/12 FROM PANEL CL CONTROL RELAY TERMINAL BLOCK TO THE ASCO 920 CONTACTOR FEEDING PANEL CL. REFER TO RISER FOR ADDITIONAL INFORMATION.
- PROVIDE AND INSTALL A SWITCH IN THE MILLWORK TO CONTROL THE REGISTER LANE OPEN LIGHTS. COORDINATE LOCATION OF SWITCH WITH LUCKY'S CONSTRUCTION MANAGER.
- EC SHALL RUN A NEUTRAL CONDUCTOR ALONG WITH THE PHASE CONDUCTORS TO THIS EQUIPMENT.
- CONDUITS TO RECEPTACLES/EQUIPMENT IN THIS AREA ARE TO COME DOWN WALL AND INTO THE BASE OF THE FIXTURES.
- WIRE AND CONDUIT TO EQUIPMENT CONNECTIONS OR RECEPTACLES MOUNTED IN REFRIGERATED CASES ARE TO COME DOWN FROM OVERHEAD AND FOLLOW THE REFRIGERATION PIPING ABOVE OR BELOW SLAB. COORDINATE WORK WITH REFRIGERATION CONTRACTOR IN THE FIELD.
- EXTEND THE EXISTING TELEPHONE CONDUIT FROM THE ELECTRIC ROOM TO LOCATION SHOWN.

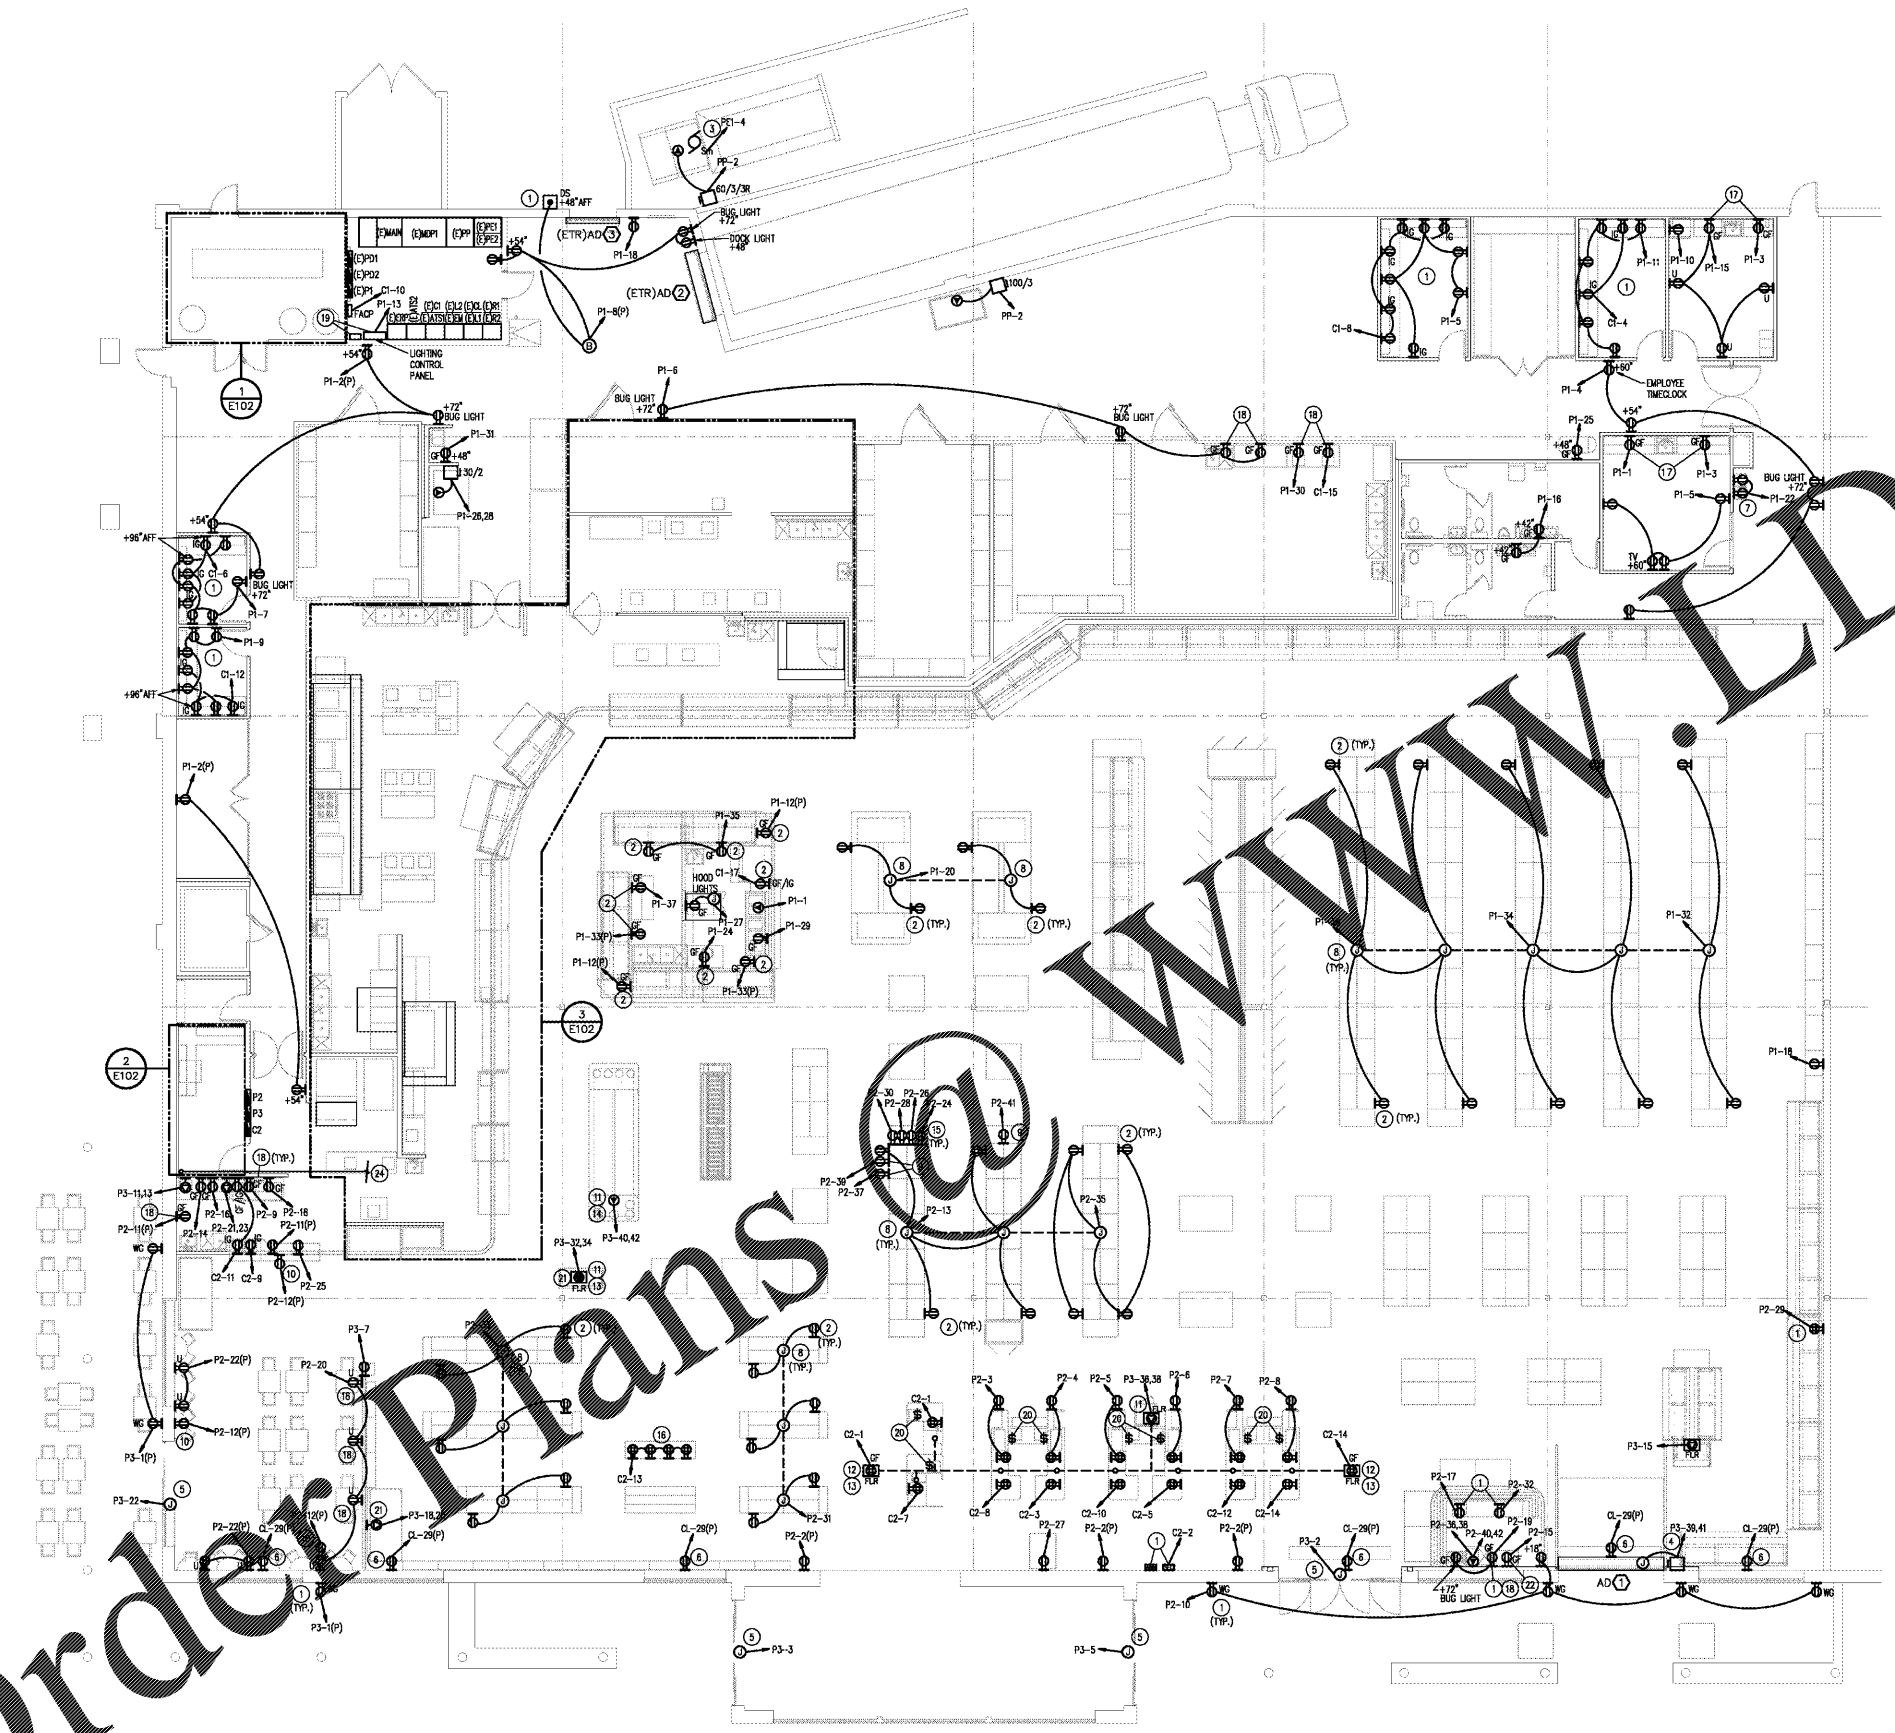


**POWER PLAN**  
 1/8" = 1'-0"

Order Plans

**Lucky's Market**

LUCKY'S MARKET  
 6420 NAPLES BLVD.  
 NAPLES, FLA. 34108



REVISIONS

PERMIT ISSUE  
 APRIL 27, 2019  
 BID ISSUE 04/27/19  
 STORE NUMBER  
 57  
 WD PROJECT NUMBER  
 LKYUF001