



Order Plans @

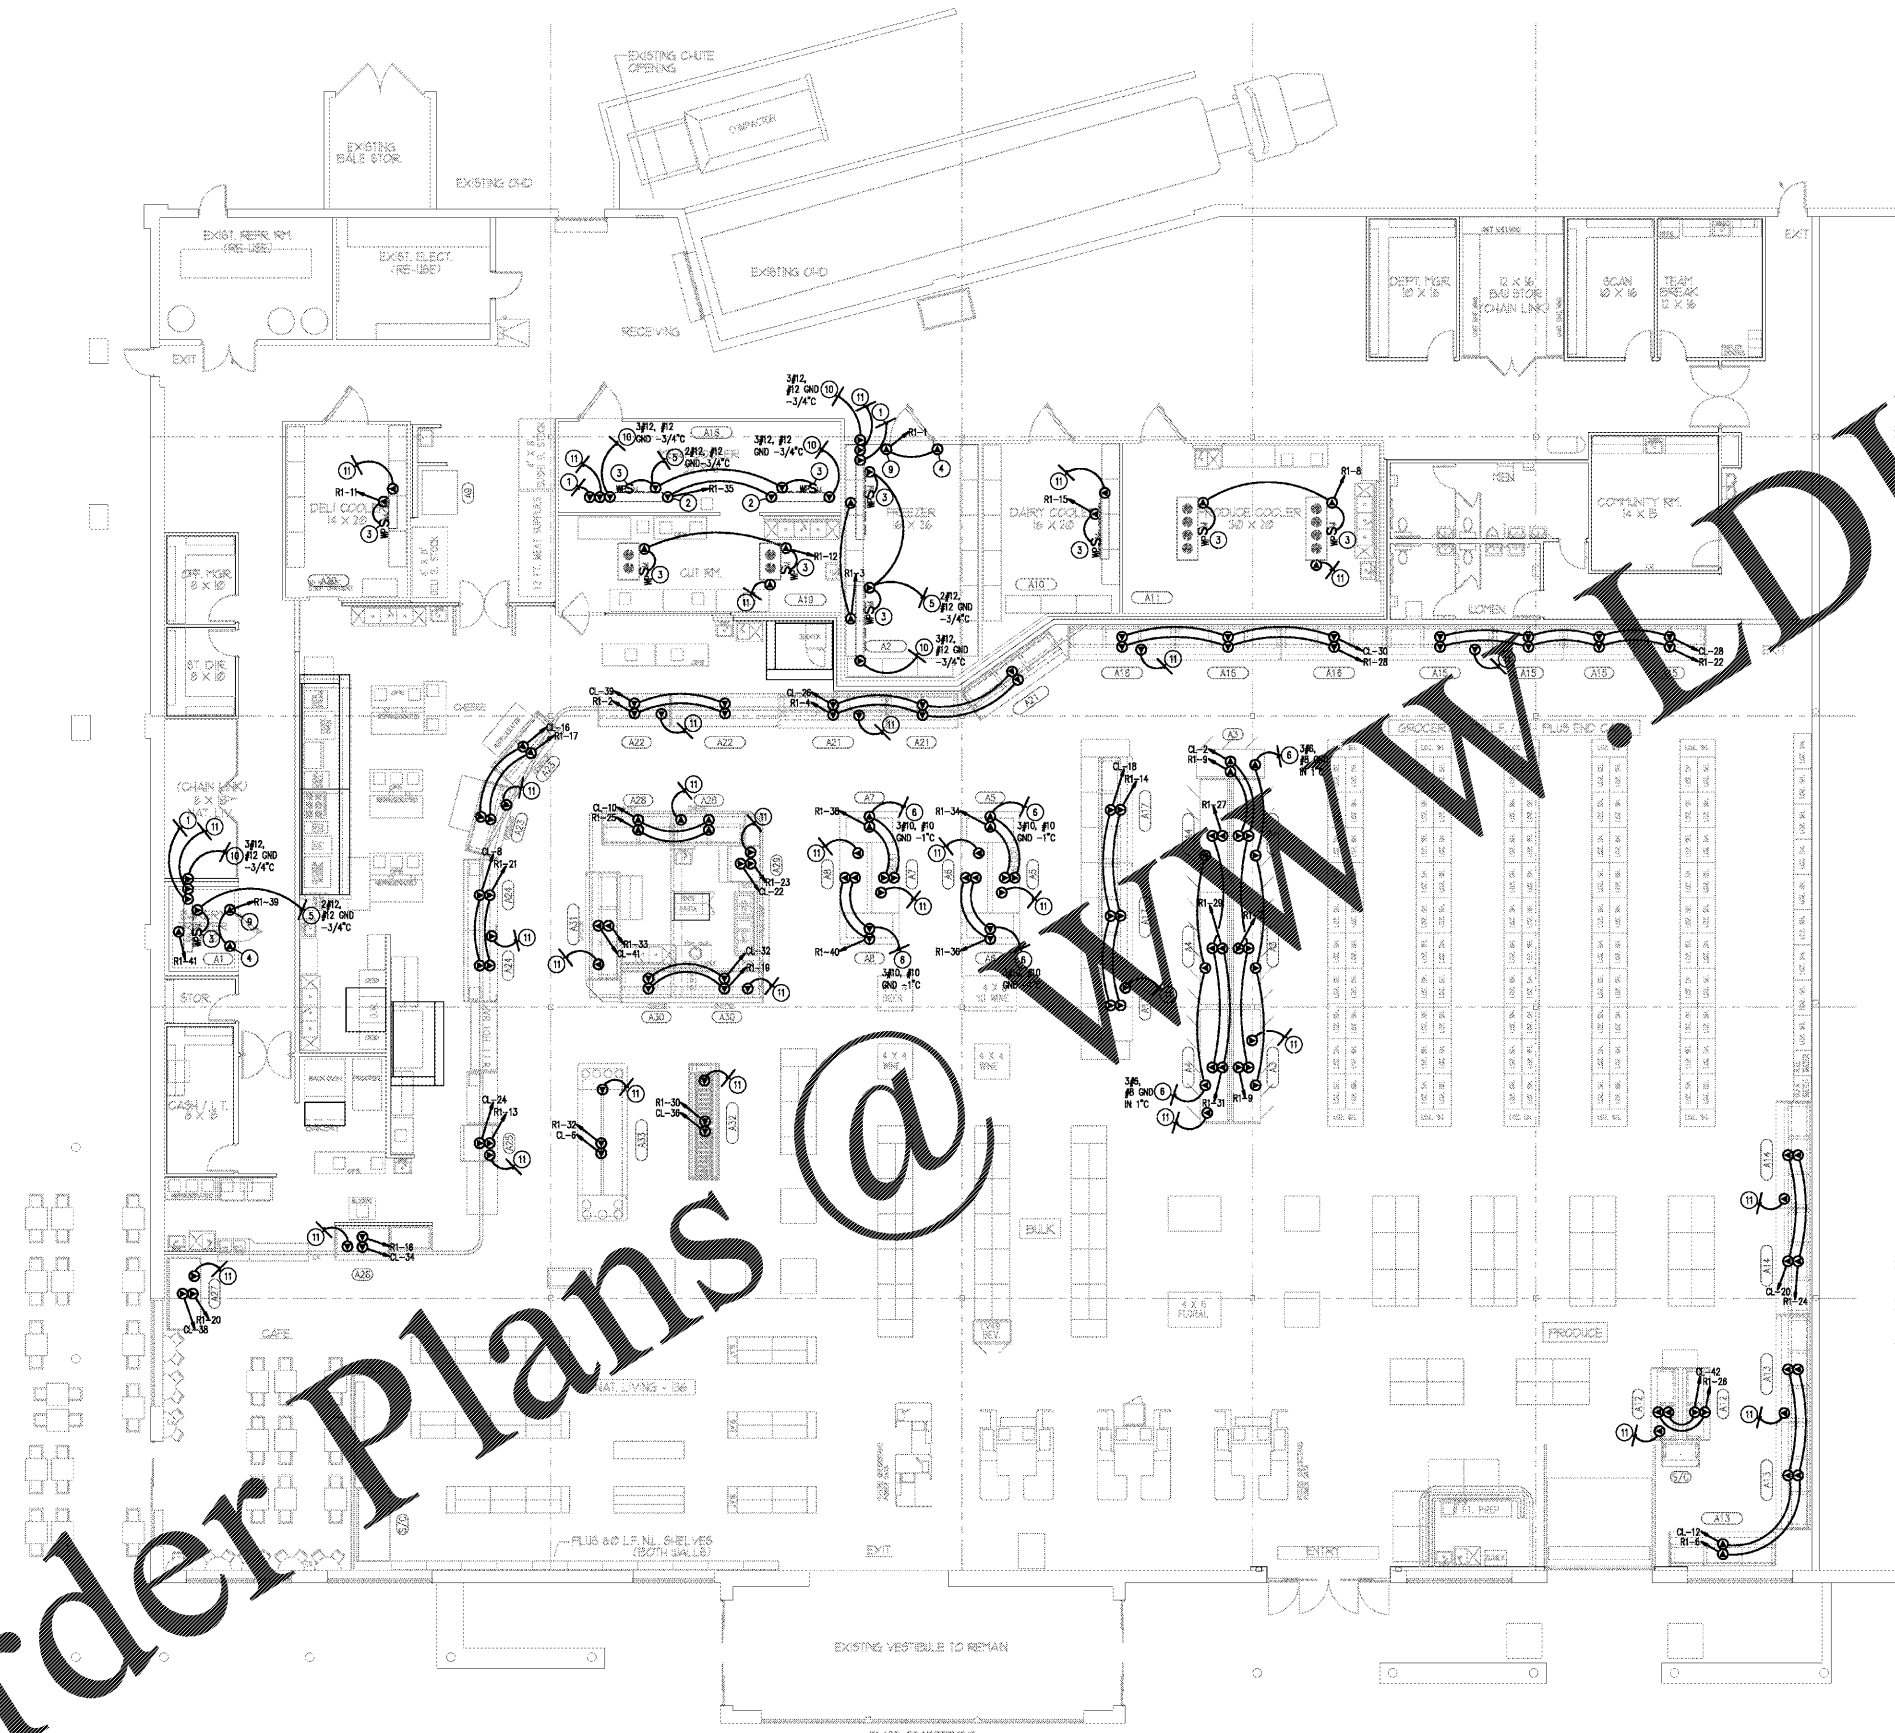


PROPOSED UNDERGROUND CONDUIT ROUTING. NOTES: (1) CONDUIT MAY BE REQUIRED TO BE UNDERGROUND CONDUIT WITH REFRIGERATION AND PLUMBING CONTRACTOR TO MINIMIZE SLAB STRENGTH.

- KEYED NOTES**
- 1 CONNECTION POINT FOR FAN DELAY CONTROLS. RUN 2#12 FROM THE EVAPORATOR(S) TO RACK CONTROL PANEL. SEE SHEET R7 FOR MORE DETAIL.
 - 2 CONNECT TO DRAIN LINE HEATER.
 - 3 MOUNT ON CEILING NEXT TO FAN COIL UNIT.
 - 4 CONNECT TO DOOR HEATER CABLE.
 - 5 INTERCONNECT FAN COIL MOTOR WITH DEFROST CONTROL PANEL. SEE REFRIGERATION PLANS FOR MORE INFORMATION.
 - 6 DEFROST FED FROM REFRIGERATION RACK DEFROST CONTROL PANEL. DISTRIBUTE THE 1 PHASE CASE DEFROST HEATER CIRCUITS EVENLY ACROSS ALL 3 PHASES (A-B, B-C, C-A, ETC.). SEE REFRIGERATION PLANS FOR MORE INFORMATION. CONDUIT SIZE INDICATED SHALL BE RUN TO DEFROST HEATER CONNECTION POINT ON EACH CASE.
 - 7 CASE POWER, LIGHTING, AND CONTROL CONDUITS TO FOLLOW REFRIGERATION PIPING OVERHEAD THEN DOWN THROUGH WALL OR CHASE AND INTO CASE. COORDINATE WORK WITH REFRIGERATION CONTRACTOR.
 - 8 CASE POWER, LIGHTING, AND CONTROL CONDUITS TO BE RUN IN SAME SLAB TRENCH AS REFRIGERATION OR PLUMBING PIPING WHEN POSSIBLE. COORDINATE WORK WITH REFRIGERATION AND PLUMBING CONTRACTORS.
 - 9 CONNECT TO HEATED AIR VENT.
 - 10 INTERCONNECT DEFROST HEATER WITH DEFROST CONTROL PANEL. SEE REFRIGERATION PLANS FOR MORE INFORMATION.
 - 11 CONNECTION POINT FOR LINE VOLTAGE EPR OR SUCTION LINE SOLENOID VALVE. RUN 2#12 FROM VALVE TO RACK CONTROL PANEL. SEE REFRIGERATION PLANS FOR MORE INFORMATION.



Lucky's Market

LUCKY'S MARKET
6420 NAPLES BLVD.
NAPLES, FLA. 34108



REVISIONS

PERMIT ISSUE
APRIL 27, 2019
BID ISSUE 04/27/19
STORE NUMBER
57
WD PROJECT NUMBER
LKYUF001

E103

CASE POWER AND LIGHTING PLAN