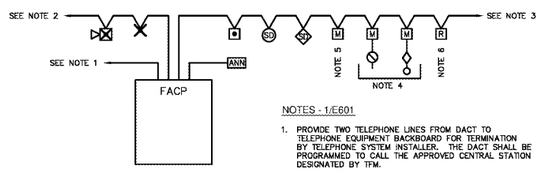

NOTES - 1/E601

1. PROVIDE TWO TELEPHONE LINES FROM DACT TO TELEPHONE EQUIPMENT BACKBOARD FOR TERMINATION BY TELEPHONE SYSTEM INSTALLER. THE DACT SHALL BE PROGRAMMED TO CALL THE APPROVED CENTRAL STATION DESIGNATED BY TFM.
2. TO OTHER ALARM NOTIFICATION APPLIANCES. REFER TO PLANS FOR QUANTITIES.
3. TO OTHER ADDRESSABLE DEVICES. REFER TO PLANS FOR TYPES AND QUANTITIES.
4. REFER TO FIRE PROTECTION SHOP DRAWINGS FOR QUANTITIES AND LOCATIONS OF SPRINKLER FLOW AND TAMPER SWITCHES.
5. MONITOR MODULE FOR HOOD FIRE SUPPRESSION SYSTEM.
6. TYPICAL CONTROL RELAY FOR RTU FAN SHUTDOWN AND ELEVATOR CONTROL (IF ELEVATOR IS PRESENT).

1/E601 FIRE ALARM SYSTEM RISER
NONE

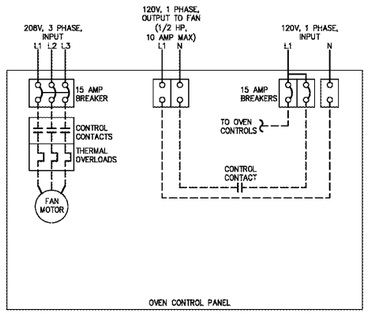

LBC Model LRO-1G5

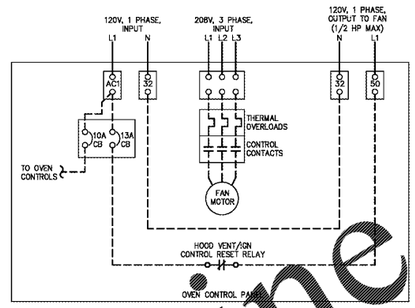

Baxter Model GV21C

2/E601 BAKERY OVEN EXHAUST FAN WIRING DIAGRAMS
NONE

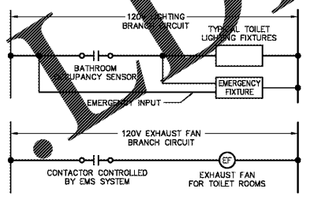

NOTES - 4/E601

1. THIS DETAIL IS TYPICAL FOR ALL TOILETS.

4/E601 OCCUPANCY SENSOR WIRING – TOILETS
NONE

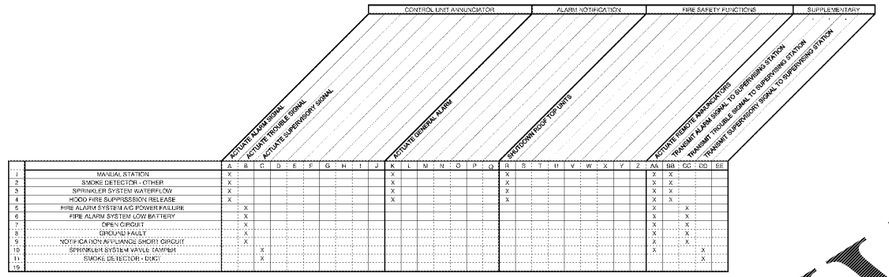

	A	B	C	D	E	F	G	H	I	J	K	L	M	N	O	P	Q	R	S	T	U	V	W	X	Y	Z	AA	BB	CC	DD	EE
1 MANUAL STATION	X										X							X									X	X			
2 SMOKE DETECTOR - OTHER	X										X							X									X	X			
3 SPRINKLER SYSTEM WATERFLOW	X										X							X									X	X			
4 HOOD FIRE SUPPRESSION RELEASE	X										X							X									X	X			
5 FIRE ALARM SYSTEM A/C POWER FAILURE		X																									X		X		
6 FIRE ALARM SYSTEM LOW BATTERY		X																									X		X		
7 OPEN CIRCUIT		X																									X		X		
8 GROUND FAULT		X																									X		X		
9 NOTIFICATION APPLIANCE SHORT CIRCUIT		X																									X		X		
10 SPRINKLER SYSTEM VALVE TAMPER			X																								X			X	
11 SMOKE DETECTOR - DUCT			X																								X			X	

3/E601 FIRE ALARM SYSTEM MATRIX
NONE

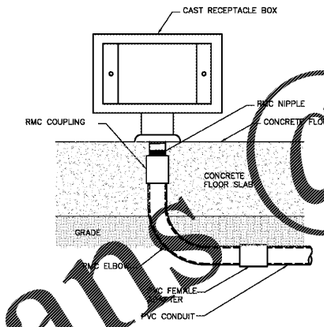

5/E601 BAKERY ABOVE FLOOR BOX
NOT TO SCALE

6/E601 SHUNT TRIP CONTROL DIAGRAM
NONE

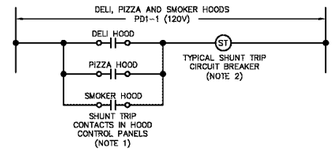

1. OPEN DRY CONTACTS IN GREASE HOOD CONTROL PANELS. COORDINATE WIRING CONNECTIONS WITH HOOD SHOP DRAWINGS.
2. TYPICAL 120V SHUNT TRIP COIL IN PANELBOARD PD1 AND PD2.

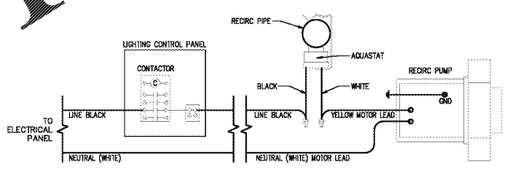

8/E601 HOT WATER RECIRC PUMP CONTROLS
NONE

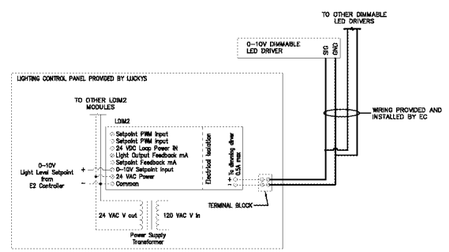

7/E601 0-10V DIMMING MODULE WIRING DIAGRAM
NOT TO SCALE

Order Plans @ WWW.LDLine.com

DWYER ENGINEERING
Scott Evans P
Suite 200
Leesburg, VA 20176
www.dwyer.com
PHONE
703-777-5988
EMAIL
info@dwyer.com

Lucky's Market

LUCKY'S MARKET
6420 NAPLES BLVD.
NAPLES, FLA. 34109

BRIAN S. DAVIS
LICENSE
No. 73666
STATE OF FLORIDA
PROFESSIONAL ENGINEER

REVISIONS

PERMIT ISSUE
APRIL 27, 2018
BID ISSUE 04/27/18
STORE NUMBER
57
WD PROJECT NUMBER
LKYUP0011

E601 ELECTRICAL DETAILS