



LEGEND:
--- FIELD WIRING BY ELEC. CONTR.
--- BULDEN #8781 STD. OPTS. W/4. CABLE FURNISHED & INSTALLED BY ELEC. CONTR.
--- CONTROL WIRING FURNISHED & INSTALLED BY ELEC. CONTR.
--- FACTORY WIRING
--- NUMBER OF CONDUCTORS UNLESS OTHERWISE NOTED
--- FORWARD DELAY T-STAT. --- HEATER T-STAT. --- DEFROST TERMINATION T-STAT.
--- DEFROST TERMINATION T-STAT.
--- HEATER T-STAT. AT CONTROLLER BOARD. ALARM/LOG INPUT AT CONTROLLER BOARD.
--- FAN CONTRACTOR. --- DEFROST CONTRACTOR.

FIELD WIRING NOTES:
1. ALL FIELD WIRING BY ELECTRICAL CONTRACTOR.
2. ALL CONDUIT FOR EMS SYSTEM FURNISHED & INSTALLED BY ELEC. CONTR.
3. IF WIRING THRU WIRE CAGE OR LOCK FOR SYSTEM, SERIES THE DEFROST TERMINATION T-STATS.
4. ELECTRICAL CONTRACTOR TO REFER TO NOTES ON REFRIGERATION SCHEDULE.

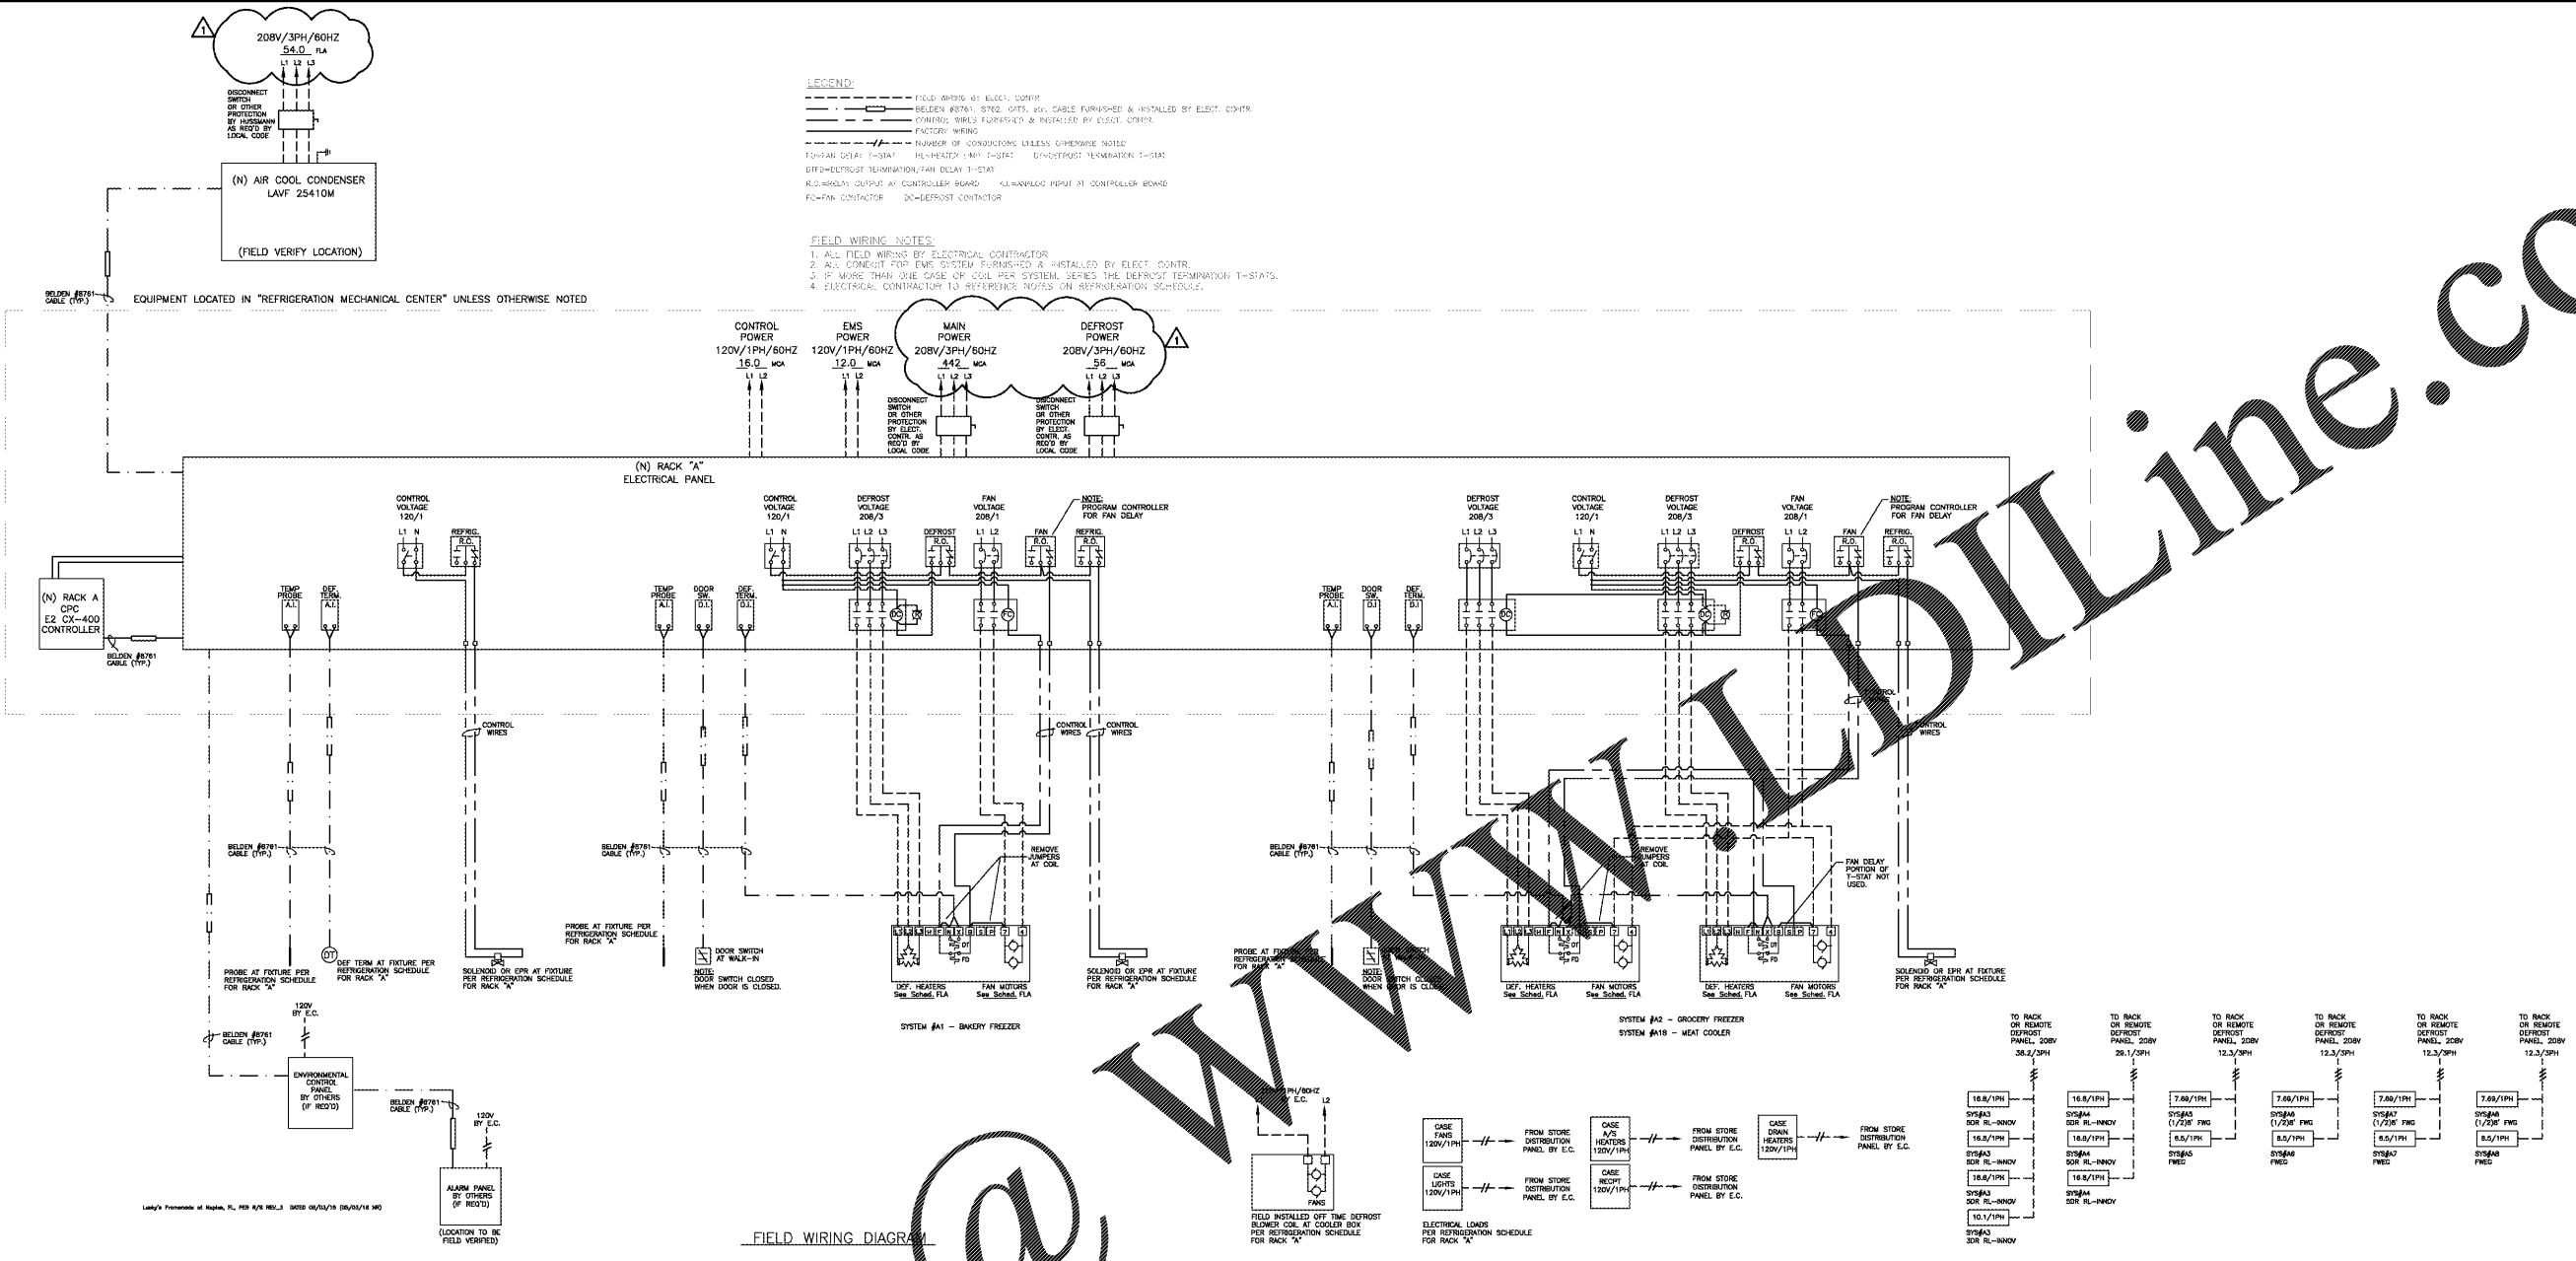

FIELD WIRING DIAGRAM

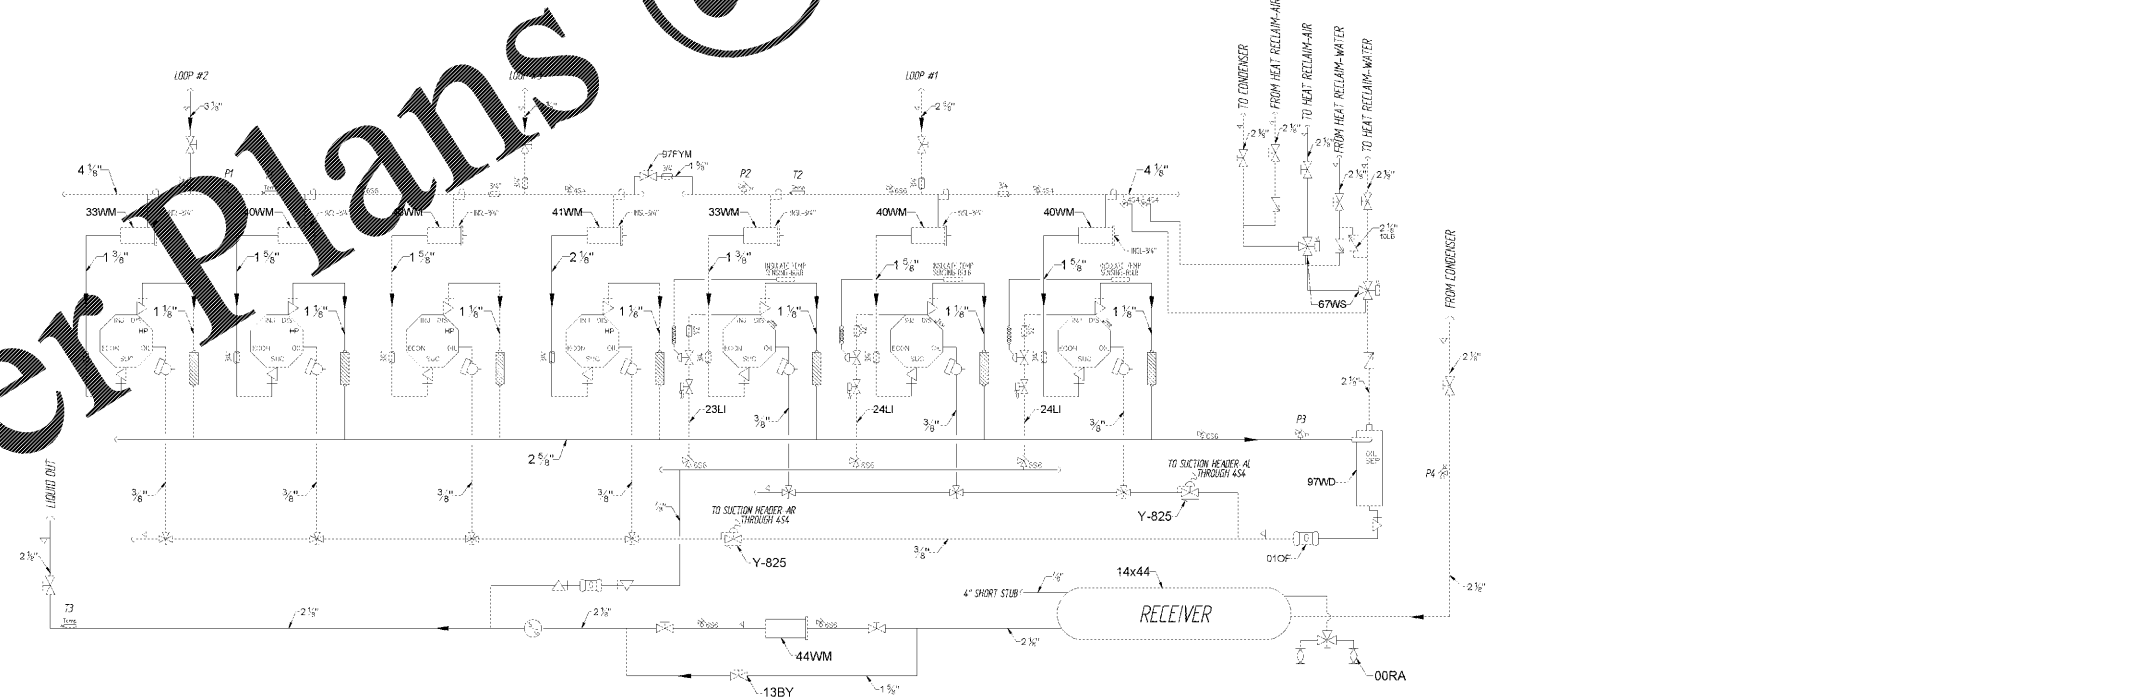

Order Plans @