SHEET NOTES

1. RELAY SHALL BE PROGRAMMED TO ZONE 1
2. RELAY SHALL BE PROGRAMMED TO ZONE 2
3. RELAY SHALL BE PROGRAMMED TO ZONE 3
4. WHEN PARTITION IS OPEN, ZONE 1 IN BOTH ROOMS SHALL BE COMBINED INTO A SINGLE ZONE. ZONE 2 IN BOTH ROOMS SHALL BE COMBINED INTO A SINGLE ZONE, AND ZONE 3 IN BOTH ROOMS SHALL BE COMBINED INTO A SINGLE ZONE.

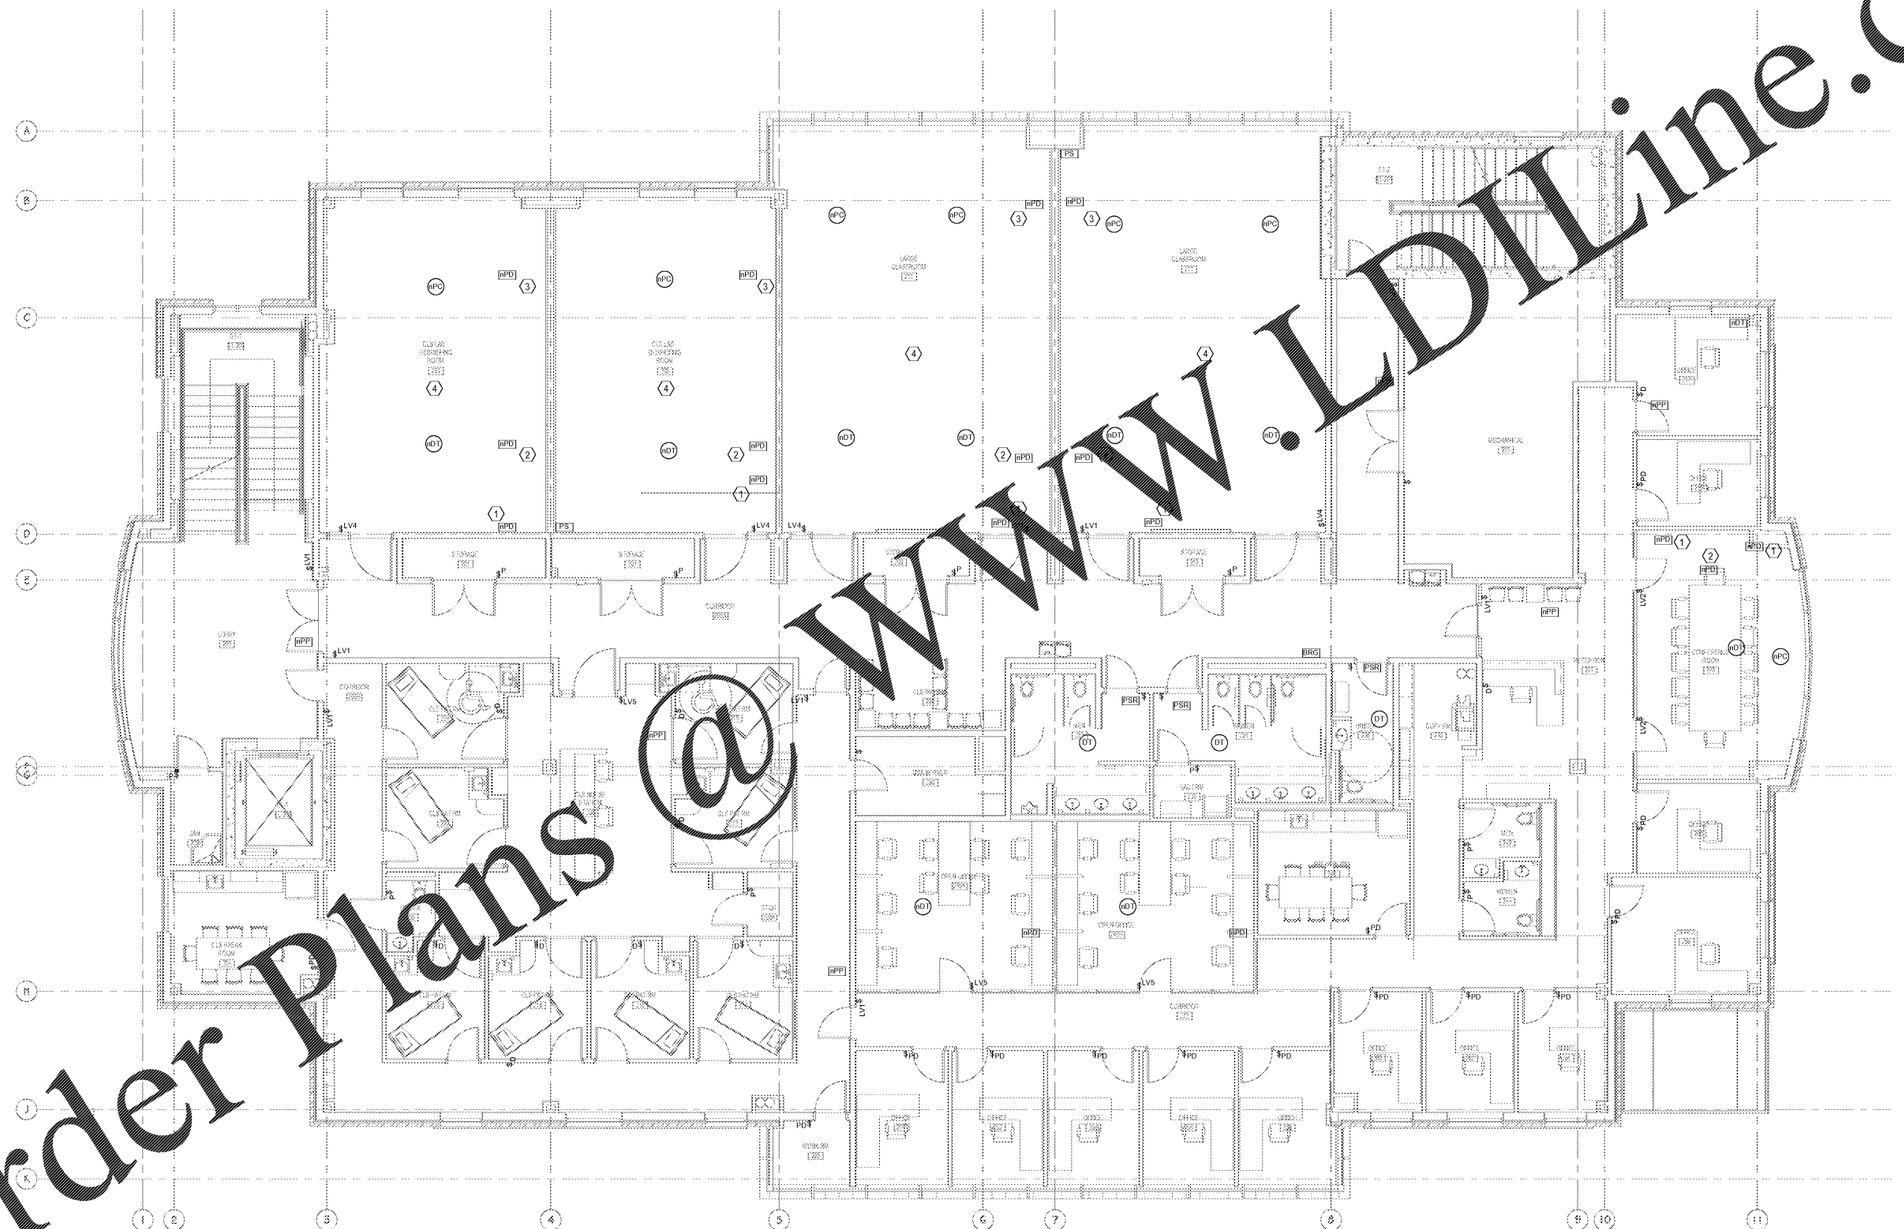

PLAN NORTH

1 2ND FLOOR LIGHTING CONTROL PLAN

SCALE: 3/16"=1'-0"

SCHMIDT CONSULTING GROUP, INC.
MECHANICAL ELECTRICAL STRUCTURAL COMMUNICATIONS INDUSTRIAL
ALABAMA LICENSE NUMBER 3542
601 W. Garden St. Pensacola, FL 32502
P: 850.438.0050 F: 850.432.6631
TODD NICHOLSON, P.E.
ALABAMA LICENSE NUMBER 29943-E
SCG PROJECT: 2016-151

2701 1st Avenue S
Birmingham, AL 35233
T 205.879.4462
GMCNETWORK.COM

ISSUE | DATE
ISSUE FOR BID | 2018.05.25

DRAWN BY: JTH
CHECKED BY: TTAN

SIMULATION LABORATORY
BUILDING - USA JOB #16-07
MOBILE, ALABAMA
ABC #2017372
GMC # AMOB160019

ALABAMA LICENSE 29943-E PROFESSIONAL ENGINEER TODD ALAN NICHOLSON

2ND FLOOR LIGHTING CONTROL PLAN

E205

sheet of

5/23/2018 8:01:13 AM

Order Plans @ WWW.LDLine.com GMC