SHEET NOTE

1. CONNECT DAC TO DCU-1 LOCATED OUTSIDE OF BUILDING. REFER TO MECHANICAL EQUIPMENT SCHEDULE FOR WIRE AND CONDUIT SIZE.
2. PROVIDE JUNCTION BOX FOR CONNECTION TO AHU UV AND MAINTENANCE LIGHTING. COORDINATE EXACT LOCATION WITH MECHANICAL CONTRACTOR PRIOR TO ROUGH-IN.

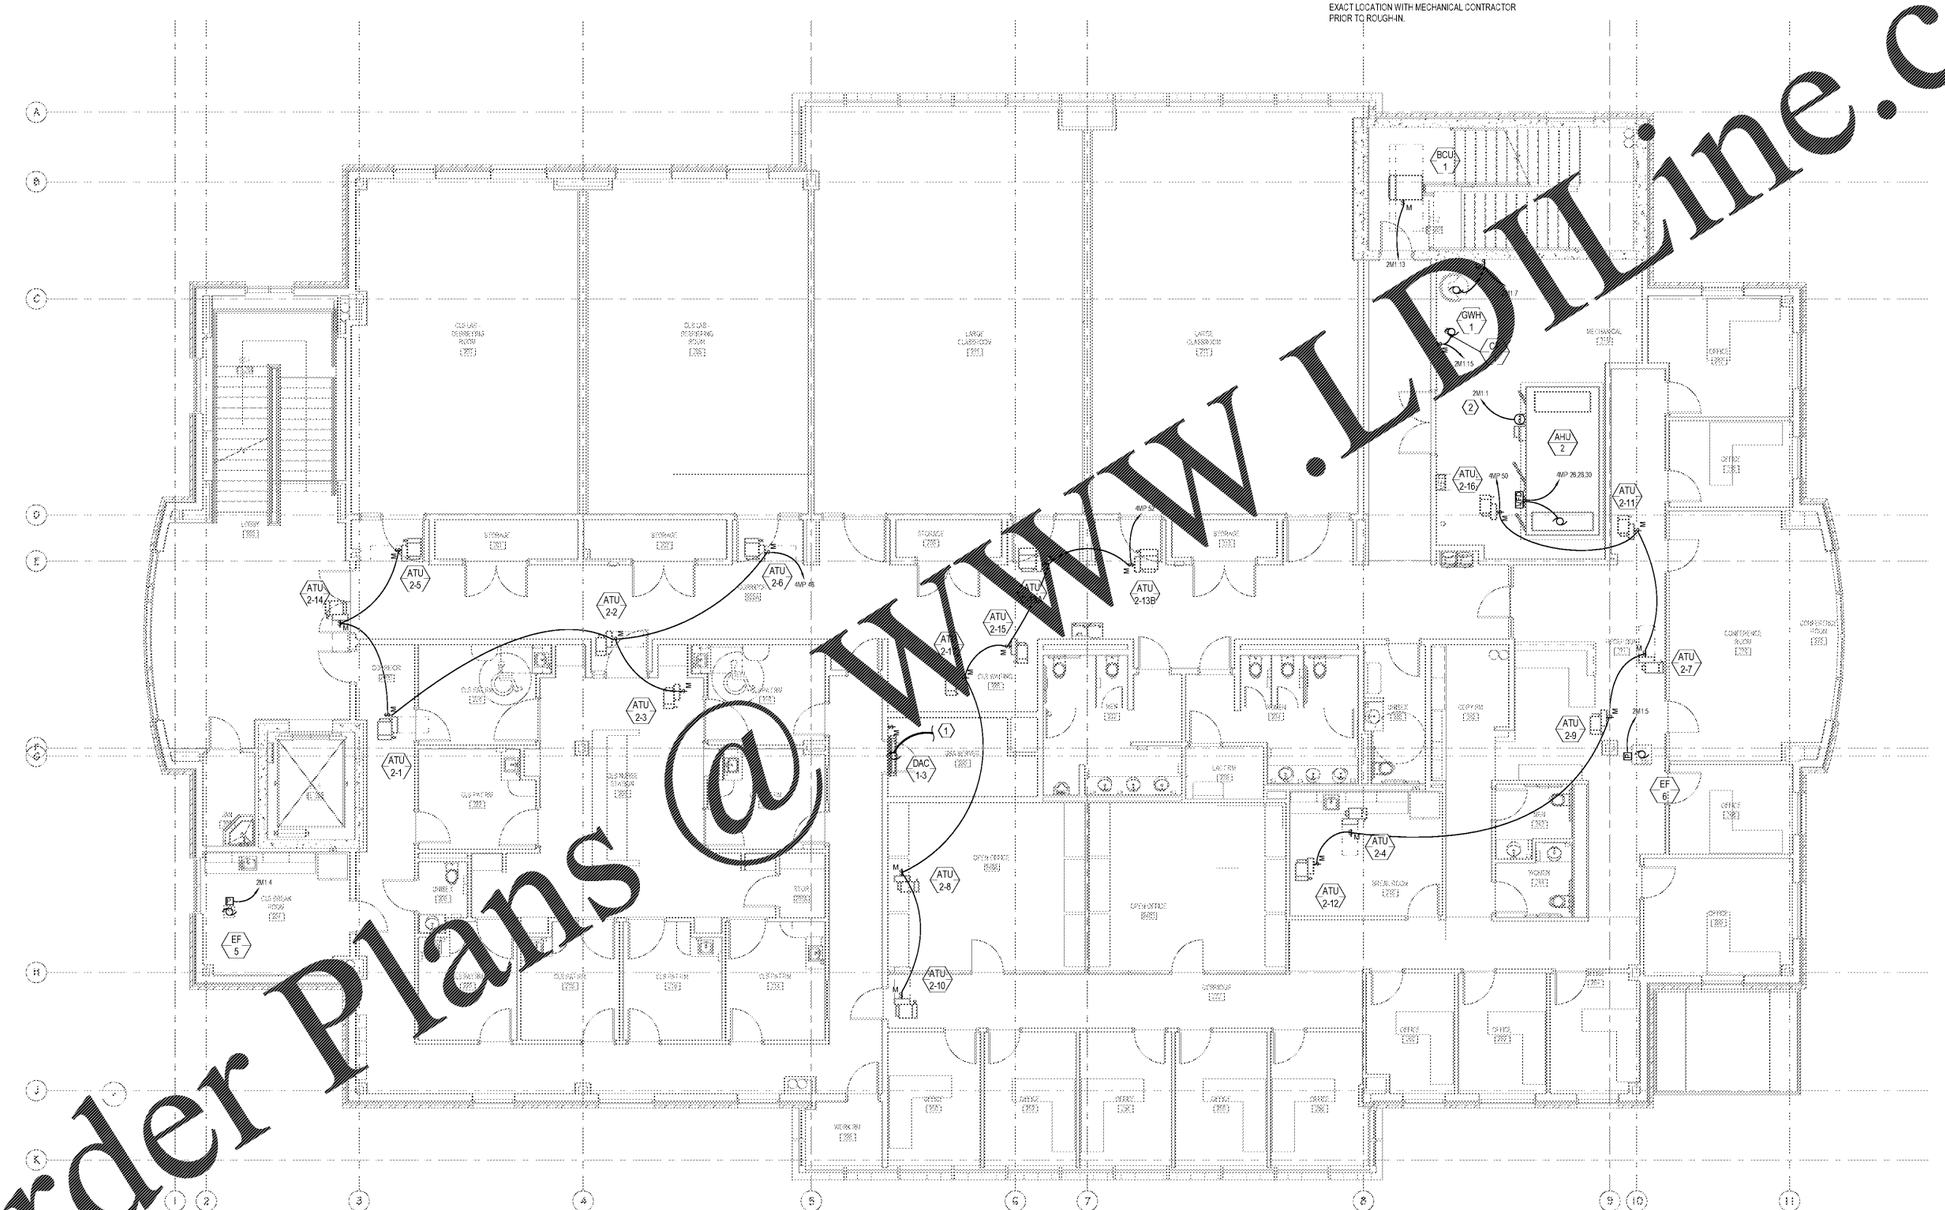
BCU 1
GWH 1
AHU 2
DAC 1-3
EF 5
EF 6
ATU 2-1
ATU 2-2
ATU 2-3
ATU 2-4
ATU 2-5
ATU 2-6
ATU 2-7
ATU 2-8
ATU 2-9
ATU 2-10
ATU 2-11
ATU 2-12
ATU 2-13B
ATU 2-14
ATU 2-15
ATU 2-16
4MP 45
4MP 50
4MP 26,28,30
2M1.1
2M1.13
2M1.15
2M1.4
2M1.5
CLS LAB DEMONSTRATING ROOM
CLS LAB OBSERVATING ROOM
LARGE CLASSROOM
LARGE CLASSROOM
MECHANICAL ENTRY
CONFERENCE
OPEN OFFICE
OPEN OFFICE
SERVER ROOM
LAB
LAB
LAB