

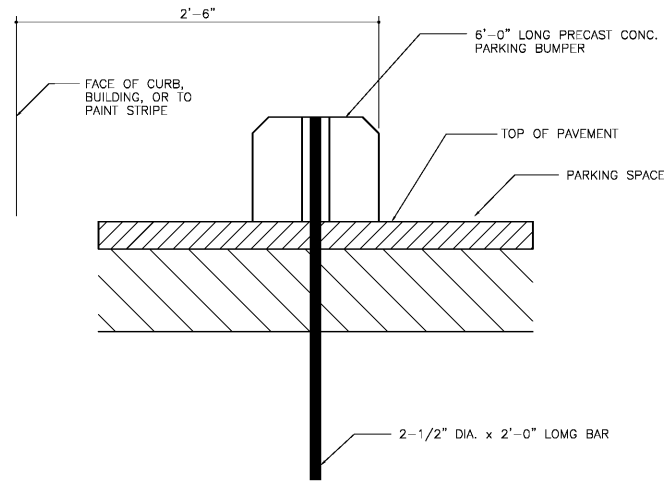



1 OVERHEAD DOOR DETAILS (NOT USED)
A9-3 SCALE: 1 1/2" = 1'-0"



4 PARKING BLOCK DETAIL
A9-3 SCALE: NONE

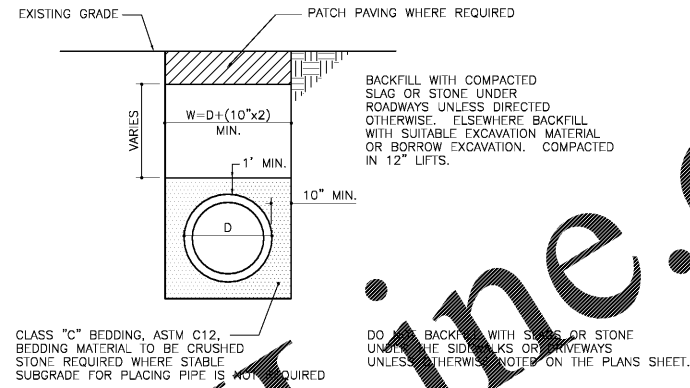

5 PIPE BEDDING DETAIL
A9-3 SCALE: NONE

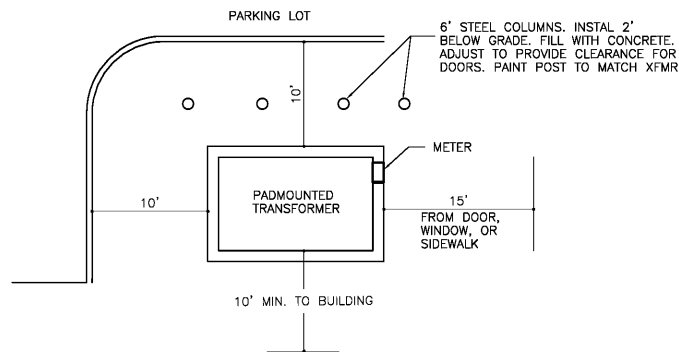


2 PAD MOUNTED XFMR CLEARANCE DETAIL
A9-3 SCALE: NONE

OPENING WIDTH		FOR EACH 4\"/>				
MIN.	MAX.		STEEL	CONCRETE BLOCK OR CONCRETE		
			DEPTH	4\"/>		
				4\"/>		
				6\"/>		
				8\"/>		
				12\"/>		

- NOTES: 1. DO NOT USE THIS SCHEDULE IF CONCENTRATED LOAD IS APPLIED TO LINTEL.
2. PROVIDE 1\"/>

SEE MECH'L DWGS. & ARCH'L DWGS. FOR QUANTITY & LOCATION OF OPENING AT DOORS, WINDOWS, LOUVERS, VENTS AND RECESSED OPENINGS.

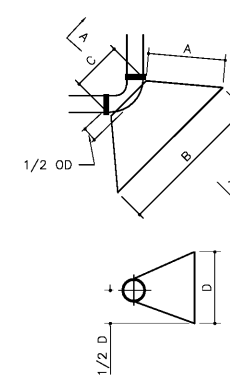

- NOTES:
1. SOIL CONDITIONS SHALL BE VERIFIED BY THE ENGINEER BEFORE THRUST BLOCK DESIGN IS IMPLEMENTED.
DESIGN DATA
1. DIMENSION OF THRUST BLOCK IN FEET BASED ON 2000 POUNDS PER SQUARE FOOT SOIL BEARING PRESSURE. ACTUAL INSIDE DIAMETER OF D.I.P., CLASS 50, P.S.I. TEST PRESSURE.
2. CONCRETE SHALL BE CLASS A, 3000 P.S.I.
3. UNDER ADVERSE CONSTRUCTION CONDITIONS, CONCRETE SHALL BE "HIGH EARLY" TYPE.

BEND	SIZE	A (FT)	B (FT)	C (IN)	D (FT)	VOLUME (CU.YD)	THRUST (LBS)
11-1/4"	6"	1.0	2.0	6	1.0	0.04	1,385
	8"	1.0	2.0	7	1.0	0.05	2,400
	10"	1.0	2.0	9	1.0	0.07	3,830
	12"	1.0	2.5	11	1.5	0.12	5,550
	14"	2.0	2.5	11	2.0	.24	7,550
	16"	2.0	2.5	12	2.0	0.26	9,860
22-1/2"	20"	2.0	3.5	15	2.5	0.48	15,400
	24"	2.0	4.0	18	3.0	0.70	22,185
	6"	1.0	2.0	6	1.0	0.04	2,760
	8"	1.0	2.0	7	1.5	0.06	4,905
	10"	1.0	2.0	9	2.0	0.10	7,665
	12"	1.0	3.0	11	2.0	0.16	11,040
45"	14"	2.0	3.5	11	2.5	0.37	15,025
	16"	2.0	3.5	12	3.0	0.45	19,625
	20"	2.0	4.0	15	4.0	0.74	30,665
	24"	3.0	5.0	18	4.5	1.47	44,160
	6"	1.0	2.0	6	1.5	0.06	5,415
	8"	1.0	2.5	7	2.0	0.10	9,625
90"	10"	2.0	3.5	9	2.5	0.31	15,040
	12"	2.0	3.5	11	3.0	0.41	21,655
	14"	2.0	4.0	11	3.75	0.56	29,475
	16"	3.0	5.0	12	4.0	1.45	38,495
	20"	4.0	6.0	15	5.0	2.06	60,145
	24"	3.0	7.5	18	6.5	3.35	91,610
TEES AND PLUGS	6"	1.0	2.5	12	2.0	0.13	10,005
	8"	1.7	3.25	14	2.0	0.27	12,565
	10"	2.0	4.0	18	2.5	0.50	19,635
	12"	2.5	4.5	20	3.25	0.91	28,275
	14"	3.0	5.0	24	4.0	1.41	38,485
	16"	3.0	5.0	26	5.0	1.77	50,265
TEES AND PLUGS	20"	4.0	7.0	32	5.75	3.69	78,540
	24"	6.0	9.0	40	6.5	7.94	113,100



SMITH DESIGN GROUP, INC.
20 WEST HAWKESON STREET
LAGRANGE, GEORGIA 30240
706-882-5511 www.SDGarch.net

REVISIONS	
DATE	DESCRIPTION

PROJECT:
VERNON ROAD FIRE STATION
VERNON ROAD
LAGRANGE GEORGIA

TITLE:
DETAILS

MODIFIED DATE:
ISSUED DATE:
FOR BID AND PERMIT
JOB NO:
1731
SHEET:
A9-3
07 MAY 2018

Order Plans @