


ELECTRICAL GENERAL NOTES

- A. ALL 120 VOLT CIRCUITS LONGER THAN 100 FEET IN LENGTH SHALL USE #10 AWG CONDUCTORS.
- B. ALL CIRCUITS SHALL HAVE A SEPARATE GROUNDING CONDUCTOR SIZED PER N.E.C. SECTION 250.122.
- C. ALL CONDUIT INSTALLED INDOORS SHALL BE ELECTRICAL METALLIC TUBING (EMT), MINIMUM 1/2" OR AS NOTED OTHERWISE. CONDUCTORS TO BE A MINIMUM OF #12 THUNDERBOLT COPPER UNLESS NOTED OTHERWISE. BRANCH CIRCUIT RUNS WITH NO MARKS OR IDENTIFICATION ARE TO BE PROVIDED WITH ONE HOT, ONE NEUTRAL AND ONE EQUIPMENT GROUND CONDUCTOR.
- D. ELECTRICAL CONTRACTOR SHALL PROVIDE CIRCUIT DIRECTORY WITH TYPED CIRCUIT DESIGNATION CARD UNDER PLASTIC COVER ON THE REVERSE OF EACH PANEL DOOR. ELECTRICAL CONTRACTOR SHALL ALSO FURNISH AND INSTALL NAMEPLATES ON ALL DISCONNECT SWITCHES, PANELS, PANELS AND SWITCHES.
- E. ELECTRICAL CONTRACTOR SHALL FURNISH ALL LABOR, MATERIALS, TOOLS, EQUIPMENT AND PERFORM ALL WORK AND SERVICES NECESSARY FOR OR INCIDENTAL TO THE FURNISHING AND INSTALLATION, COMPLETE OF ALL WORKING MATERIALS AND METHODS AS SHOWN ON THE DRAWINGS AND AS SPECIFIED, IN ACCORDANCE WITH PROVISIONS OF THE CONTRACT DOCUMENTS. ALL WORK SHALL BE COORDINATED WITH WORK OF ALL OTHER TRADES.
- F. FIELD COORDINATE ALL FURNITURE POWER FEED LOCATIONS PRIOR TO ROUGH-IN AND PLASTIC GROMMET.
- G. ALL EMPTY CONDUITS SHALL BE PROVIDED WITH PLUGS INSTALLED AND PLASTIC GROMMET.
- H. CONTRACTOR SHALL COORDINATE LOCATION OF ELECTRICAL PANELS WITH THE CEILING TO PROVIDE THE GREATEST CLEARANCE FOR WIRING.
- I. ELECTRICAL CONTRACTOR TO VERIFY EXACT PLACEMENT OF ALL DEVICES SHOWN ON THE ELECTRICAL CONSTRUCTION DOCUMENTS WITH MECHANICAL DRAWINGS PRIOR TO FINAL INSTALLMENT.
- J. CIRCUIT IDENTIFICATION SHALL BE BY CIRCUIT DESIGNATION SHALL BE IDENTIFIED TO RECEPT SPACER FOR EACH HOMERUN SHOWN IN THE DRAWINGS.
- K. ALL RECEPTACLES WITHIN 6'-0" OF A SINK OR LAVATORY SHALL BE OF A GFCI TYPE.
- L. ALL FIRE ALARM NOTIFICATION DEVICES LOCATED IN THE SAME ROOM OR OPEN OFFICE AREA SHALL BE SEQUENCED TO FLASH AT THE SAME RATE PER LATEST FIRE ALARM CODE.

ELECTRICAL PLAN NOTES

1. INSTALL SWITCH FOR LOCAL CONTROL OF RECEPTACLE(S) SERVING THE LED DISPLAY CASE LIGHTING. COORDINATE SWITCH LOCATION WITH THE CONCESSION CASEWORK INSTALLER.
2. ROUTE HOMERUN THROUGH A RELAY IN LIGHTING CONTROL PANEL LCP3. REFERENCE THE LIGHTING CONTROL PANEL SCHEDULE.
3. INSTALL SPECIAL HEAVY DUTY RECEPTACLE AND HOMERUN WITH 3/4" 1-#10 GROUND WIRE IN A 3/4" CONDUIT. COORDINATE THE EXACT RECEPTACLE STYLE WITH THE KITCHEN EQUIPMENT INSTALLER. INTERFACE THE EQUIPMENT'S INTERNAL FIRE SUPPRESSION SYSTEM WITH THE BUILDING'S FIRE ALARM SYSTEM SO THE FIRE ALARM SYSTEM GOES INTO ALARM UPON THE DISCHARGE OF THE FIRE SUPPRESSION SYSTEM.
4. MAKE POWER CONNECTION TO THE COUNTERTOP STEAMER AND HOMERUN WITH 3/4" 1-#12 GROUND WIRE IN A 3/4" CONDUIT.
5. MAKE POWER CONNECTION TO THE FRYER AND HOMERUN WITH 3/4" 1-#10 GROUND WIRE IN A 3/4" CONDUIT.
6. INSTALL SPECIAL HEAVY DUTY RECEPTACLE AND HOMERUN WITH 3/4" 1-#10 GROUND WIRE IN A 3/4" CONDUIT. COORDINATE THE EXACT RECEPTACLE TYPE WITH THE KITCHEN EQUIPMENT INSTALLER.
7. INSTALL 30AMP SINGLE POLE SWITCH AND WIRE TO CONTROL POWER TO THE GLASS WASHER.
8. MAKE POWER CONNECTION TO THE GLYCOL PUMP SYSTEM AND HOMERUN WITH 3/4" 1-#10 GROUND WIRE IN A 3/4" CONDUIT.
9. MAKE POWER CONNECTION TO THE WATER HEATER AND HOMERUN WITH 3/4" 1-#10 GROUND WIRE IN A 3/4" CONDUIT. INSTALL SAFETY SWITCH PROVIDED BY OTHERS FOR DISCONNECTING MEANS.
10. MAKE POWER CONNECTION TO THE CIRCULATING PUMP. PROVIDE A 20A MOTOR RATED TOGGLE SWITCH FOR DISCONNECTING MEANS AND MAKE REQUIRED CONTROL CONNECTION BETWEEN THE PUMP AND THE WATER HEATER ADJUST. ROUTE THE HOMERUN THROUGH A RELAY IN LIGHTING CONTROL PANEL LCP3. REFERENCE THE LIGHTING CONTROL PANEL SCHEDULES.
11. INSTALL SPECIAL HEAVY DUTY RECEPTACLE AND HOMERUN WITH 3/4" 1-#10 GROUND WIRE IN A 3/4" CONDUIT. COORDINATE THE EXACT RECEPTACLE TYPE WITH THE KITCHEN EQUIPMENT INSTALLER.

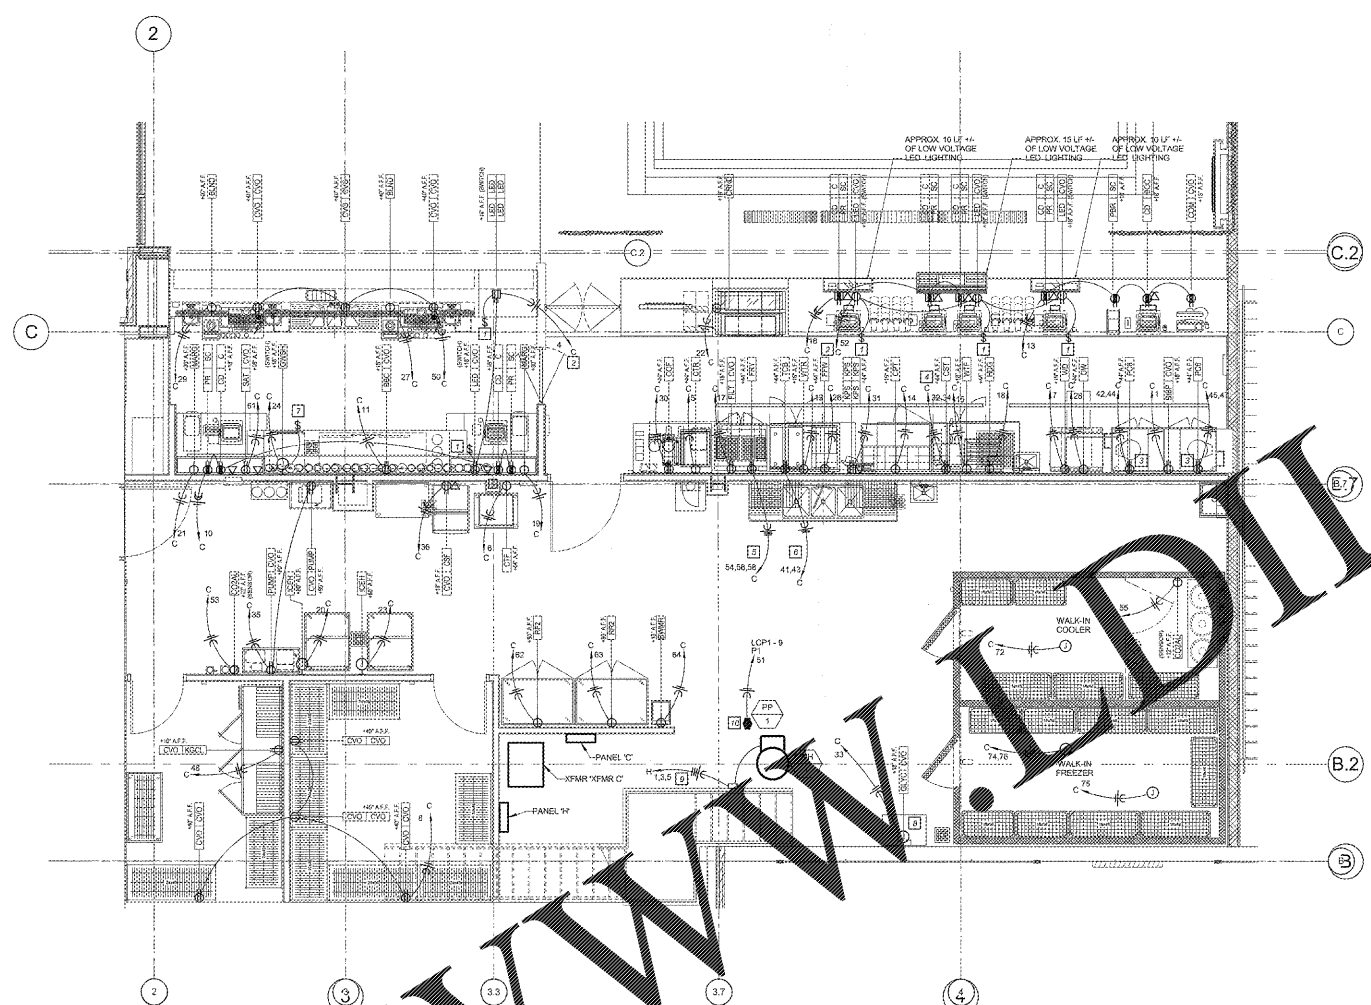

PARTIAL ENLARGED FLOOR PLAN - CONCESSION, CONCESSION SUPPORT AND OCCUPANTS
1/4" = 1'-0"




ENGINEERING
Gibbons, Drake, Scott, Inc.
8101 E. 61st Street, Suite 100
Birmingham, Alabama 35213
Phone: (810) 338-1790
Fax: (810) 338-1797
www.gdseng.com
CORPORATE: CCA # 000000003

SHEET LEGEND

0000	GENERAL INFORMATION
1000	SCHEMATIC
2000	CONSTRUCTION DETAILS
3000	FLOOR PLANS & RELATED PLANS
4000	SECTION & ELEVATION DETAILS
5000	MECHANICAL
6000	ELECTRICAL
7000	PLUMBING
8000	MECHANICAL
9000	MECHANICAL

MADISON YARDS 8
AMC NEW BUILD
905 CENTRAL AVENUE
ATLANTA, GA 30316



No.	Date	Description

Project Issue Date: _____
KEY PLAN:

SHEET TITLE:
ELECTRICAL ENLARGED PLANS
SHEET NUMBER:
E401

Order Plans @ www.dilville.com

THIS DRAWING IS A SEPARATE SET OF AN APPLICABLE SET OF CONSTRUCTION CONTRACT DOCUMENTS. REFER TO GENERAL AND SPECIFICATIONS FOR ALL APPLICABLE RULES, CONDITIONS, "STANDARD" CONTRACT AND SPECIFICATIONS. THE CONTRACTOR SHALL BE RESPONSIBLE FOR ALL INFORMATION IN THIS SET OF DOCUMENTS. THE CONTRACTOR SHALL BE RESPONSIBLE FOR ALL INFORMATION IN THIS SET OF DOCUMENTS. THE CONTRACTOR SHALL BE RESPONSIBLE FOR ALL INFORMATION IN THIS SET OF DOCUMENTS. THE CONTRACTOR SHALL BE RESPONSIBLE FOR ALL INFORMATION IN THIS SET OF DOCUMENTS.