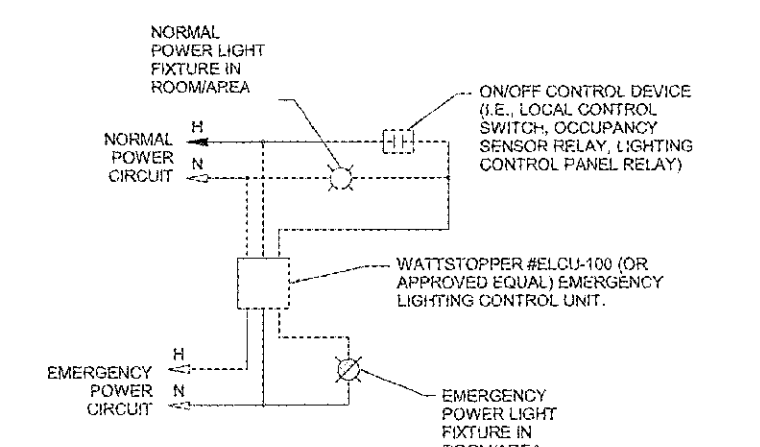

SEQUENCE OF OPERATIONS:

EMERGENCY LIGHTING CONTROL UNIT SHALL ALLOW ALL LIGHTS, EMERGENCY AND NORMAL TO BE CONTROLLED ON/OFF VIA LIGHTING CONTROL DEVICES (IE, LOCAL CONTROL SWITCH, OCCUPANCY SENSOR RELAY, LIGHTING CONTROL PANEL RELAY). IF NORMAL POWER IS LOST, EMERGENCY LIGHTING CONTROL UNIT SHALL BYPASS ALL LIGHTING CONTROL DEVICES TO TURN ALL EMERGENCY LIGHTS TO FULL ON.

SPECIFICATION NOTES:

EMERGENCY LIGHTING CONTROL UNIT SHALL BE UL924 COMPLIANT, RATED FOR 20 AMPS, 120/277V.

EMERGENCY LIGHTING CONTROL UNIT DETAIL

NOT TO SCALE

ED98

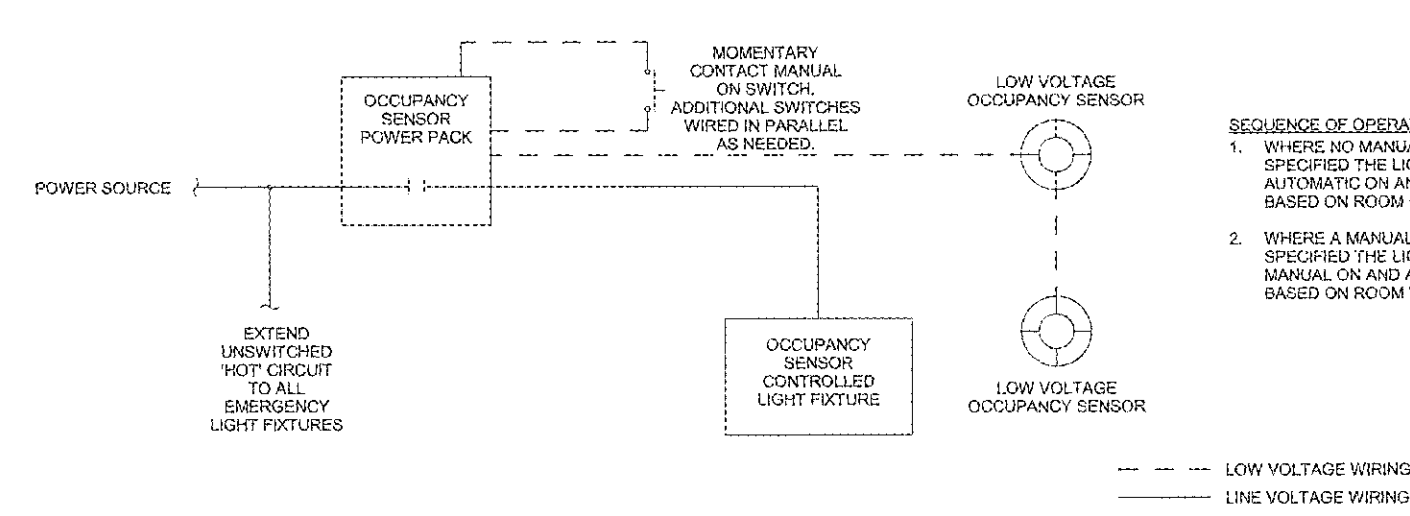

SEQUENCE OF OPERATION:

1. WHERE NO MANUAL ON SWITCH IS SPECIFIED THE LIGHTING SHALL BE AUTOMATIC ON AND AUTOMATIC OFF BASED ON ROOM OCCUPANCY.
2. WHERE A MANUAL ON SWITCH IS SPECIFIED THE LIGHTING SHALL BE MANUAL ON AND AUTOMATIC OFF BASED ON ROOM VACANCY.

LOW VOLTAGE OCCUPANCY SENSOR CONTROL DETAIL

NOT TO SCALE

ED99

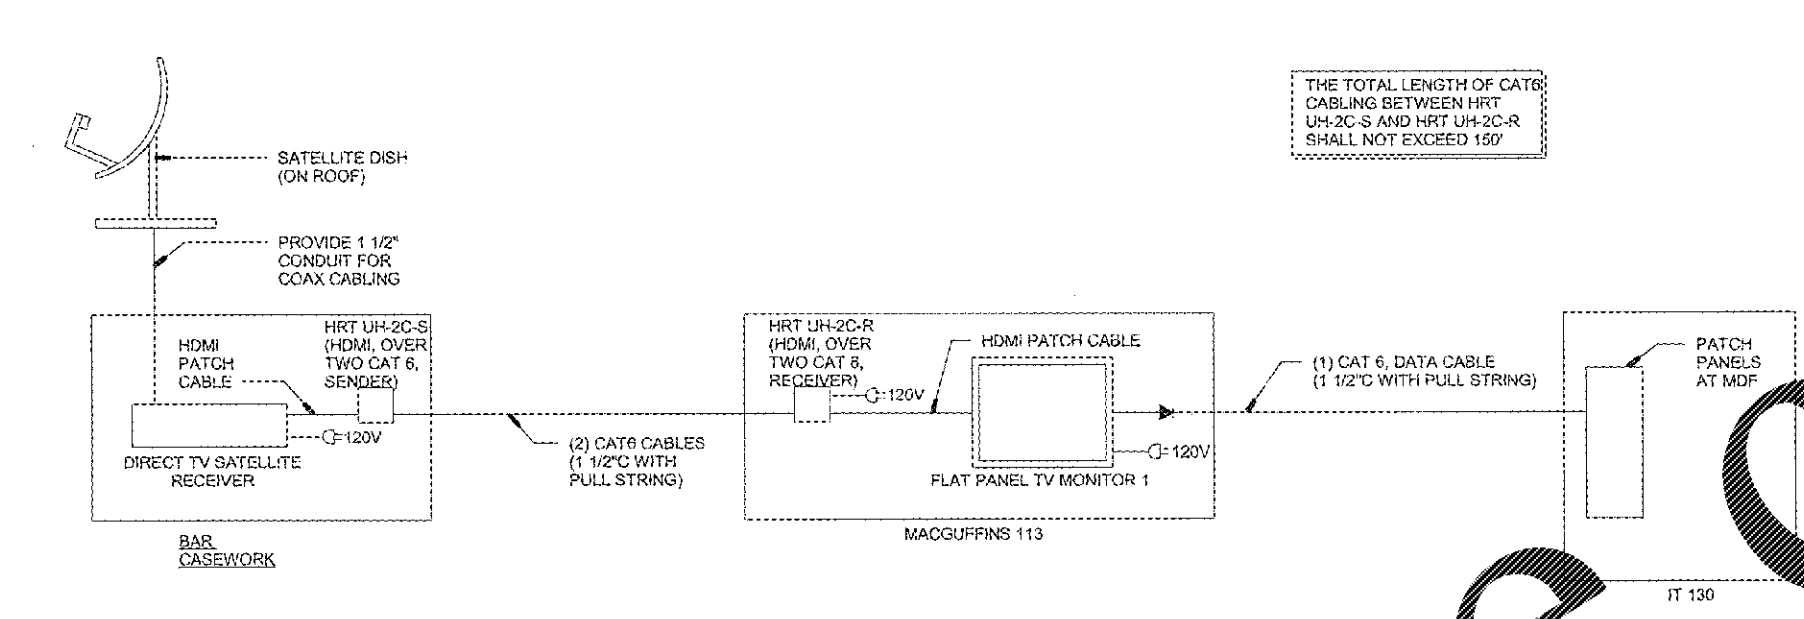

SATELLITE TV SYSTEM SCHEMATIC

NOT TO SCALE

ED506

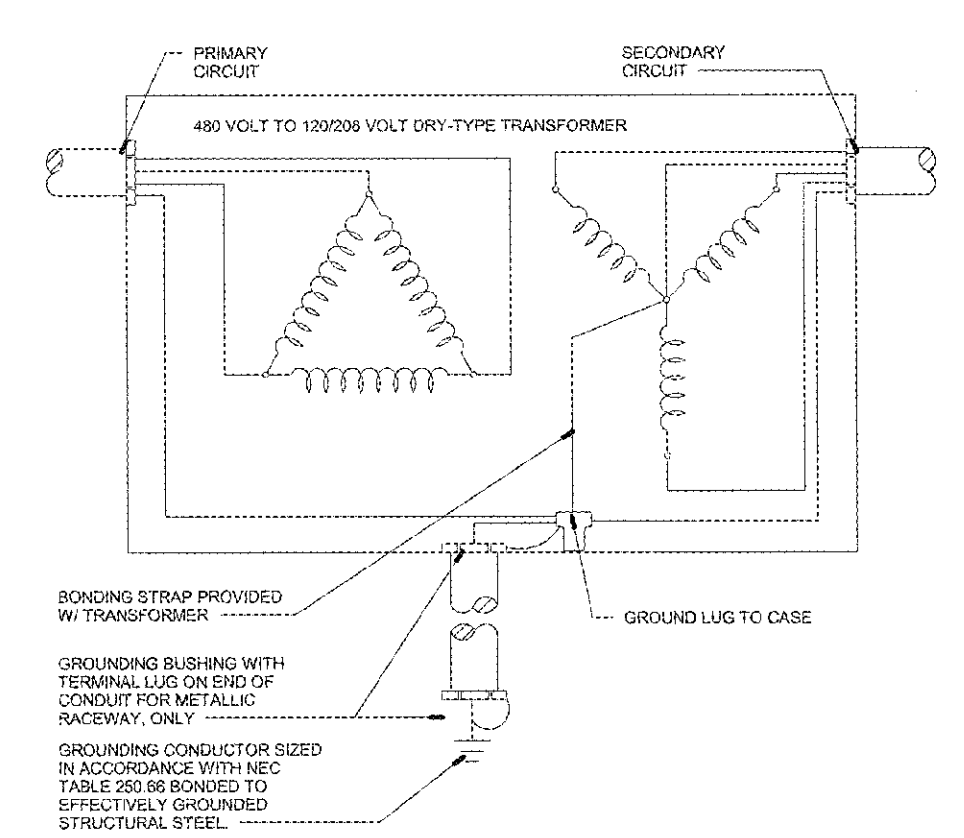

DRY TYPE TRANSFORMER GROUNDING

NOT TO SCALE

ED16

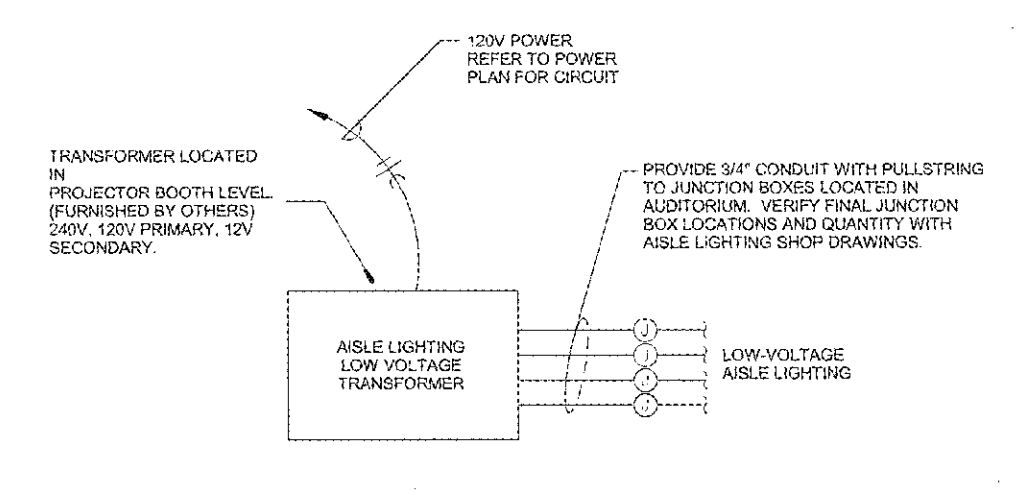

NOTE:
IF MULTIPLE TRANSFORMERS ARE REQUIRED FOR AN AUDITORIUM CONNECT TO SAME 120V POWER CIRCUIT. MAXIMUM 8 TRANSFORMERS ON A SINGLE 120V CIRCUIT

TYPICAL AISLE LIGHTING SCHEMATIC

NOT TO SCALE

ED101

AISLE LIGHTING NOTES

A. ALL AISLE LIGHTING IS PROVIDED BY OWNER AND INSTALLED BY ELECTRICAL CONTRACTOR. ALL LOW VOLTAGE WIRING SHALL BE PROVIDED BY THE ELECTRICAL CONTRACTOR. COORDINATE WITH AISLE LIGHTING EQUIPMENT SUPPLIER FOR ALL PARTS AND ACCESSORIES TO BE INSTALLED. INSTALL PER MANUFACTURER'S WRITTEN INSTRUCTIONS.
B. COORDINATE LOW VOLTAGE WIRE SIZE WITH AISLE LIGHTING INSTALLATION INSTRUCTIONS, TAKING INTO ACCOUNT VOLTAGE DROP REQUIREMENTS. TEST AND VERIFY ALL AISLE LIGHTING AND PLEXCALL DEVICES HAVE ADEQUATE VOLTAGE TO OPERATE PROPERLY. COORDINATE WITH AISLE LIGHTING EQUIPMENT SUPPLIER TO FINAL START-UP AND OPERATION OF SYSTEM. COORDINATE ANY INSTALLATION DEFICIENCIES WITH AISLE LIGHTING EQUIPMENT SUPPLIER AND OWNER TO PROVIDE ALL REMEDIES TO ELIMINATE DEFICIENCIES.
C. MAINTAIN A RECORD SET OF DRAWINGS IN THE FIELD TO DOCUMENT THE FINAL WIRING CONFIGURATION AND LOCATION OF ALL DEVICES POWERED FROM THE SECONDARY SIDE OF THE AISLE LIGHTING LOW VOLTAGE TRANSFORMERS. AT COMPLETION OF INSTALLATION, ... FIELD NOTES INTO A CLEAN SET OF DRAWINGS SO THAT ALL INFORMATION IS CLEAR AND LEGIBLE. SUBMIT FINAL COPY OF R... DRAWINGS WITH OTHER RECORD DRAWINGS PER DIVISION 1 SPECIFICATIONS.
D. ALL LOW VOLTAGE WIRING SHOWN SHALL BE ROUTED IN AISLE LIGHTING RACEWAYS.
E. PROVIDE INSTALL JUNCTION BOXES IN ... AUDITORIUM AS REQUIRED TO SERVE THE AISLE LIGHTING. THE ... ION BOXES SHALL BE USED TO CONNECT THE AISLE LIGHTING TO TH... OW VOLTAGE WIRING FROM THE TRANSFORMERS LOCATED IN THE PR... ECTION AREA. COORDINATE WITH THE AISLE LIGHTING CONTRACTOR T... LOCATE ALL JUNCTION BOXES NEEDED FOR ... LY FUNCTIONAL ... SLE LIGHTING SYSTEM.
F. DURING PERFOR... ES, A 0.2 FOOTC... NDLE MINIMUM IS REQUIRED FOR ALL ... OF THE PATH OF EGRESS. LIGHT LEVELS MUST INCREASE TO 1 FO... LE MINIMUM UPON ACTIVATION OF THE FIRE AL... M SYSTEM.
G. BE... HTS FIXED TO T... PROVIDE LIGHT UP TO 5'-... FROM ... T TO WALL OF ... AT WHEN THE ROWS OF SEATING ... ACED 48" ON CENTER ... BACK. AREAS ON ... OR THAT REQUIRE ... ION THAT IS VISIBLE TO OCCUPANTS ... A TWO ... ONE WIRE...

ED000

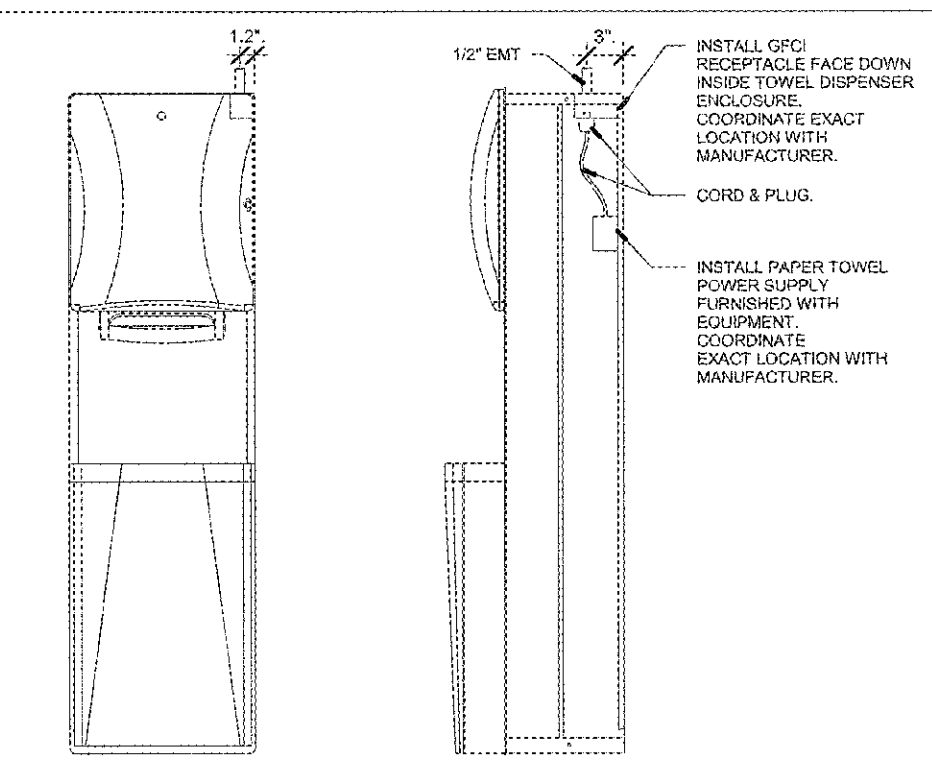

NOTES:

1. RECEPTACLE TO BE INSTALLED INSIDE THE TOWEL DISPENSER/WASTE CONT... HOUSING AT THE BACK OF THE UPPER RIGHT CORNER.
2. COORDINATE THE RECEPTACLE INSTALLATION WITH THE TO... ORIES INSTALLER. THE RECEPTACLE SHALL NOT INTERFERE WITH THE INSTALL... OF THE ... L DISPENSER IN THE UNIT ENCLOSURE.

TOWEL DISPENSER ELECTRICAL ROUGH-IN DETAIL

NOT TO SCALE

ED510

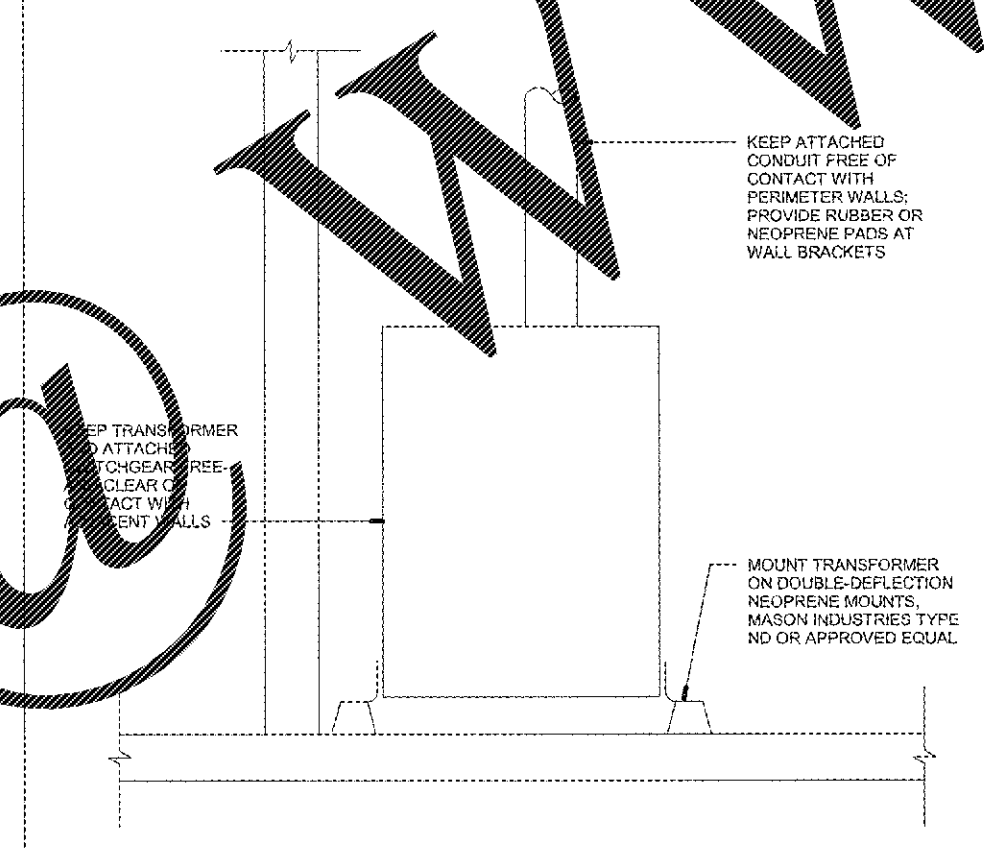

TRANSFORMER VIBRATION ISOLATION DETAIL

NOT TO SCALE

ED508

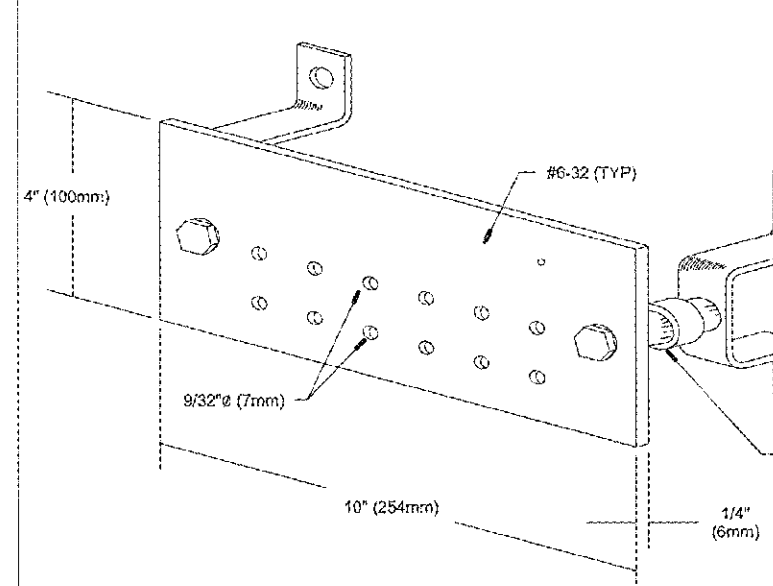

GROUND BAR

NOT TO SCALE

ED19

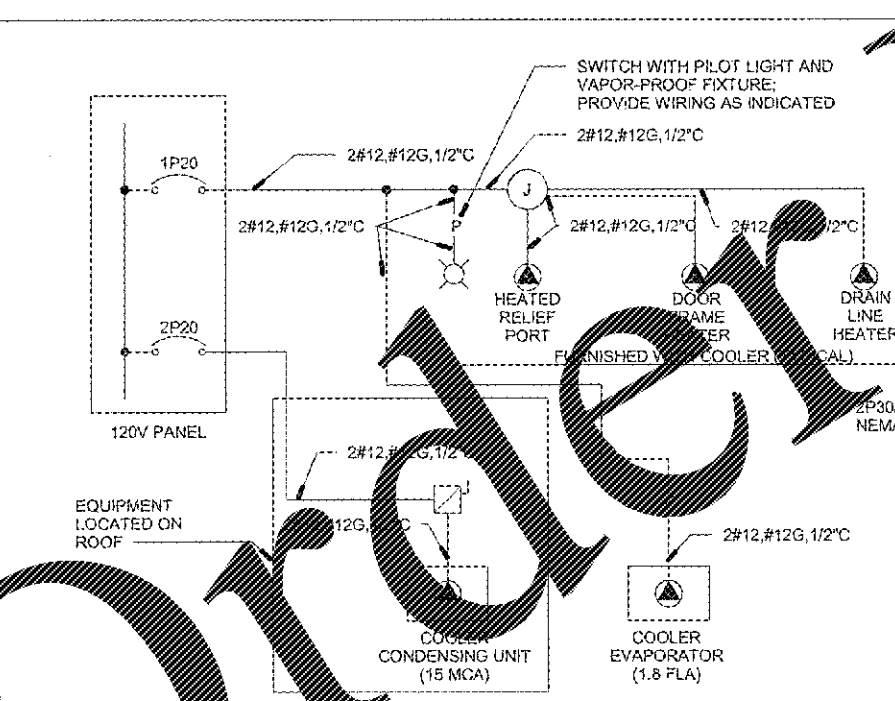

WALK-IN COOLER WIRING DIAGRAM NOTES:

1. CONTRACTOR SHALL VERIFY ALL OVERCURRENT PROTECTIVE DEVICE SIZES TO CORRESPOND WITH MANUFACTURER'S RECOMMENDATIONS.
2. ...O MANUFACTURER'S INSTALLATION INSTRUCTIONS AND WIRING DIAGRAMS FOR EXACT WIRING CONNECTION INFORMATION. ALL WORK SHALL BE IN ACCORDANCE WITH THE NEC AND MANUFACTURER'S REQUIREMENTS.
3. ALL CONDUIT PENETRATIONS INTO COOLER ENCLOSURE SHALL BE SEALED IN ACCORDANCE WITH MANUFACTURER'S RECOMMENDATIONS.

ED507

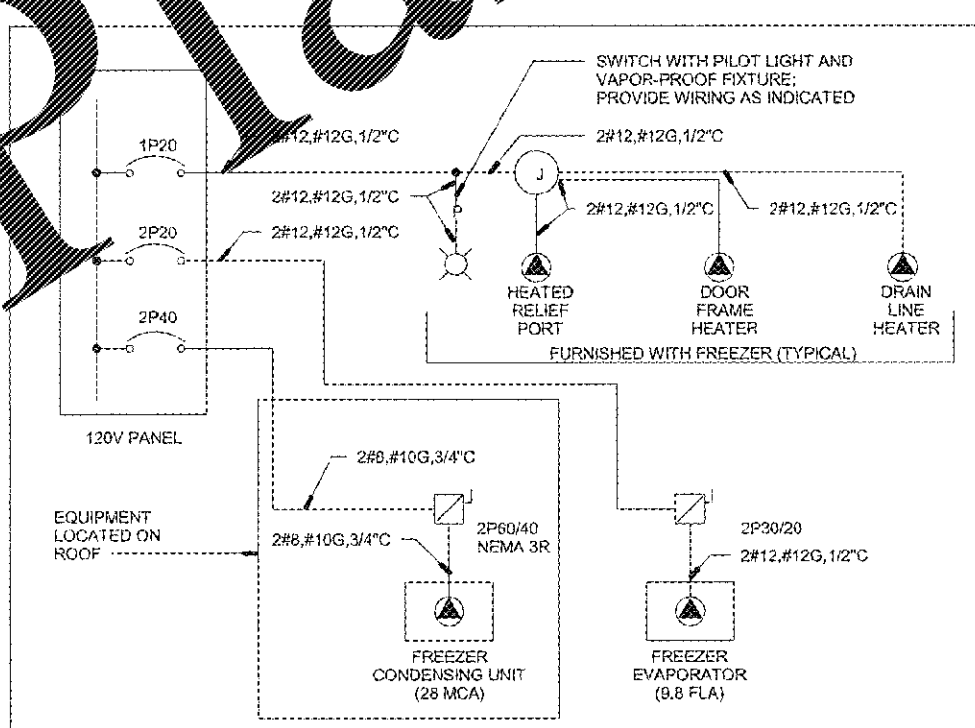

WALK-IN FREEZER WIRING DIAGRAM NOTES:

1. CONTRACTOR SHALL VERIFY ALL OVERCURRENT PROTECTIVE DEVICE SIZES TO CORRESPOND WITH MANUFACTURER'S RECOMMENDATIONS.
2. REFER TO MANUFACTURER'S INSTALLATION INSTRUCTIONS AND WIRING DIAGRAMS FOR EXACT WIRING CONNECTION INFORMATION. ALL WORK SHALL BE IN ACCORDANCE WITH THE NEC AND MANU. REQ'TS..
3. ALL CONDUIT PENETRATIONS INTO FREEZER ENCLOSURE SHALL BE SEALED IN ACCORDANCE WITH MANUFACTURER'S RECOMMENDATIONS.

ED505

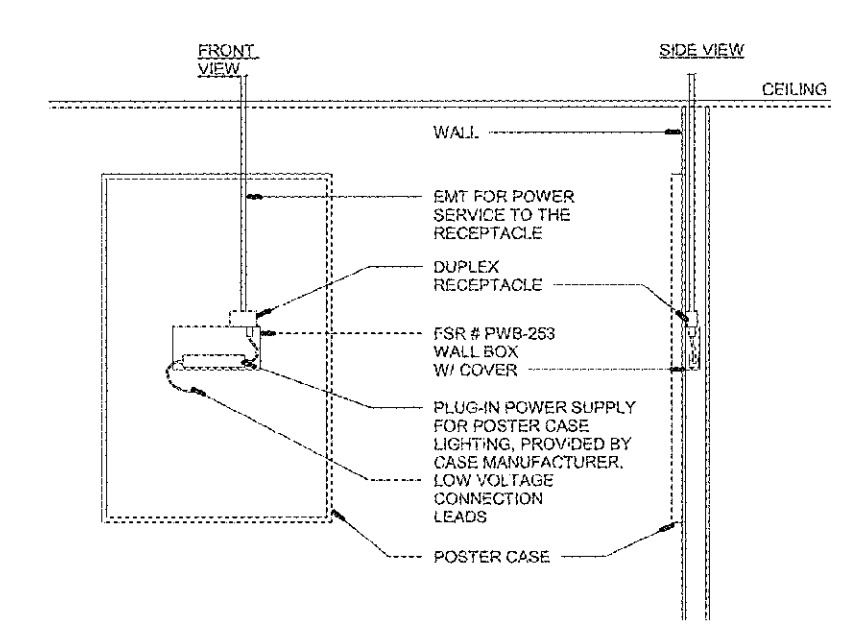

NOTES:

1. ROUGH IN THE WALL BOX WHERE THE CENTER OF THE POSTER CASE WILL BE LOCATED. REFERENCE THE ARCHITECTURAL ELEVATIONS FOR THE EXACT LOCATION.
2. SPLICE INSIDE THE WALL BOX THE LIGHTING LEAD WIRES FROM THE POSTER CASE TO THE LOW VOLTAGE LEAD WIRES FROM THE PLUG-IN POWER SUPPLY.

POSTER CASE ELECTRICAL ROUGH-IN DETAIL

NOT TO SCALE

ED511

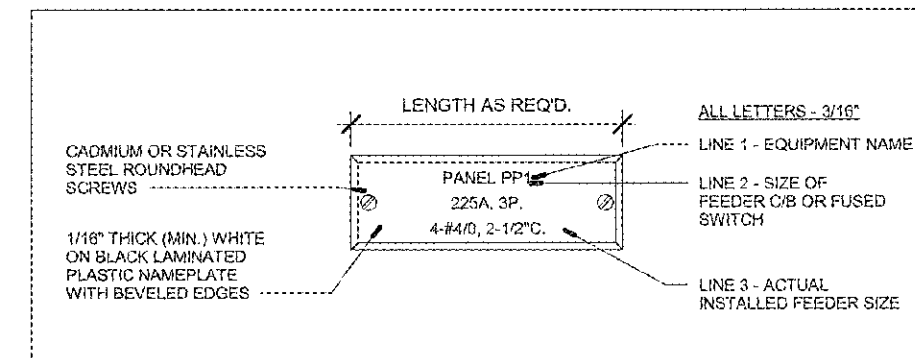

EQUIPMENT/PANELBOARD NAMEPLATE DETAIL

NOT TO SCALE

ED66

THIS DRAWING IS A SINGLE PART OF AN INTEGRATED SET OF CONSTRUCTION CONTRACT DOCUMENTS. REFER TO DRAWING AND SPECIFICATION SHEETS INCLUDING, BUT NOT LIMITED TO, ALL "GENERAL CONDITIONS", "SUMMARY OF WORK", AND APPLICABLE SPECIFICATION SECTIONS WHICH APPLY TO THIS DRAWING. REFER TO ALL DOCUMENTS FOR THE COMPLETE SCOPE OF WORK. THE CONTRACTOR WILL BE RESPONSIBLE FOR ALL INFORMATION CONTAINED IN THE "SET" OF DOCUMENTS ISSUED. THIS DRAWING IS SCHEMATIC AND IS NOT TO BE USED AS A SHOP DRAWING. ALTERATIONS FROM THAT SHOWN REQUIRED TO COORDINATE WITH OTHER TRADES OR TO CONFORM TO ACTUAL SITE CONDITIONS ARE THE CONTRACTOR'S RESPONSIBILITY. VERIFY THE LOCATIONS OR DIMENSIONS OF ALL ARCHITECTURAL AND STRUCTURAL ELEMENTS WITH THE ARCHITECTURAL AND STRUCTURAL DRAWINGS ISSUED. THE SHOWING OF THESE ELEMENTS ARE FOR REFERENCE ONLY AND ARE TO BE VERIFIED PRIOR TO DESIGN OR CONSTRUCTION. NO LIABILITY IS ASSUMED BY THE INDICATION OF ELEMENTS IN THESE DRAWINGS. THE ACCOMPANYING PROFESSIONAL SEAL INDICATES THAT THE PERSON WHOSE NAME APPEARS ON THE SEAL HAS PREPARED OR SUPERVISED PREPARATION OF THE DOCUMENT ON WHICH THE SEAL APPEARS. THAT PERSON AND THE FIRM FOR WHICH THAT PERSON IS EMPLOYED DISCLAIM RESPONSIBILITY FOR ANY PORTIONS OF THE WORK ON WHICH THEIR SEAL DOES NOT APPEAR.

THIS DOCUMENT SHALL NOT BE USED FOR ANY OTHER PROJECTS, FOR ADDITIONS TO THIS PROJECT, OR FOR COMPLETION OF THIS PROJECT BY OTHERS WITHOUT THE PRIOR WRITTEN CONSENT OF GIBBENS DRAKE SCOTT. ANY INDIVIDUAL AND/OR COMPANY THAT USES THIS DOCUMENT UNAUTHORIZED, AGREES TO THE FULLEST EXTENT OF THE LAW, TO INDEMNIFY AND HOLD HARMLESS GIBBENS DRAKE SCOTT, INC., ITS OFFICERS, DIRECTORS AND EMPLOYEES AGAINST ANY DAMAGES, LIABILITIES OR COSTS, INCLUDING REASONABLE ATTORNEY'S FEES AND COSTS OF DEFENSE, ARISING OUT OF THE MISUSE OF THIS DOCUMENT.

THIS DRAWING COPYRIGHT 2018 ©

GEORGIA REGISTERED No. PE033486 PROFESSIONAL ENGINEER TIM L SCOTT

SIGNATURE/DATE:

GDS ENGINEERING
Gibbens, Drake, Scott, Inc.
9201 E. 63rd Street, Suite 100
Raytown, Missouri 64133
Phone: (816) 358-1790
Fax: (816) 358-2367
www.gdsengr.com
GEORGIA COA #PEF000263

SHEET LEGEND

G000's	GENERAL INFORMATION & SCOPE OF WORK
N100's	EGRESS / ADA PLANS & DETAILS
A100's	FLOOR PLANS & CEILING PLANS
A200's	EXTERIOR & INTERIOR ELEVATIONS
A300's	BUILDING SECTIONS
A400's	ENLARGED PLANS
A500's	EXTERIOR & INTERIOR DETAILS
A600's	DOOR SCHEDULE, DOOR DETAILS, FINISH SCHEDULE, FINISH PLANS
Q100's	AUDITORIUM SIGHT LINE SECTIONS
Q120's	AUDITORIUM SEATING PLAN
S's	STRUCTURAL
M's	MECHANICAL
P's	PLUMBING
E's	ELECTRICAL
WF's	WAYFINDING DETAILS
FS's	CASEWORK & EQUIPMENT

MADISON YARDS 8

AMC NEW BUILD
905 MEMORIAL DRIVE SE
ATLANTA, GA 30316

American Multi-Cinema, Inc.
One AMC Way
11500 Ash Street
Leawood, KS 66211

No.	Date	Description

Project Issue Date:

KEY PLAN:

SHEET TITLE:
ELECTRICAL DETAILS

SHEET NUMBER:
E702

Order Plans @ WWW.LDILine.com