


Order Plans

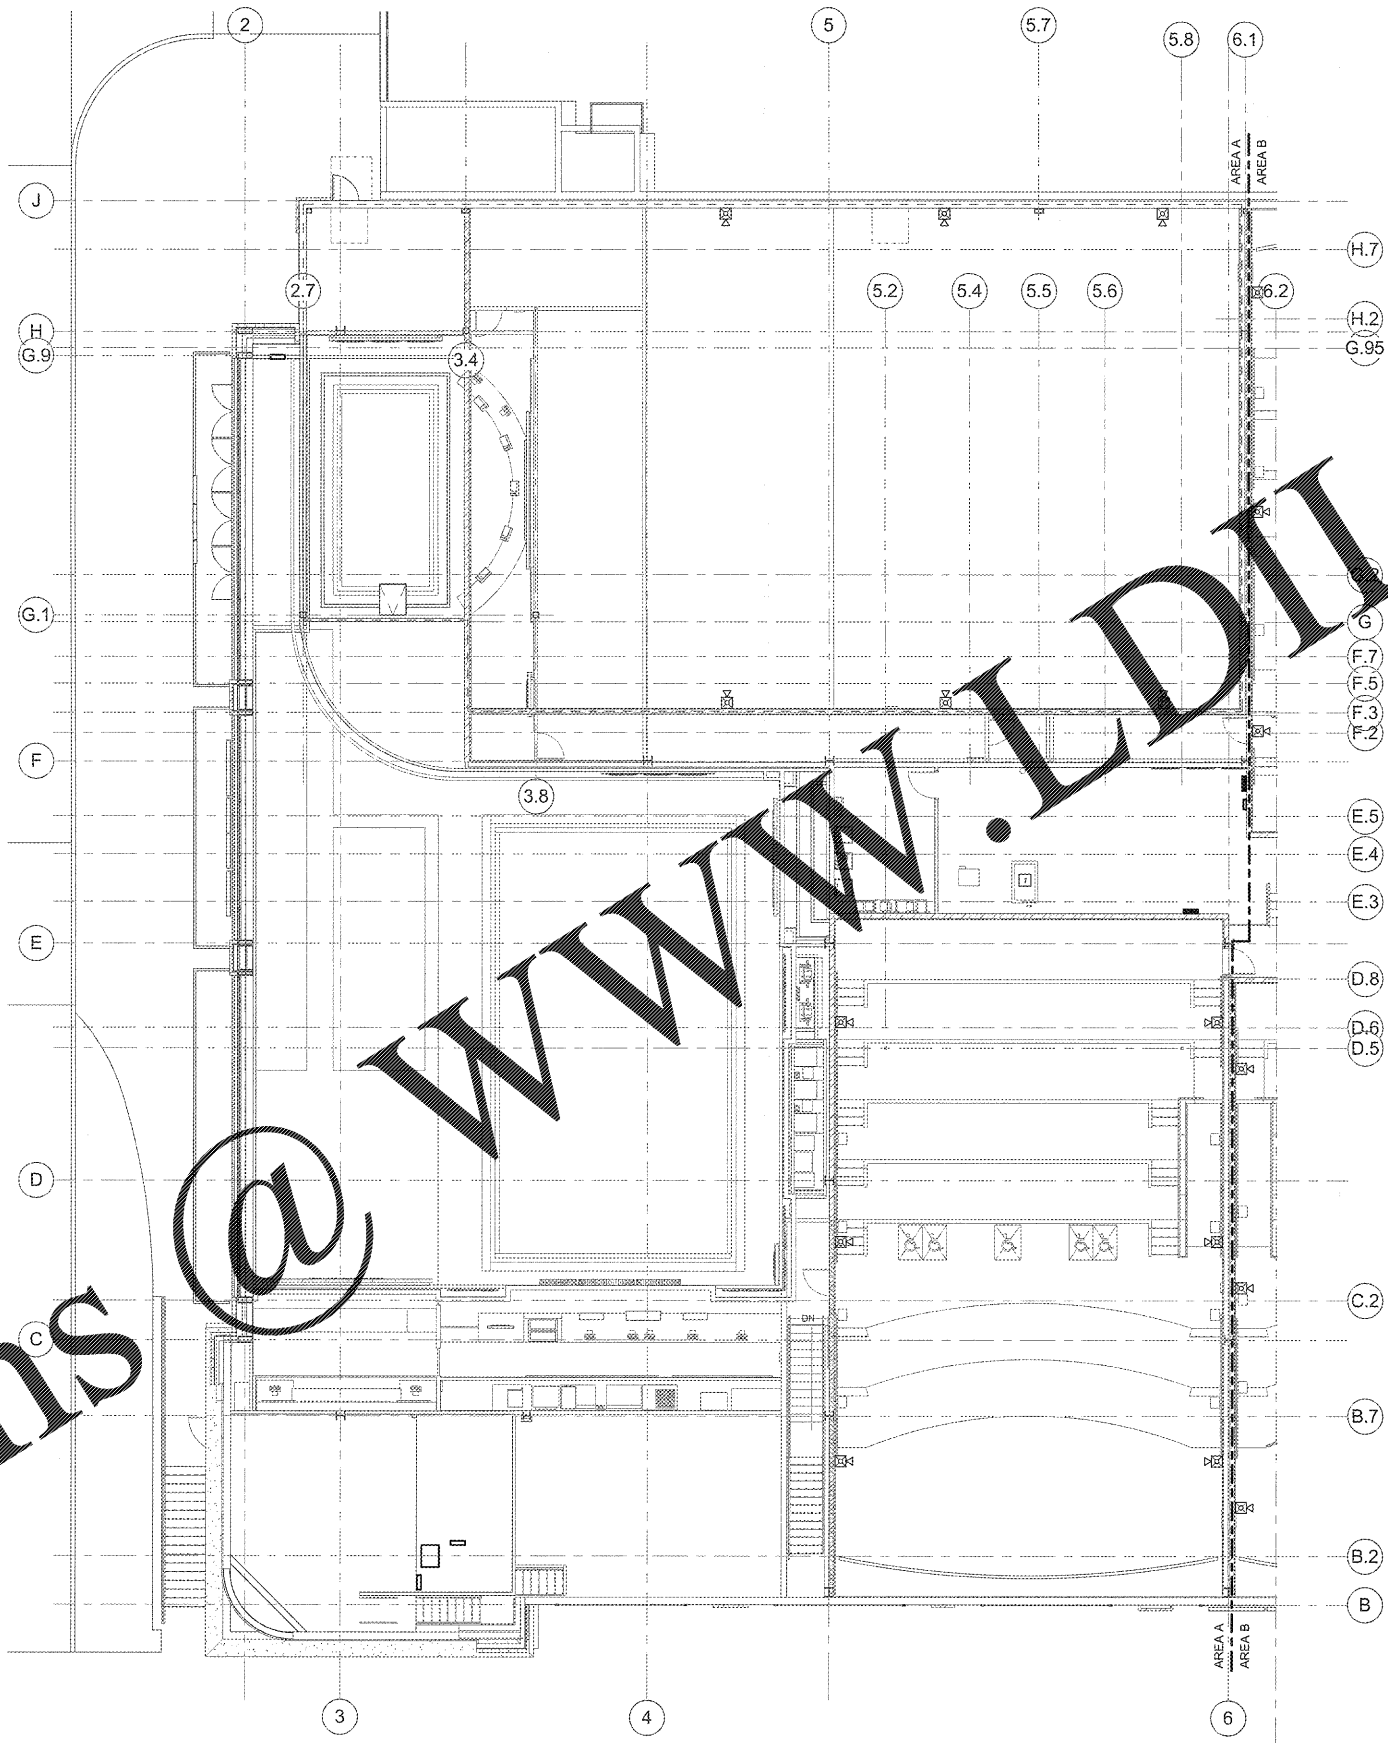

FIRE ALARM GENERAL NOTES

- ALL CONDUIT INSTALLED INDOORS SHALL BE ELECTRICAL METALLIC TUBING (EMT), MINIMUM 1/2".
- THE CONTRACTOR SHALL FURNISH ALL LABOR, MATERIALS, TOOLS, EQUIPMENT AND PERFORM ALL WORK AND SERVICES NECESSARY FOR OR INCIDENTAL TO THE FURNISHING AND INSTALLATION, COMPLETE WITH ALL WIRING MATERIALS AND METHODS AS SHOWN ON THE DRAWINGS AND AS SPECIFIED, IN ACCORDANCE WITH PROVISIONS OF THE CONTRACT DOCUMENTS AND COMPLETELY COORDINATED WITH WORK OF ALL OTHER TRADES.
- ALL EMPTY CONDUITS SHALL BE PROVIDED WITH PULL STRING INSTALLED AND PLASTIC GROMMET.
- THE CONTRACTOR TO VERIFY EXACT PLACEMENT OF ALL DEVICES SHOWN ON THE ELECTRICAL CONSTRUCTION DOCUMENTS WITH MECHANICAL DRAWINGS PRIOR TO FINAL PLACEMENT.
- ALL OPENINGS SLEEVED THROUGH FLOOR CONSTRUCTION, FIRE WALLS OR SMOKING PARTITIONS, SHALL BE SEALED WITH AN APPROVED SEALANT HAVING FIRE RATING EQUAL TO THAT OF STRUCTURAL MEMBER PENETRATED.
- PROVIDE TRANSIENT PROTECTION TO REDUCE THE POSSIBILITY OF SHORT CIRCUIT BY REDUCED TRANSIENTS, CIRCUITS AND EQUIPMENT SHALL BE PERMITTED IN ACCORDANCE WITH THE REQUIREMENTS OF ARTICLE 908 OF THE NATIONAL ELECTRICAL CODE.
- THE CIRCUIT BREAKERS FOR THE FIRE ALARM SYSTEM SHALL HAVE A RED MARKING AND SHALL BE IDENTIFIED AS "FIRE ALARM CIRCUIT".
- THE LOCATION OF THE CIRCUIT BREAKER SHALL BE PERMANENTLY IDENTIFIED ON THE FIRE ALARM CONTROL UNIT.
- ANY DEVICE OR SYSTEM THAT NECESSITATES THE LOCKING OR UNLOCKING OF EXITS SHALL BE CONNECTED TO THE FIRE ALARM SYSTEM AND SHALL UNLOCK UPON RECEIPT OF FIRE ALARM SIGNAL BY MEANS OF A RELAY.
- ALL FIRE ALARM DEVICES SHALL BE INSTALLED WITHIN 5'0" OF THE DOORWAY OR IN A COMMON AREA.
- ALL FIRE ALARM HORN DEVICES LOCATED IN THE SAME ROOM OR OPEN OFFICE SHALL BE CONNECTED TO FLASH AT THE SAME RATE PER LATEST FIRE ALARM CODE.

IF FIRE ALARM CONTRACTOR SHALL BE RESPONSIBLE FOR INCLUDING THE CORRECTLY SIZED SUPPLEMENTAL POWER SUPPLY PANELS, XTAL SUPERVISOR PANELS AND ALL OTHER SYSTEMS REQUIRED FOR VOLT CIRCUITS.

FIRE ALARM PLAN NOTES

- INSTALL A FIRE ALARM OUTPUT DEVICE THAT WILL CLOSE DRY CONTACTS WHEN THE FIRE ALARM SYSTEM GOES INTO ALARM. THE CONTACTS WILL OPEN WHEN THE FIRE ALARM SYSTEM IS CLEARED AND THE SYSTEM IS RESET. THE DEVICE SHALL CONTAIN TWO SEPARATE CONTACTS. WIRE ONE SET INTO THE PROJECTOR AUTOMATION PANEL AND THE OTHER SET INTO THE AUDITORIUM DRAWING PANEL.



ENGINEERING
 Gilbert, Drake, Scott, Inc.
 9201 E. 42nd Street, Suite 100
 Raytown, Missouri 64133
 Phone: (816) 358-1700
 Fax: (816) 358-1007
 www.gds-engine.com
 CREATED BY: CDM APPROVED DATE:

SHEET LEGEND

0000	GENERAL REVISIONS & SUPPLY OF WORK
1000	FLOOR PLANS & CEILING PLANS
2000	EXTERIOR & INTERIOR ELEVATIONS
3000	BUILDING SECTIONS
4000	INTERIORS PLANS
5000	OFFICES & RECEPTION DETAILS
6000	DOOR SCHEDULE, DOOR DETAILS
7000	ELECTRICAL
8000	AUDITORIUM HIGH LINE SECTIONS
9000	MECHANICAL
PA	PLUMBING
PE	ELECTRICAL
VP	MECHANICAL
77	WIRING DETAILS
77	MECHANICAL & ELECTRICAL

MADISON YARDS 8
 AMC NEW BUILD
 905 MEMORIAL DRIVE SE
 ATLANTA, GA 30316



No.	Date	Description

KEY PLAN:

SHEET TITLE:
PROJECTION LEVEL AREA-A FIRE ALARM PLAN
 SHEET NUMBER:
F103

PROJECTION LEVEL AREA A FIRE ALARM PLAN
 1/8" = 1'-0"

THIS DOCUMENT IS A SINGLE PART OF AN INSTRUMENT OF SERVICE (CONSISTING OF ARCHITECTURAL, ENGINEERING, AND MECHANICAL CONTRACT DOCUMENTS) AND IS NOT TO BE SEPARATED FROM THE OTHER PARTS OF THE INSTRUMENT OF SERVICE. IT IS THE CONTRACTOR'S RESPONSIBILITY TO OBTAIN AND REVIEW ALL CONTRACT DOCUMENTS IN THEIR ENTIRETY PRIOR TO COMMENCING WORK. ANY CHANGES TO THIS DOCUMENT SHALL BE MADE TO THE INSTRUMENT OF SERVICE AS A WHOLE. THE CONTRACTOR SHALL BE RESPONSIBLE FOR OBTAINING AND REVIEWING ALL NECESSARY PERMITS AND REGULATIONS. THE CONTRACTOR SHALL BE RESPONSIBLE FOR OBTAINING AND REVIEWING ALL NECESSARY PERMITS AND REGULATIONS. THE CONTRACTOR SHALL BE RESPONSIBLE FOR OBTAINING AND REVIEWING ALL NECESSARY PERMITS AND REGULATIONS. THE CONTRACTOR SHALL BE RESPONSIBLE FOR OBTAINING AND REVIEWING ALL NECESSARY PERMITS AND REGULATIONS.