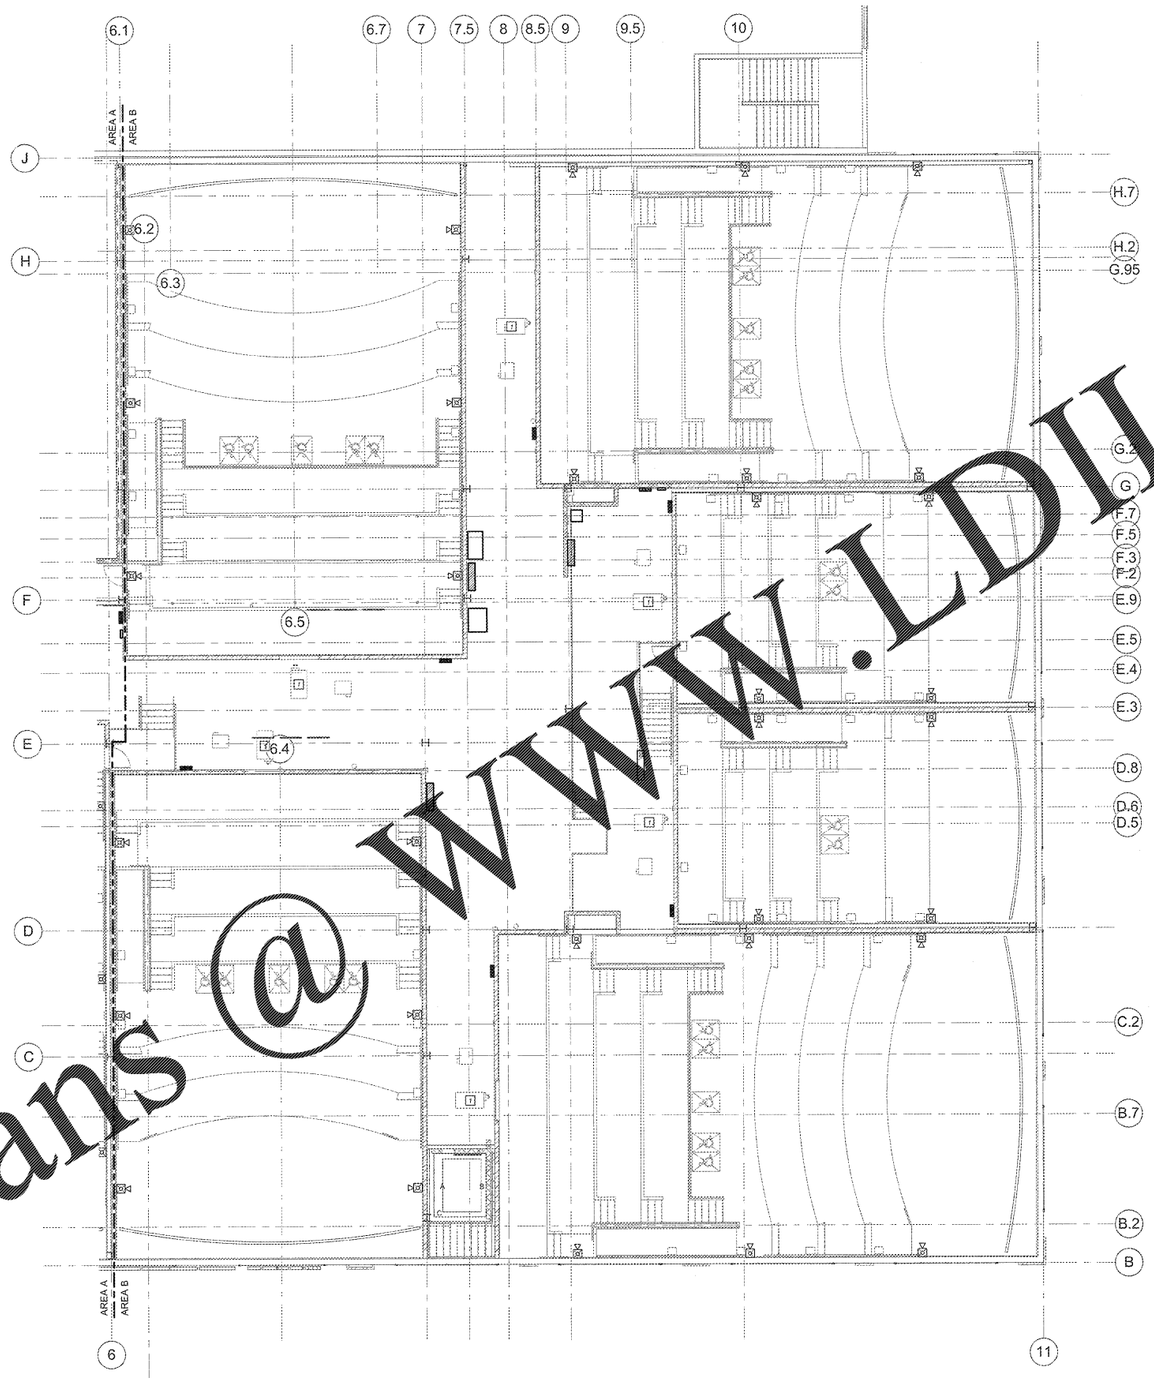

PROJECTION LEVEL AREA B FIRE ALARM PLAN

1/8" = 1'-0"

FIRE ALARM GENERAL NOTES

A. ALL CONDUIT INSTALLED INDOORS SHALL BE ELECTRICAL METALLIC TUBING (EMT), MINIMUM 1/2".

B. THE CONTRACTOR SHALL FURNISH ALL LABOR, MATERIALS, TOOLS, EQUIPMENT AND PERFORM ALL WORK AND SERVICES NECESSARY FOR OR INCIDENTAL TO THE FURNISHING AND INSTALLATION, COMPLETE OF ALL WIRING MATERIALS AND METHODS AS SHOWN ON THE DRAWINGS AND AS SPECIFIED, IN ACCORDANCE WITH PROVISIONS OF THE CONTRACT DOCUMENTS AND COMPLETELY COORDINATED WITH WORK OF ALL OTHER TRADES.

C. ALL EMPTY CONDUITS SHALL BE PROVIDED WITH PULL STRING INSTALLED AND PLASTIC GROMMET.

D. THE CONTRACTOR TO VERIFY EXACT PLACEMENT OF ALL DEVICES SHOWN ON THE ELECTRICAL CONSTRUCTION DOCUMENTS WITH MECHANICAL DRAWINGS PRIOR TO FINAL PLACEMENT.

E. ALL OPENINGS SLEEVED THROUGH FLOOR CONSTRUCTION, FIRE WALLS OR SMOKE PARTITIONS, SHALL BE SEALED WITH AN APPROVED SEALANT HAVING FIRE RATING EQUAL TO THAT OF STRUCTURAL MEMBER PENETRATED.

F. PROVIDE TRANSIENT PROTECTION TO REDUCE THE POSSIBILITY OF DAMAGE BY INDUCED TRANSIENTS, CIRCUITS AND EQUIPMENT SHALL BE PROTECTED IN ACCORDANCE WITH THE REQUIREMENTS OF ARTICLE 800 OF THE NATIONAL ELECTRICAL CODE.

G. THE CIRCUIT BREAKERS FOR THE FIRE ALARM SYSTEM SHALL BE [illegible] A RED MARKING AND SHALL BE IDENTIFIED AS "FIRE ALARM CIRCUIT".

M. THE LOCATION OF THIS CIRCUIT [illegible] SHALL BE PERMANENTLY [illegible] THE FIRE ALARM CONTROL UNIT.

I. ANY DEVICE OR SYSTEM INTENDED TO ACTUATE THE LOCKING OR UNLOCKING OF EXITS SHALL BE CONNECTED TO THE FIRE ALARM SYSTEM. EXITS CONNECTED TO THE FIRE ALARM SYSTEM SHALL UNLOCK UPON RECEIPT OF A FIRE ALARM SIGNAL BY MEANS OF THE FIRE ALARM SYSTEM.

J. MANUAL FIRE ALARM DEVICES SHALL BE LOCATED WITHIN 5'-0" OF THE DOORWAY IN A CONSPICUOUS LOCATION, UNOBSTRUCTED AND ACCESSIBLE AT EACH EXIT ON EACH FLOOR.

K. ALL PROGRAM HORNES AND STROBE DEVICES LOCATED IN THE SAME ROOM OR OPEN OFFICE AREA SHALL BE SYNCHRONIZED TO FLASH AT THE SAME RATE PER LATEST FIRE ALARM CODE.

L. THE FIRE ALARM CONTRACTOR SHALL BE RESPONSIBLE FOR INCLUDING THE COST OF ALL REQUIRED 120 VOLT CIRCUITS REQUIRED FOR THE FIRE ALARM CONTROL PANEL, SUPPLEMENTAL POWER SUPPLY PANELS, XTRALIS/VESDA PANELS AND ALL FIRE ALARM SYSTEM REQUIRED 120 VOLT CIRCUITS.

FIRE ALARM PLAN NOTES

1. INSTALL A FIRE ALARM OUTPUT DEVICE THAT WILL CLOSE DRY CONTACTS WHEN THE FIRE ALARM SYSTEM GOES INTO ALARM. THE CONTACTS WILL OPEN WHEN THE FIRE ALARM SYSTEM IS CLEARED AND THE SYSTEM IS RESET. THE DEVICE SHALL CONTAIN TWO SEPARATE CONTACTS. WIRE ONE SET INTO THE PROJECTOR AUTOMATION PANEL AND THE OTHER SET INTO THE AUDITORIUM DIMMING PANEL.

Order Plans @ WWW.LDLINE.COM

THIS DRAWING IS A GRAPHIC PART OF AN INTEGRATED SET OF DOCUMENTS TO BE USED FOR CONSTRUCTION. ERRORS OR OMISSIONS ARE SPECIFICALLY DISCLAIMED IN ANY MEDIA, BUT NOT LIMITED TO, ELECTRONIC MEDIA. CONTRACTOR SHALL VERIFY ALL DIMENSIONS AND CONDITIONS AT THE JOB SITE AND NOTIFY THE ARCHITECT OF ANY DISCREPANCIES BEFORE PROCEEDING WITH THE WORK. THE CONTRACTOR SHALL BE RESPONSIBLE FOR ALL CONSTRUCTION MEANS, METHODS, TECHNIQUES, SEQUENCES AND PROCEDURES AND FOR COORDINATING ALL PORTIONS OF THE WORK. THE CONTRACTOR SHALL BE RESPONSIBLE FOR ALL JOB SITE SAFETY PRECAUTIONS AND PROGRAMS. THE CONTRACTOR SHALL BE RESPONSIBLE FOR THE ACTIONS OF ALL SUBCONTRACTORS AND ENSURE THAT THEY COMPLY WITH ALL APPLICABLE CODES AND REGULATIONS. THE CONTRACTOR SHALL BE RESPONSIBLE FOR ALL CONSTRUCTION MEANS, METHODS, TECHNIQUES, SEQUENCES AND PROCEDURES AND FOR COORDINATING ALL PORTIONS OF THE WORK. THE CONTRACTOR SHALL BE RESPONSIBLE FOR ALL JOB SITE SAFETY PRECAUTIONS AND PROGRAMS. THE CONTRACTOR SHALL BE RESPONSIBLE FOR THE ACTIONS OF ALL SUBCONTRACTORS AND ENSURE THAT THEY COMPLY WITH ALL APPLICABLE CODES AND REGULATIONS. THE CONTRACTOR SHALL VERIFY ALL DIMENSIONS AND CONDITIONS AT THE JOB SITE AND NOTIFY THE ARCHITECT OF ANY DISCREPANCIES BEFORE PROCEEDING WITH THE WORK. THE CONTRACTOR SHALL BE RESPONSIBLE FOR ALL CONSTRUCTION MEANS, METHODS, TECHNIQUES, SEQUENCES AND PROCEDURES AND FOR COORDINATING ALL PORTIONS OF THE WORK. THE CONTRACTOR SHALL BE RESPONSIBLE FOR ALL JOB SITE SAFETY PRECAUTIONS AND PROGRAMS. THE CONTRACTOR SHALL BE RESPONSIBLE FOR THE ACTIONS OF ALL SUBCONTRACTORS AND ENSURE THAT THEY COMPLY WITH ALL APPLICABLE CODES AND REGULATIONS.

THIS DOCUMENT SHALL NOT BE USED FOR ANY OTHER PURPOSES, FOR ADDITIONS TO THIS PROJECT, OR FOR COMPLETION OF THIS PROJECT BY OTHERS WITHOUT THE PRIOR WRITTEN CONSENT OF GIBBENS DRAKE SCOTT. ANY INDIVIDUAL AND/OR COMPANY THAT USES THIS DOCUMENT WITHOUTH PRIOR AGREEMENT WITH GDS SHALL BE HELD LIABLE TO ANY AND ALL DAMAGES RESULTING FROM SUCH USE. GDS, INC. SHALL NOT BE HELD RESPONSIBLE FOR ANY CHANGES MADE TO THIS DOCUMENT BY OTHERS WITHOUT THE PRIOR WRITTEN CONSENT OF GDS, INC. ANY SUCH CHANGES ARE NOT THE RESPONSIBILITY OF GDS, INC. AND GDS, INC. SHALL NOT BE HELD LIABLE FOR ANY PROBLEMS THAT ARISE FROM THE UNAUTHORIZED USE OF THIS DOCUMENT.

GEORGIA REGISTERED No. PE031486 PROFESSIONAL ENGINEER TIM L SCOTT

SIGNATURE: DATE:

GDS ENGINEERING

Gibbens, Drake, Scott, Inc.
9205 E. 63rd Street, Suite 109
Raytown, Missouri 64133
Phone: (816) 536-1399
fax: (816) 358-2367
www.gdsengr.com
GEORGIA COA #PEF000203

SHEET LEGEND

G000x	GENERAL INFORMATION & SCOPE OF WORK
A100x	FLOOR PLANS & DETAILS
A150x	REFLECTED CEILING PLANS
A200x	EXTERIOR & INTERIOR ELEVATIONS
A300x	BUILDING SECTIONS
A400x	ENLARGED PLANS
A500x	EXTERIOR & INTERIOR DETAILS
A600x	DOOR SCHEDULE, DOOR DETAILS, FINISH SCHEDULE, FINISH LEGEND
C150x	SITE PLAN, GRADING, UTILITIES
C250x	AUDITORIUM SEATING PLAN
S's	STRUCTURAL
M's	MECHANICAL
P's	PLUMBING
E's	ELECTRICAL
W's	WAYFINDING DETAILS
FS's	CASEWORK & EQUIPMENT

MADISON YARDS 8

AMC NEW BUILD
905 MEMORIAL DRIVE SE
ATLANTA, GA. 303316

amc

American Multi-Cinema, Inc.
One AMC Way
11500 Ash Street
Leawood, KS 66211

No.	Date	Description

Project Issue Date:

KEY PLAN:

SHEET TITLE:
PROJECTION LEVEL AREA-B FIRE ALARM PLAN

SHEET NUMBER:
F104