


1 WALL MOUNT HANDRAIL DETAIL  
PLFS0.3 N.T.S.


2 HANDRAIL @ NEW PARTITION WALL DETAIL  
PLFS0.3 N.T.S.

3 NOT USED  
PLFS0.3


4 NOT USED  
PLFS0.3

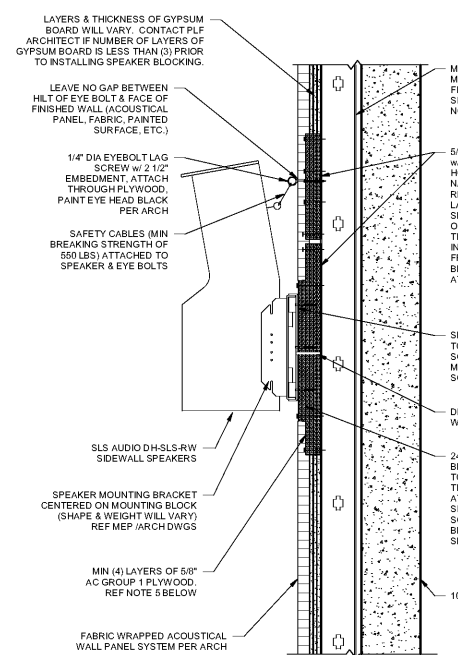


SPEAKER MOUNT  
@ EXISTING STUD WALL SECTION

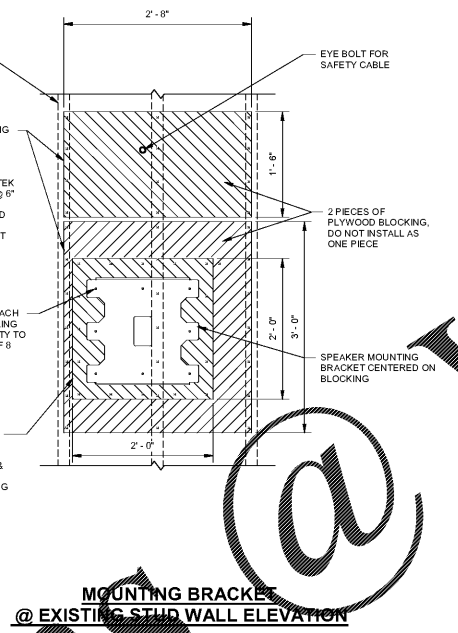

MOUNTING BRACKET  
@ EXISTING STUD WALL ELEVATION

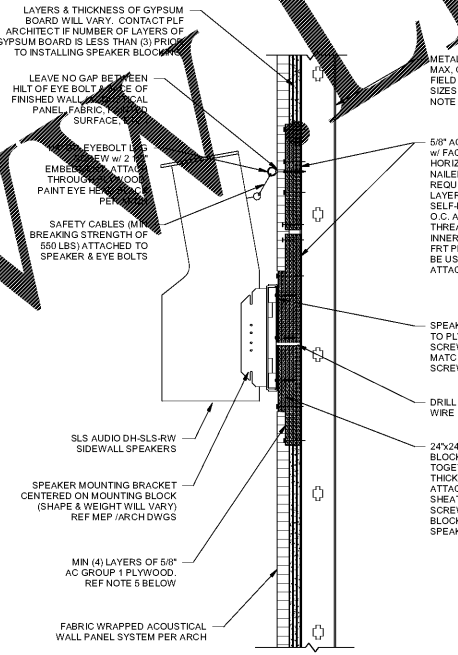

SPEAKER MOUNT  
@ EXISTING STUD WALL SECTION

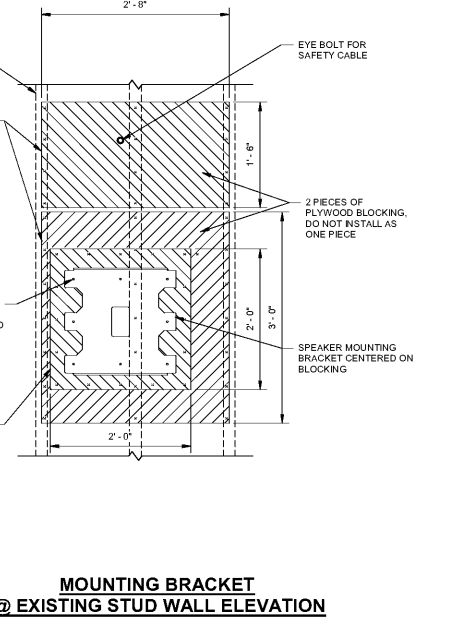

MOUNTING BRACKET  
@ EXISTING STUD WALL ELEVATION

- NOTES:**
- THE MAXIMUM SPEAKER AND BRACKET WEIGHT ALLOWED FOR THIS DETAIL IS 100 LBS. IF THE WEIGHT OF THE EQUIPMENT RECEIVED EXCEEDS THIS WEIGHT, THE INSTALLER AND GENERAL CONTRACTOR MUST CONTACT THE ARCHITECT FOR A REVISED DETAIL.
  - THE SPEAKER BRACKET USED FOR THIS DETAIL SHALL NOT EXTEND MORE THAN 6" FROM THE FACE OF BLOCKING. IF THE BRACKET RECEIVED REQUIRES EXTENSION EXCEEDING THIS DIMENSION, THE INSTALLER AND GENERAL CONTRACTOR MUST CONTACT THE ARCHITECT FOR A REVISED DETAIL.
  - CONTRACTOR SHALL FIELD VERIFY EXISTING METAL STUD WALL FRAMING. IF FIELD CONDITIONS VARY, CONTRACTOR SHALL CONTACT ARCHITECT FOR REVISED DETAIL.
  - THE MOUNTING BRACKET MAY VARY PROJECT-TO-PROJECT. THE GRAPHIC REPRESENTATION IS NOT PROJECT SPECIFIC.
  - CONTRACTOR SHALL REMOVE EXISTING GYPSUM BOARD (ALL LAYERS) FROM STUD WALL @ LOCATION OF BLOCKING. CONTRACTOR SHALL SEAL ALL BLOCKING EDGES WITH ACOUSTICAL SEALANT.
  - CONTRACTOR SHALL FIELD VERIFY EXISTING STUD SIZES & CONFIRM THAT STUD HEIGHTS DO NOT EXCEED THE VALUES SHOWN IN THE TABLE BELOW. IF EXISTING STUDS EXCEED HEIGHTS SHOWN, CONTRACTOR SHALL INSTALL NEW METAL STUDS IN ACCORDANCE W/ TABLE @ SPEAKER LOCATIONS. IF EXISTING STUD SIZES VARY FROM THOSE SHOWN, CONTRACTOR SHALL CONTACT THE ARCHITECT & E.O.R. PRIOR TO INSTALLATION FOR A REVISED TABLE.

STUD SIZE (F.V.)	MAX STUD HT W/ WALL SPEAKER*
2S162-33	19'-0"
2S162-41	23'-0"
6S162-43	28'-0"
6S162-54	35'-0"
6S162-64	42'-0"
6S162-68	52'-0"

\*STUD HEIGHTS ARE BASED ON THE ASSUMPTION THAT STUDS ARE SPACED @ 16" O.C. MAX. IF STUDS ARE SPACED FURTHER APART, CONTACT ARCHITECT & E.O.R. FOR A REVISED TABLE.  
ALL PLYWOOD BLOCKING AT SPEAKER LOCATIONS SHALL BE AC GROUP 1. FRT PLYWOOD BLOCKING SHALL NOT BE USED FOR SPEAKER ATTACHMENTS.

- NOTES:**
- THE MAXIMUM SPEAKER AND BRACKET WEIGHT ALLOWED FOR THIS DETAIL IS 100 LBS. IF THE WEIGHT OF THE EQUIPMENT RECEIVED EXCEEDS THIS WEIGHT, THE INSTALLER AND GENERAL CONTRACTOR MUST CONTACT THE ARCHITECT FOR A REVISED DETAIL.
  - THE SPEAKER BRACKET USED FOR THIS DETAIL SHALL NOT EXTEND MORE THAN 6" FROM THE FACE OF BLOCKING. IF THE BRACKET RECEIVED REQUIRES EXTENSION EXCEEDING THIS DIMENSION, THE INSTALLER AND GENERAL CONTRACTOR MUST CONTACT THE ARCHITECT FOR A REVISED DETAIL.
  - CONTRACTOR SHALL FIELD VERIFY EXISTING METAL STUD WALL FRAMING. IF FIELD CONDITIONS VARY, CONTRACTOR SHALL CONTACT ARCHITECT FOR REVISED DETAIL.
  - THE MOUNTING BRACKET MAY VARY PROJECT-TO-PROJECT. THE GRAPHIC REPRESENTATION IS NOT PROJECT SPECIFIC.
  - CONTRACTOR SHALL REMOVE EXISTING GYPSUM BOARD (ALL LAYERS) FROM STUD WALL @ LOCATION OF BLOCKING. CONTRACTOR SHALL SEAL ALL BLOCKING EDGES WITH ACOUSTICAL SEALANT.
  - CONTRACTOR SHALL FIELD VERIFY EXISTING STUD SIZES & CONFIRM THAT STUD HEIGHTS DO NOT EXCEED THE VALUES SHOWN IN THE TABLE BELOW. IF EXISTING STUDS EXCEED HEIGHTS SHOWN, CONTRACTOR SHALL INSTALL NEW METAL STUDS IN ACCORDANCE W/ TABLE @ SPEAKER LOCATIONS. IF EXISTING STUD SIZES VARY FROM THOSE SHOWN, CONTRACTOR SHALL CONTACT THE ARCHITECT & E.O.R. PRIOR TO INSTALLATION FOR A REVISED TABLE.


STUD SIZE (F.V.)	MAX STUD HT W/ WALL SPEAKER*
3S25162-33	19'-0"
3S25162-43	23'-0"
6S05162-33	28'-0"
6S05162-43	35'-0"
6S05162-54	42'-0"
6S05162-68	52'-0"

\*STUD HEIGHTS ARE BASED ON THE ASSUMPTION THAT STUDS ARE SPACED @ 16" O.C. MAX. IF STUDS ARE SPACED FURTHER APART, CONTACT ARCHITECT & E.O.R. FOR A REVISED TABLE.

7. ALL PLYWOOD BLOCKING AT SPEAKER LOCATIONS SHALL BE AC GROUP 1. FRT PLYWOOD BLOCKING SHALL NOT BE USED FOR SPEAKER ATTACHMENTS.

5 DOLBY WALL SPEAKER SECTION @ STUD WALL  
PLFS0.3 N.T.S.

6 DOLBY WALL SPEAKER SECTION @ STUD WALL  
PLFS0.3 N.T.S.

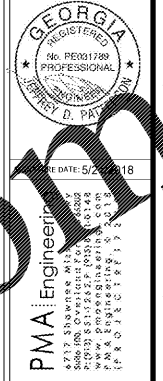


**SHEET LEGEND**

SYMBOL	DESCRIPTION
...	...

**AMC MADISON YARDS 8**  
AMC NEW BUILD  
905 MEMORIAL DRIVE SE  
ATLANTA, GA 30316



REV	DATE	DESCRIPTION



**SHEET TITLE:**  
TYPICAL  
DETAILS

**SHEET NUMBER:**  
PLFS0.3