

**PMA Engineering**  
 4717 Shownee Mission Hwy  
 Suite 100, Overland Park, KS 66202  
 P: (913) 881-1222, F: (913) 881-0148  
 www.pmaengineering.com  
 PMA Engineering, c 2019  
 PROJECT # 18078

**Screen Systems**  
 1440, RAOUL-CHARRETTE  
 JULIETTE, QC, CANADA  
 J6E  
 Tel.: 1-877-755-3111  
 Fax: 1-514-0-755-3111  
 www.streng.com

|              |                                  |
|--------------|----------------------------------|
| PROJECT:     | AMC MADISON YARDS<br>ATLANTA, GA |
| AUD #:       | AUDITORIUM #4                    |
| BY:          |                                  |
| DATE:        |                                  |
| DESCRIPTION: |                                  |
| REVISION:    |                                  |

DRAWING TITLE:

**SCREEN STRUCTURE  
 ISOMETRIC VIEW  
 FRONT SIDE**

DATE: 05/10/2018

SCALE: NO SCALE  
(THE ORIGINAL SIZE OF THIS DRAWING IS 36"x48")


DRAWN BY: BWP

APPROVED BY: TDA

JOB NO: SECTION:

DRAWING NUMBER:  
**SF004**

INFORMATIONS CONTAINED IN THIS DOCUMENT ARE CONFIDENTIAL AND THE EXCLUSIVE PROPERTY OF MDI AND PMA. IT IS FORBIDDEN TO USE OR REPRODUCE IN WHOLE OR IN PART, EXCEPT WITH THE PRIOR WRITTEN CONSENT OF MDI AND PMA.

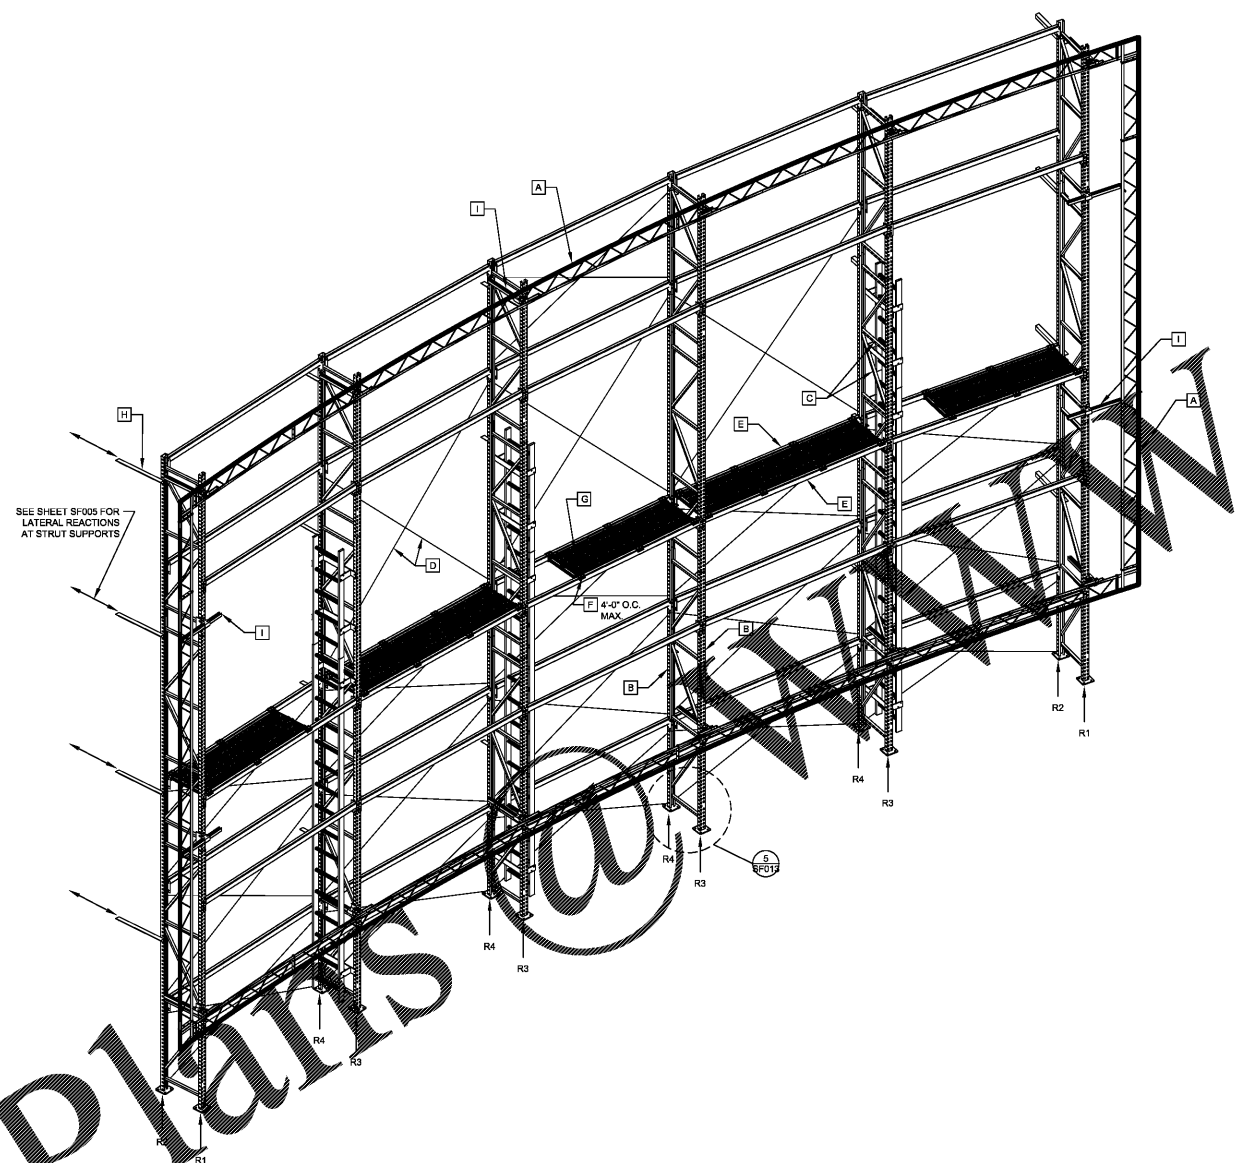

**MEMBER LIST:**

- A "WRAP-AROUND" SCREEN FRAME BY MDI
- B COLUMN C-SHAPE 3" x 1 1/4" GAGE (0.075" TO GRADE 50)
- C SECONDARY BEAM C-SHAPE 1 1/2" x 1 1/4" GAGE (0.075" TO GRADE 36)
- D ROUND TUBE 2.00" x 20 (10.030") A513 GRADE 1010 TYPE 2 (F<sub>y</sub> = 29 KSI MIN)  
OR  
X-BRACE FLAT BAR 1/2" x 0.25" A575 (F<sub>y</sub> = 36 KSI)
- E MAIN BEAM RECTANGULAR BOX BEAM 3.0 x 1.583" x 14 GAGE (0.370") A570 GRAD
- F SECONDARY BEAM RECTANGULAR TUBE HSS 2.0" x 1.0" x 11 GAGE (0.370") A570 TYPE 2 F<sub>y</sub> = 29 KSI MIN
- G SPEAKER PLANKS CSP F<sub>y</sub> x 2" x 18 GAGE (AT SPEAKER PLATFORM AND CATWALK LEVELS ONLY)
- H LATERAL STRUT L2 x 2 x 1/8 GRADE A36 9'-0" MAX LENGTH
- I UNISTRUT P1000 w/ CONNECTION BRACKETS 12 GAGE A1011 SS GRADE 33
- J

**GENERAL STRUCTURAL NOTES FOR SCREEN STRUCTURE:**

1. THE INTENT OF THESE STRUCTURAL DRAWINGS IS TO SHOW THE PRIMARY STRUCTURAL COMPONENTS AND MEMBERS OF THE SCREEN SUPPORT STRUCTURE. NON-STRUCTURAL COMPONENTS SUCH AS LADDERS, SAFETY DEVICES, SCREEN MATERIALS, ETC. ARE BY OTHERS.
2. REVIEW OF THE BUILDING STRUCTURE FOR REACTION LOADS SPECIFIED SHALL BE PERFORMED BY OTHERS. REINFORCING OF THE BUILDING STRUCTURE MAY BE REQUIRED AND SHALL BE DETERMINED BY OTHERS.
3. INSTALLER SHALL REFER TO STRONG / MDI SCREEN SYSTEM DRAWINGS AND INSTALLATION INSTRUCTIONS FOR ADDITIONAL INFORMATION, PARTS LIST, AND ERECTION DETAILS.
4. BUILDING CODE: 2012 INTERNATIONAL BUILDING CODE w/ GEORGIA AMENDMENTS
5. DESIGN LOADS:
  - A. DEAD LOADS OF SCREEN SYSTEM:
    - 1 SCREEN FRAME STRUCTURE WEIGHT: 3,878 LBS.
    - 2 SCREEN FABRIC WEIGHT: 142 LBS.
    - 3 WRAP-AROUND FRAME WEIGHT: 428 LBS.
    - 4 SPEAKERS (S) WEIGHT: 1,285 LBS.
    - 5 TOTAL WEIGHT: 5,731 LBS.
  - B. CATWALKS FOR MAINTENANCE ACCESS: 40 PSF
6. SEISMIC CRITERIA:
  - 1 OCCUPANCY CATEGORY: III
  - 2 SITE SOIL CLASS: D
  - 3 SHORT PERIOD RESPONSE, S<sub>s</sub>: 0.193g
  - 4 1-SECOND PERIOD RESPONSE, S<sub>1</sub>: 0.091g
  - 5 DESIGN RESPONSE, S<sub>D5</sub>: 0.239g
  - 6 DESIGN RESPONSE, S<sub>D1</sub>: 0.146g
  - 7 SEISMIC DESIGN CATEGORY: C
  - 8 R-FACTOR (SIGNS & BILLBOARDS): 3.0
  - 9 I-FACTOR (PERP TO SCREEN): 1.00
  - 10 I-FACTOR (PARALLEL TO SCREEN): 1.25
7. SPECIAL INSPECTIONS OF THE FOLLOWING ITEMS SHALL BE PERFORMED ON A PERIODIC BASIS IN ACCORDANCE WITH CHAPTER 17 OF THE 2012 INTERNATIONAL BUILDING CODE WITH GEORGIA AMENDMENTS.
  - A. POST-INSTALLED ANCHORS IN CONCRETE
  - B. STEEL MATERIAL VERIFICATION
  - C. STEEL BOLTING IN FIELD
  - D. STEEL FRAMING IN SITU

| COLUMN REACTION TABLE (KIPS) |                |                     |                |                 |
|------------------------------|----------------|---------------------|----------------|-----------------|
| LOCATION                     | DEAD LOAD ONLY | DEAD PLUS LIVE LOAD | SEISMIC UPLIFT | SEISMIC LATERAL |
| R1                           | 0.43           | 0.60                | N/A            | ±0.01           |
| R2                           | 0.41           | 0.59                | N/A            | ±0.02           |
| R3                           | 0.48           | 0.61                | N/A            | ±0.01           |
| R4                           | 0.51           | 0.63                | N/A            | ±0.02           |

**NOTES:**

1. DEAD PLUS LIVE LOAD REACTIONS INCLUDE 40 PSF LIVE LOAD ON ALL CATWALK LEVELS CONCURRENTLY.
2. UP AND LATERAL REACTIONS ARE ASD SEISMIC LOADS WITH A LOAD FACTOR = 0.7E.

Order Plans

LDOnline.com