PMA Engineering
6717 Shawnee Mission Pkwy
Suite 100, Overland Park, KS 66202
P: (913) 831-1325, F: (913) 831-0148
www.pmaengineering.com
PMA Engineering, c 2018
(PROJECT # P18078)

GEORGIA REGISTERED No. PE031789 PROFESSIONAL ENGINEER ANTHONY D. PATTERSON

5/21/2018

STRONG | MDI
Screen Systems
1440, RAOUL-CHARRETTE
JOLIETTE, QC, CANADA
J6E
Tel.: 1-877-755-
450-755-3
st
di.com

PROJECT: AMC MADISON YARDS
ATLANTA, GA

AGE #: AUDITORIUM #6 & 7

REVISION	DESCRIPTION	DATE:	BY:

DRAWING TITLE:

SCREEN STRUCTURE
ISOMETRIC VIEW
FRONT SIDE

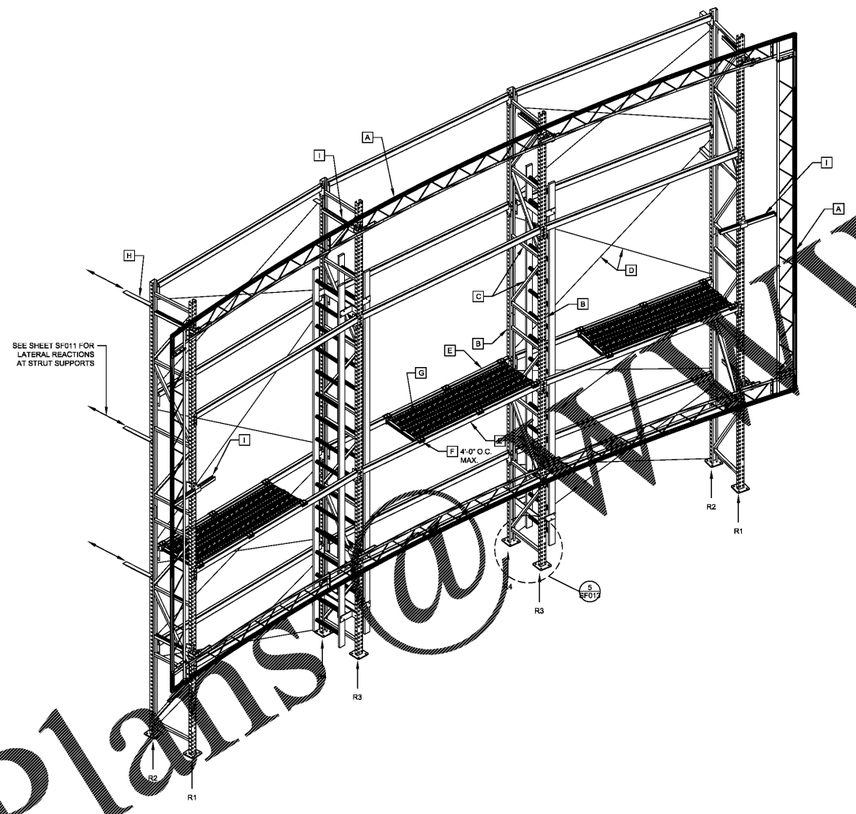

FRONT SIDE ISOMETRIC VIEW
N.T.S.
1
SF010

MEMBER LIST:

- A "WRAP-AROUND" SCREEN FRAME BY MDI
- B COLUMN C-SHAPE 3" x 1.500" x 14 GAGE (0.070") A570 GRADE 50
- C [illegible]-SHAPED 1.5" x [illegible] 16 GAGE (0.0[illegible]70) GRADE 36
- D ROUND TUBE [illegible].500" x 20 [illegible].035") A513 GRADE 1010 TYPE 2 (Fy = 28 KSI MIN)
  OR
  X-BRACE FLAT BA[illegible] x 0.25" AST[illegible] Fy = 36 KSI)
- E MAIN BEAM RECTANGULAR BOX BEAM 3.0 x 1.563" x 14 GAGE (0.070") A570 GRADE 50
- F SECONDARY BEAM RECTANGULAR TUBE HSS 2.0" x 1.0" x 11 GAGE (0.120") A513 GRADE 1010 TYPE 2 FY = 28 KSI MIN
- G OPEN MESH PLANKS OSP 9" x 2" x 18 GAGE (AT SPEAKER PLATFORM AND CATWALK LEVELS ONLY)
- H LATERAL STRUT L2 x 2 x 1/8 GRADE A36 5'-0" MAX LENGTH
- I UNISTRUT P1000 w/ CONNECTION BRACKETS 12 GAGE A1011 SS GRADE 33

GENERAL STRUCTURAL NOTES FOR SCREEN STRUCTURE:

1. THE INTENT OF THESE STRUCTURAL DRAWINGS IS TO SHOW THE PRIMARY STRUCTURAL COMPONENTS AND MEMBERS OF THE SCREEN SUPPORT STRUCTURE. NON-STRUCTURAL COMPONENTS SUCH AS LADDERS, SAFETY DEVICES, SCREEN MATERIALS, ETC. ARE BY OTHERS.
2. REVIEW OF THE BUILDING STRUCTURE FOR REACTION LOADS SPECIFIED SHALL BE PERFORMED BY OTHERS. REINFORCING OF THE BUILDING STRUCTURE MAY BE REQUIRED AND SHALL BE DETERMINED BY OTHERS.
3. INSTALLER SHALL REFER TO STRONG / MDI SCREEN SYSTEM DRAWINGS AND INSTALLATION INSTRUCTIONS FOR ADDITIONAL INFORMATION, PARTS LIST, AND ERECTION DETAILS.
4. BUILDING CODE: 2012 INTERNATIONAL BUILDING CODE w/ GEORGIA AMENDMENTS
5. DESIGN LOADS:
   - A. DEAD LOADS OF SCREEN SYSTEM:
     - 1.SCREEN FRAME STRUCTURE WEIGHT: 1,869 LBS.
     - 2.SCREEN FABRIC WEIGHT: 58 LBS.
     - 3.WRAP-AROUND FRAME WEIGHT: 261 LBS.
     - 4.SPEAKERS (3) WEIGHT: 771 LBS.
     - 5.TOTAL WEIGHT: 2,979 LBS.
   - B. CATWALKS FOR MAINTENANCE ACCESS: 40 PSF
   - C. SEISMIC CRITERIA:
     - 1.OCCUPANCY CATEGORY: III
     - 2.SITE SOIL CLASS: D
     - 3. SHORT PERIOD RESPONSE, Ss: 0.193g
     - 4. 1-SECOND PERIOD RESPONSE, S1: 0.091g
     - 5. DESIGN RESPONSE, SDS: 0.206g
     - 6. DESIGN RESPONSE, SD1: 0.146g
     - 7. SEISMIC DESIGN CATEGORY: C
     - 8. R-FACTOR (SIGNS & BILLBOARDS): 3.0
     - 9. I-FACTOR (PERP TO SCREEN): 1.00
     - 10. I-FACTOR (PARALLEL TO SCREEN): 1.25
6. SPECIAL INSPECTIONS OF THE FOLLOWING ITEMS SHALL BE PERFORMED ON A PERIODIC BASIS IN ACCORDANCE WITH CHAPTER 17 OF THE 2012 INTERNATIONAL BUILDING CODE WITH GEORGIA AMENDMENTS.
   - A. POST-INSTALLED ANCHORS IN CONCRETE
   - B. STEEL MATERIAL VERIFICATION
   - C. STEEL BOLTING IN FIELD
   - D. STEEL FRAMING IN SITU

COLUMN REACTION TABLE (KIPS)				
LOCATION	DEAD LOAD ONLY	DEAD PLUS LIVE LOAD	SEISMIC UPLIFT	SEISMIC LATERAL
R1	0.45	0.72	N/A	±0.01
R2	0.41	0.63	N/A	±0.01
R3	0.52	0.93	N/A	±0.01
R4	0.52	0.96	N/A	±0.01

NOTES:

1. DEAD PLUS LIVE LOAD REACTIONS INCLUDE 40 PSF LIVE LOAD ON ALL CATWALK LEVELS CONCURRENTLY.
2. UP AND LATERAL REACTIONS ARE ASD SEISMIC LOADS WITH A LOAD FACTOR = 0.7E.

DATE: 05/10/2018

SCALE: NO SCALE
(THE ORIGINAL SIZE OF THIS DRAWING IS 36"X24")

DRAWN BY: BWP

APPROVED BY: TDA

JOB NO: | SECTION:

DRAWING NUMBER: SF010

INFORMATIONS CONTAINED IN THIS DOCUMENT ARE CONFIDENTIAL AND THE EXCLUSIVE PROPERTY OF MDI AND PMA. IT IS FORBIDEN TO USE OR REPRODUCE IN WHOLE OR IN PART, EXCEPT WITH THE PRIOR WRITTEN CONSENT OF MDI AND PMA.

Order Plans @ WWW.LEDLine.com