

DIVISION 09 - FINISHES (CONTINUED)

- D. APPLICATION
1. APPLY MINIMUM MIL THICKNESSES OF EACH COAT OF PRIMER AND EACH COAT OF FINISH FOLLOWING THE MANUFACTURER'S SPECIFIC RECOMMENDATIONS...
E. COLOR SCHEDULE
1. USE THE ACRYLIC ENAMEL PAINT SYSTEM FOR THE FIRST FOUR ITEMS OF THE COLOR SCHEDULE...
F. CLEANUP
1. UPON COMPLETION OF PAINTING WORK, REMOVE ALL EXCESS MATERIALS, EQUIPMENT, TOOLS, AND DEBRIS FROM THE SITE.

DIVISION 26 - ELECTRICAL

- A. GENERAL
1. ALL ELECTRICAL WORK IS TO MEET THE APPLICABLE PORTIONS OF THE FOLLOWING RECOGNIZED CODES AND STANDARDS:
a) CERTIFIED BALLAST MANUFACTURERS (CBM)
b) NATIONAL ELECTRICAL MANUFACTURER'S ASSOCIATION (NEMA)
B. CABLE, WIRE, AND CONNECTORS
1. WIRE AND CABLE:
a) PROVIDE FACTORY FABRICATED WIRE AND CABLE OF THE SIZE, RATING, MATERIAL, AND TYPE AS INDICATED.

DIVISION 26 - ELECTRICAL (CONTINUED)

- B. CABLE, WIRE, AND CONNECTORS (CONTINUED)
5. CONNECTORS FOR BUILDING WIRE AND CABLE
a) USE TERMINAL LUGS WHENEVER POSSIBLE UP TO AND INCLUDING #6 AWG.
C. GROUNDING
1. GROUND ALL EQUIPMENT AND DEVICES AS INDICATED ON THE DRAWINGS...
D. CONDUCTOR TESTS
1. PERFORM MEGGER TESTS ON INSULATION BEFORE SEALS ARE POURED...
E. CONDUIT
1. PROVIDE A COMPLETE ASSEMBLY OF CONDUIT WITH FITTINGS FOR EACH ELECTRICAL RACEWAY INCLUDING CONNECTORS, NIPPLES, COUPLINGS, EXPANSION FITTINGS, BUSHINGS, LOCKNUTS, AND ALL OTHER COMPONENTS...
F. SITE CONDUIT ROUTING, BURIAL DEPTH AND SPACING
1. BURY ALL UNDERGROUND SITE CONDUIT AT A MINIMUM OF 18 INCHES BELOW THE FINISHED GRADE.

DIVISION 26 - ELECTRICAL (CONTINUED)

- I. EQUIPMENT TESTS
1. PERFORM OPERATIONAL TESTS ON ALL ELECTRICAL EQUIPMENT TO ENSURE SATISFACTORY PERFORMANCE.
J. ELECTRICAL WORK CLOSE-OUT
1. ALL SITE ELECTRICAL SYSTEMS MUST HAVE PASSED FUNCTIONAL TESTING AND BE FULLY OPERABLE.
K. BOX AND PANEL BOARD
1. PROVIDE ELECTRICAL MATERIALS, AND COMPONENTS FOR A COMPLETE INSTALLATION EQUAL TO THOSE SUPPLIED BY CROUSE-HINDS, APPLETON, OR SQUARE D.
L. SAFETY AND DISCONNECT SWITCHES
1. PROVIDE HEAVY DUTY TYPE, DEAD FRONT, SHEET STEEL ENCLOSED, SURFACE MOUNTED SAFETY SWITCHES OF THE TYPE AND SIZE INDICATED.

DIVISION 31 - EARTHWORK

- A. GENERAL
1. REFERENCED PUBLICATIONS: THE FOLLOWING PUBLICATIONS ARE INCLUDED AS PART OF THESE EARTHWORK SPECIFICATIONS:
a) ASTM D 156 - METHOD FOR SIEVE ANALYSIS OF FINE AND COARSE AGGREGATES
b) ASTM D 698 - TEST METHODS FOR MOISTURE-DENSITY RELATIONS OF SOIL AND SOIL-AGGREGATE MIXTURES...
2. CARE SHALL BE USED WHEN OPERATING MECHANICAL EQUIPMENT IN LOCATIONS WHERE IT MAY CAUSE DAMAGE TO TREES, BUILDINGS, UTILITIES, OR STRUCTURES ABOVE OR BELOW GROUND.

CONTRACTOR SHALL REVIEW THE GEOTECHNICAL REPORT AND ALL CIVIL DOCUMENTS. THE GEOTECHNICAL REPORT AND CIVIL DOCUMENT SUPERCEDE ANY OF THE STANDARD SPECIFICATIONS ON THIS SHEET.


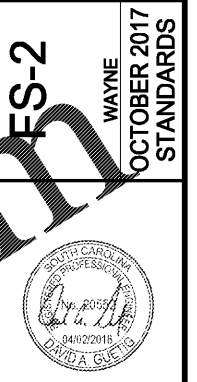


Table with project details: SPECIFICATIONS, SCALE: N/A, DATE: MARCH, 2018, FILE NAME: 03-Moc00616_FS-2, No. REVISION, and project location: 508 SC - 72 GREENWOOD SOUTH CAROLINA.

Galloway Planning, Architecture, Engineering, 6162 S. Willow Drive, Suite 330, Greenwood Village, CO 80111, 303.770.3500, www.gallowayusa.com



MURPHY USA logo and address: MURPHY OIL U.S.A. INC., 200 EAST PEACH STREET, EL DORADO, ARKANSAS 71730