

Callison|TKL, Inc.
1420 7th Ave, Suite 2400
Seattle, WA 98101
Tel: 206.623.4646

Callison|TKL Project No: 003-180034-00

Consultant:

HENDERSON ENGINEERS

Henderson Engineers, Inc.
8th Fl., 100 Broadway
New York, NY 10003
Tel: 212.443.5200

EVS

29 West 27th Street, 5th Floor
New York, NY 10001
Tel: 212.254.1000

LIGHTING PLAN GENERAL NOTES

- REFER TO SHEET E-000 FOR ADDITIONAL GENERAL NOTES.
- REFER TO ARCHITECTS LIGHT FIXTURE PACKAGE FOR LIGHT FIXTURE INFORMATION. LIGHT FIXTURE SCHEDULE SHOWN ON SHEET E-200 IS FOR REFERENCE ONLY.
- REFER TO ARCHITECTURAL SHEETS FOR LIGHT FIXTURES INSTALLED IN M.I. WORK. REFER TO ELECTRICAL POWER PLANS FOR HARDWIRED POWER CONNECTIONS.
- EMERGENCY EGRESS LIGHTING WITHIN THE TENANT SPACE HAS BEEN CALCULATED BY THE DESIGN PROFESSIONAL TO MEET 1.0 FOOT-CANDLE AVERAGE, 0.1 FOOT-CANDLE MINIMUM AND A 40:1 MAXIMUM RATIO ALONG THE ARCHITECT'S PATH OF EGRESS.
- PROVIDE NEUTRAL CONDUCTOR TO EACH WALL SWITCH LOCATION IF NEUTRAL TERMINATION IS NOT REQUIRED. OCP CONDUCTOR AND TAG AS NEUTRAL FOR FUTURE USE.
- LOW VOLTAGE SPECIFICATIONS AND LOCATIONS SHOWN ON THIS SHEET WERE PROVIDED TO HENDERSON ENGINEERS, INC. (HEI) BY OWNERS LIGHTING DESIGNER. HENDERSON ENGINEERS, INC. (HEI) IS PROVIDING LIGHTING DESIGN SERVICES FOR THE LIGHTING SYSTEM AND IS NOT RESPONSIBLE FOR THE LIGHTING DESIGN. THE ENGINEER SEAL AND SIGNATURE ON THIS SHEET APPLIES ONLY TO HIS SCOPE OF WORK.


LIGHT FIXTURE TAG LEGEND

| | | |
|---------|---|-------------------------------|
| L# | = | LIGHT FIXTURE TYPE |
| PNL #/# | = | PANELBOARD AND CIRCUIT NUMBER |
| RFP #/# | = | RELAY PANEL AND RELAY NUMBER |

OWNER'S LIGHTING DESIGNER HAS RESPONSIBILITY FOR THE LIGHTING DESIGN. MEETS MINIMUM ILLUMINATION LEVELS. LIGHTING DESIGNER'S DESIGN MEETS THE SCOPED WORK AND CONSUMER'S DESIRABLE LIGHTING FIXTURE SELECTION AND COORDINATE LOCATION, MOUNTING HEIGHTS AND FINISHES. ALL WORK SHALL BE COORDINATED WITH ARCHITECTURAL PLANS AND CONDITIONS PRIOR TO INSTALLATION. VERIFY ANY CONFLICTS OR INTERFERENCES PRIOR TO INSTALLATION.

ELECTRICAL PLAN NOTES

- ALL EXISTING LIGHT FIXTURES, CONTROLS, AND CIRCUITING IN ROOM AND DESIGNATED EXP ARE EXISTING TO REMAIN. FIELD VERIFY EXISTING CIRCUITS AND MAINTAIN CONTINUITY THROUGHOUT PROJECT.
- RELAY PANEL (RFP#) REFER TO SHEETS E-200 FOR REQUIREMENTS, SCHEDULES, AND ADDITIONAL INFORMATION.
- FAN WITH LIGHT KIT: THE TAG ASSOCIATED WITH THE LIGHT FIXTURE TYPE INDICATES CIRCUITING AND CONTROL REQUIREMENTS FOR THE LIGHT. THE TAG WITHOUT A LIGHT FIXTURE TYPE INDICATES CIRCUITING AND CONTROLS FOR THE FAN MOTOR.
- THE TAG ASSOCIATED WITH 'X' FIXTURES ARRANGED IN AN 'X' FORMATION SHALL BE TYPICAL OF ALL (4) FIXTURES WITHIN THE 'X' FORMATION.
- LOCATION OF NEW MASTER LIGHTING CONTROL SWITCHES AND SALES FLOOR DIMMING SWITCHES REFER TO LIGHTING CONTROL SCHEDULES AND SWITCHBANK DETAIL ON SHEET E-200 FOR ADDITIONAL INFORMATION.
- CEILING MOUNTED OCCUPANCY SENSOR AND POWER PACK FOR AUTOMATIC CONTROL OF LIGHT FIXTURES IN THIS SPACE. REFER TO LIGHTING CONTROL SCHEDULES AND DETAILS ON SHEET E-200 FOR ADDITIONAL INFORMATION.

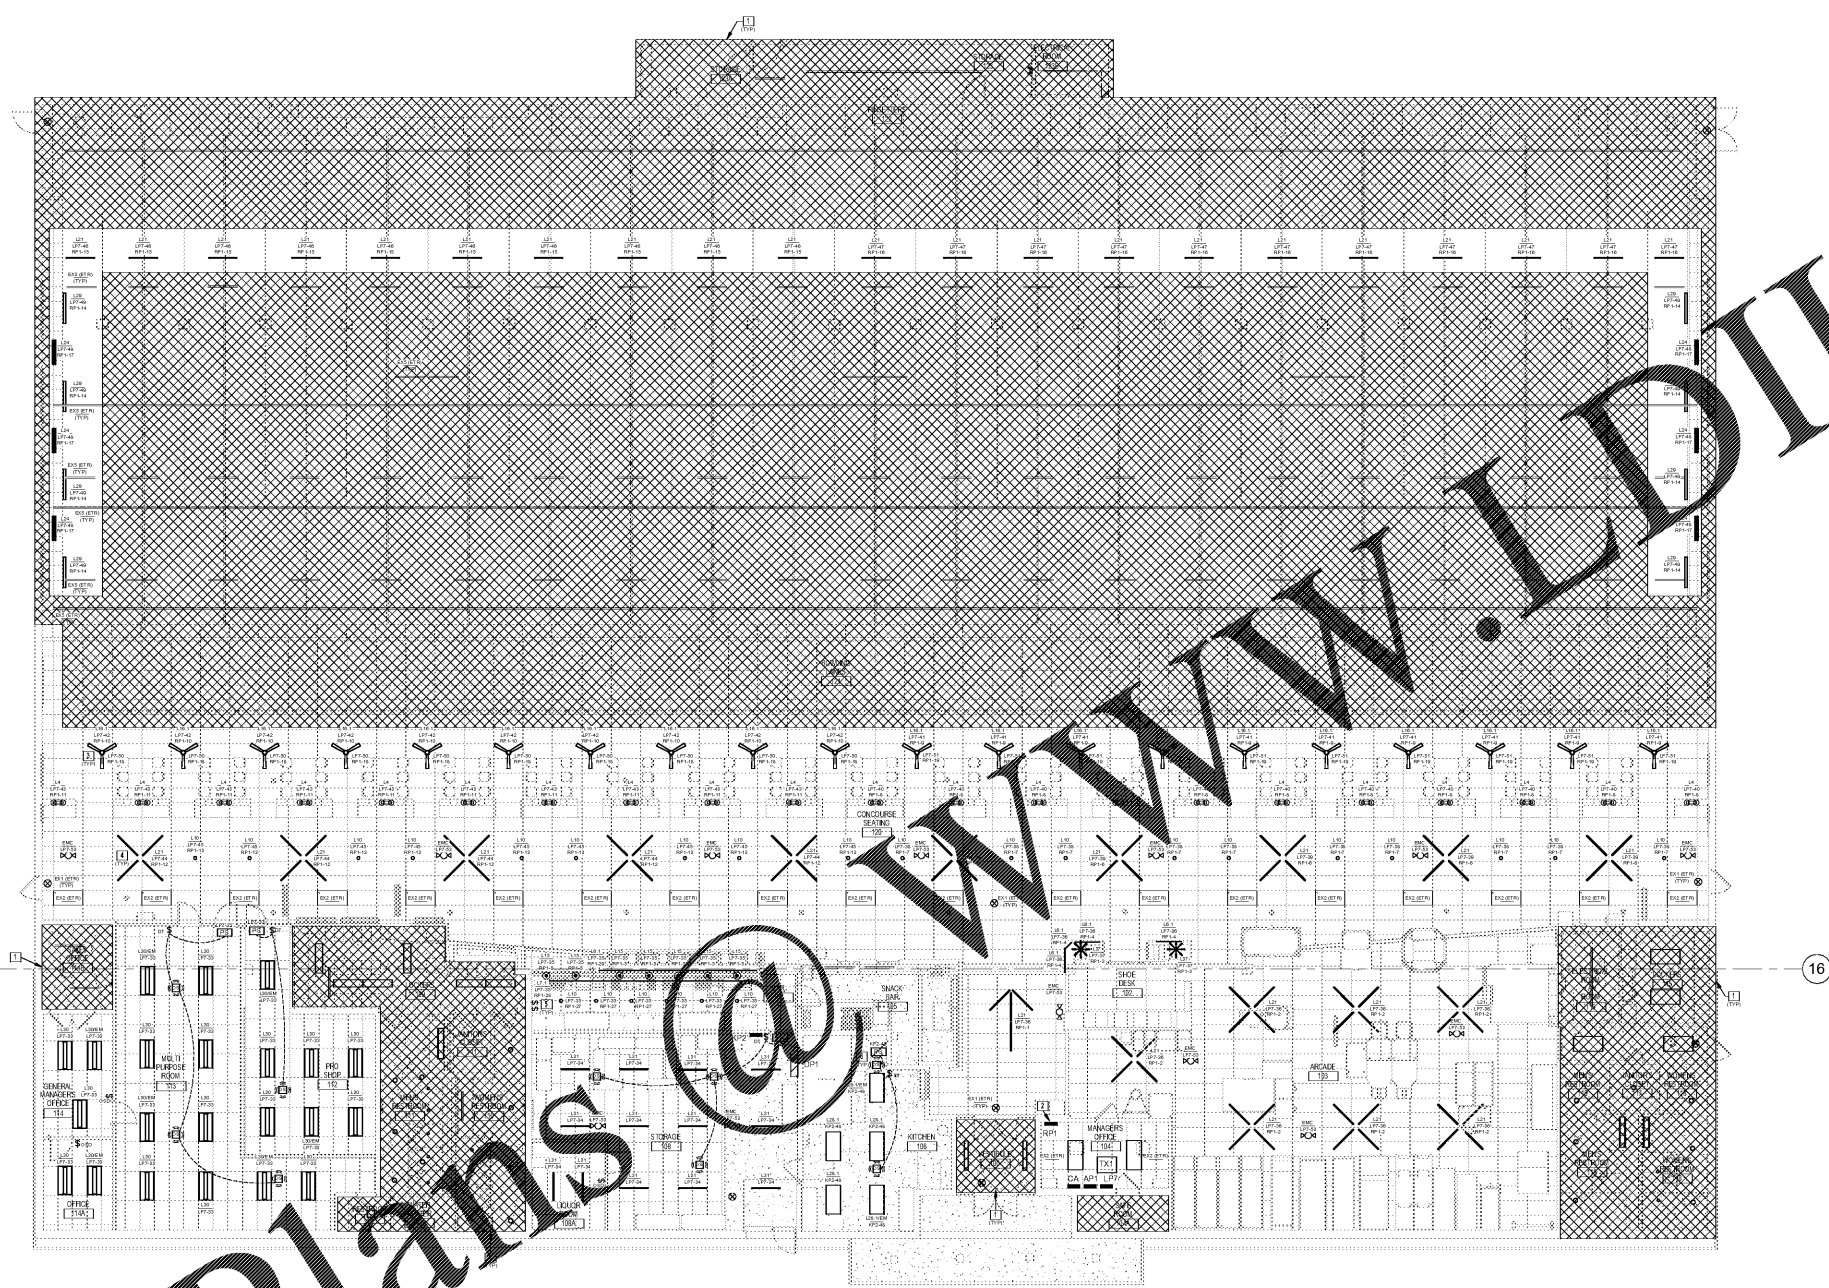

1 LIGHTING RCP
1/8" = 1'-0"

16

BOWLERO - AUGUSTA

ISSUE FOR PERMIT / BID

Client/Owner/Project Address

Bowlero | AMP
Client Address
222 WATER STREET
New York, NY 10003
Project Address
3077 Washington Rd
Augusta, GA 30807

Issue Drawing Log

| DATE | DESCRIPTION |
|------------|------------------|
| 2018 05 29 | ISSUE FOR PERMIT |

Seal

THIS DOCUMENT IS RELEASED FOR THE PROJECT'S FINAL DESIGN ONLY. IT IS NOT TO BE USED FOR CONSTRUCTION PURPOSES.

Sheet Identification

LIGHTING RCP

E-100

NOTE: EXISTING CONDITIONS WERE TAKEN FROM ORIGINAL DRAWINGS & SITE VISITS AND MAY NOT REFLECT EXACT "AS-BUILT" CONDITIONS. FIELD VERIFY ALL EXISTING CONDITIONS PRIOR TO SUBMITTING FINAL BIDS. CAREFULLY COORDINATE NEW WORK AND DEMOLITION WITH ALL OTHER DISCIPLINES AND EXISTING CONDITIONS.

Order Plans @ WWW.LEDILLINE.COM