

GENERAL NEW LOW VOLTAGE NOTES:


- 1 REFER TO SHEET E-000 FOR ELECTRICAL GENERAL NOTES
- 2 FOR TELEPHONE, AND AV DEVICES REFER TO ARCHITECTURAL DRAWINGS FOR EXACT LOCATION AND MOUNTING HEIGHTS
- 3 COORDINATE DEVICE LOCATIONS WITH MILLWORK WITH MILLWORK VENDOR PRIOR TO ROUGH-IN
- 4 FOR TELEPHONE AND DATA CABLES, PROVIDE 9" W/HP AT EACH TERMINATION POINT AND COIL FOR TERMINATION BY OTHERS
- 5 ALL LOW VOLTAGE WIRING FOR CONTROLS, AUDIOVISUAL, TELEPHONE AND SECURITY NOT INSTALLED IN CONDUIT. SHALL BE PLenum RATED CONDUCTIONS. CABLES SHALL BE BLENDED LEAD/VELCRO STRAPS AND SUPPORTED IN A WORKMAN LIKE MANNER IN ACCORDANCE WITH THE BECS STANDARDS AND THE NEC. CONTRACTOR SHALL VERIFY WITH LOCAL AUTHORITY HAVING JURISDICTION AND LANDLORD IF LOW VOLTAGE WIRING IS REQUIRED TO BE INSTALLED IN CONDUIT.

LOW VOLTAGE SCOPE NOTES

- 1 COORDINATE ALL LOW VOLTAGE OUTLET ROUGH-IN REQUIREMENTS, QUANTITIES AND EXACT LOCATIONS WITH ARCHITECT PRIOR TO ROUGH-IN
- 2 COORDINATE LOW VOLTAGE CABLES WITH ARCHITECT PRIOR TO ROUGH-IN. CONTRACTOR SHALL PULL CABLES FROM HEADINGS. CONTRACTOR SHALL PULL CABLES TO OUTLET LOCATION. COORDINATE EXACT TYPES AND QUANTITIES. CABLES TO BE PULLED TO EACH ROUGH-IN LOCATION WITH THE ARCHITECT AND OWNER PRIOR TO ROUGH-IN. COORDINATE WITH ARCHITECT AND OWNER PRIOR TO ROUGH-IN. COORDINATE WITH ARCHITECT AND OWNER PRIOR TO ROUGH-IN. PROVIDE 15" OF EXTRA HEAD ROOM FOR TERMINATION BY OTHERS
- 3 CONDUIT FROM ROUGH-IN TO TERMINATION POINTS SHALL BE INSTALLED WITH A MINIMUM OF 6" CLEARANCE FROM ACCESSIBLE CEILING
- 4 ALL LOW VOLTAGE WIRING SHALL BE SUPPORTED VIA EITHER CABLE TRAY OR J-HOOKS. J-HOOKS SHALL BE SUPPLIED BY THE MANUFACTURER. J-HOOKS SHALL BE SPACED AT 3'-0" MAXIMUM. J-HOOKS SHALL BE INSTALLED PER MANUFACTURER'S REQUIREMENTS

ELECTRICAL PLAN NOTES

- 1 UNLESS OTHERWISE NOTED, COORDINATE DATA CABLES AND TELEVISION REQUIREMENTS WITH ARCHITECT AND TELEVISION OWNER PRIOR TO ROUGH-IN. COORDINATE WITH ARCHITECT AND TELEVISION OWNER PRIOR TO ROUGH-IN. COORDINATE WITH ARCHITECT AND TELEVISION OWNER PRIOR TO ROUGH-IN. COORDINATE WITH ARCHITECT AND TELEVISION OWNER PRIOR TO ROUGH-IN
- 2 COORDINATE WITH ARCHITECT AND TELEVISION OWNER PRIOR TO ROUGH-IN. COORDINATE WITH ARCHITECT AND TELEVISION OWNER PRIOR TO ROUGH-IN. COORDINATE WITH ARCHITECT AND TELEVISION OWNER PRIOR TO ROUGH-IN
- 3 PROVIDE JUNCTION BOX FOR PROTECTION OVER DATA CONNECTION. COORDINATE WITH ARCHITECT AND TELEVISION OWNER PRIOR TO ROUGH-IN. COORDINATE WITH ARCHITECT AND TELEVISION OWNER PRIOR TO ROUGH-IN
- 4 TELEVISION COORDINATE TELECOMMUNICATIONS CABLES AND TELEVISION REQUIREMENTS WITH ARCHITECT AND TELEVISION OWNER PRIOR TO ROUGH-IN. COORDINATE WITH ARCHITECT AND TELEVISION OWNER PRIOR TO ROUGH-IN
- 5 DATA/VOICE OUTLET PROVIDE JUNCTION BOX WITH SINGLE GANG MULTIPLE. PROVIDE CONDUIT TO NEAREST ACCESSIBLE LOCATION ABOVE ITIM ROOM CEILING. PROVIDE CABLES FOR EACH DATA/VOICE PORT FROM OUTLET TO TERMINATION POINT IN ITIM ROOM
- 6 PROVIDE JUNCTION BOX WITH COVER PLATE FOR TELECOMMUNICATIONS AT ITIM RACK. PROVIDE CABLES WITH ADDITIONAL LENGTH CABLE EXTENDING FROM THE JUNCTION BOX AND COIL FOR TERMINATION BY OTHERS

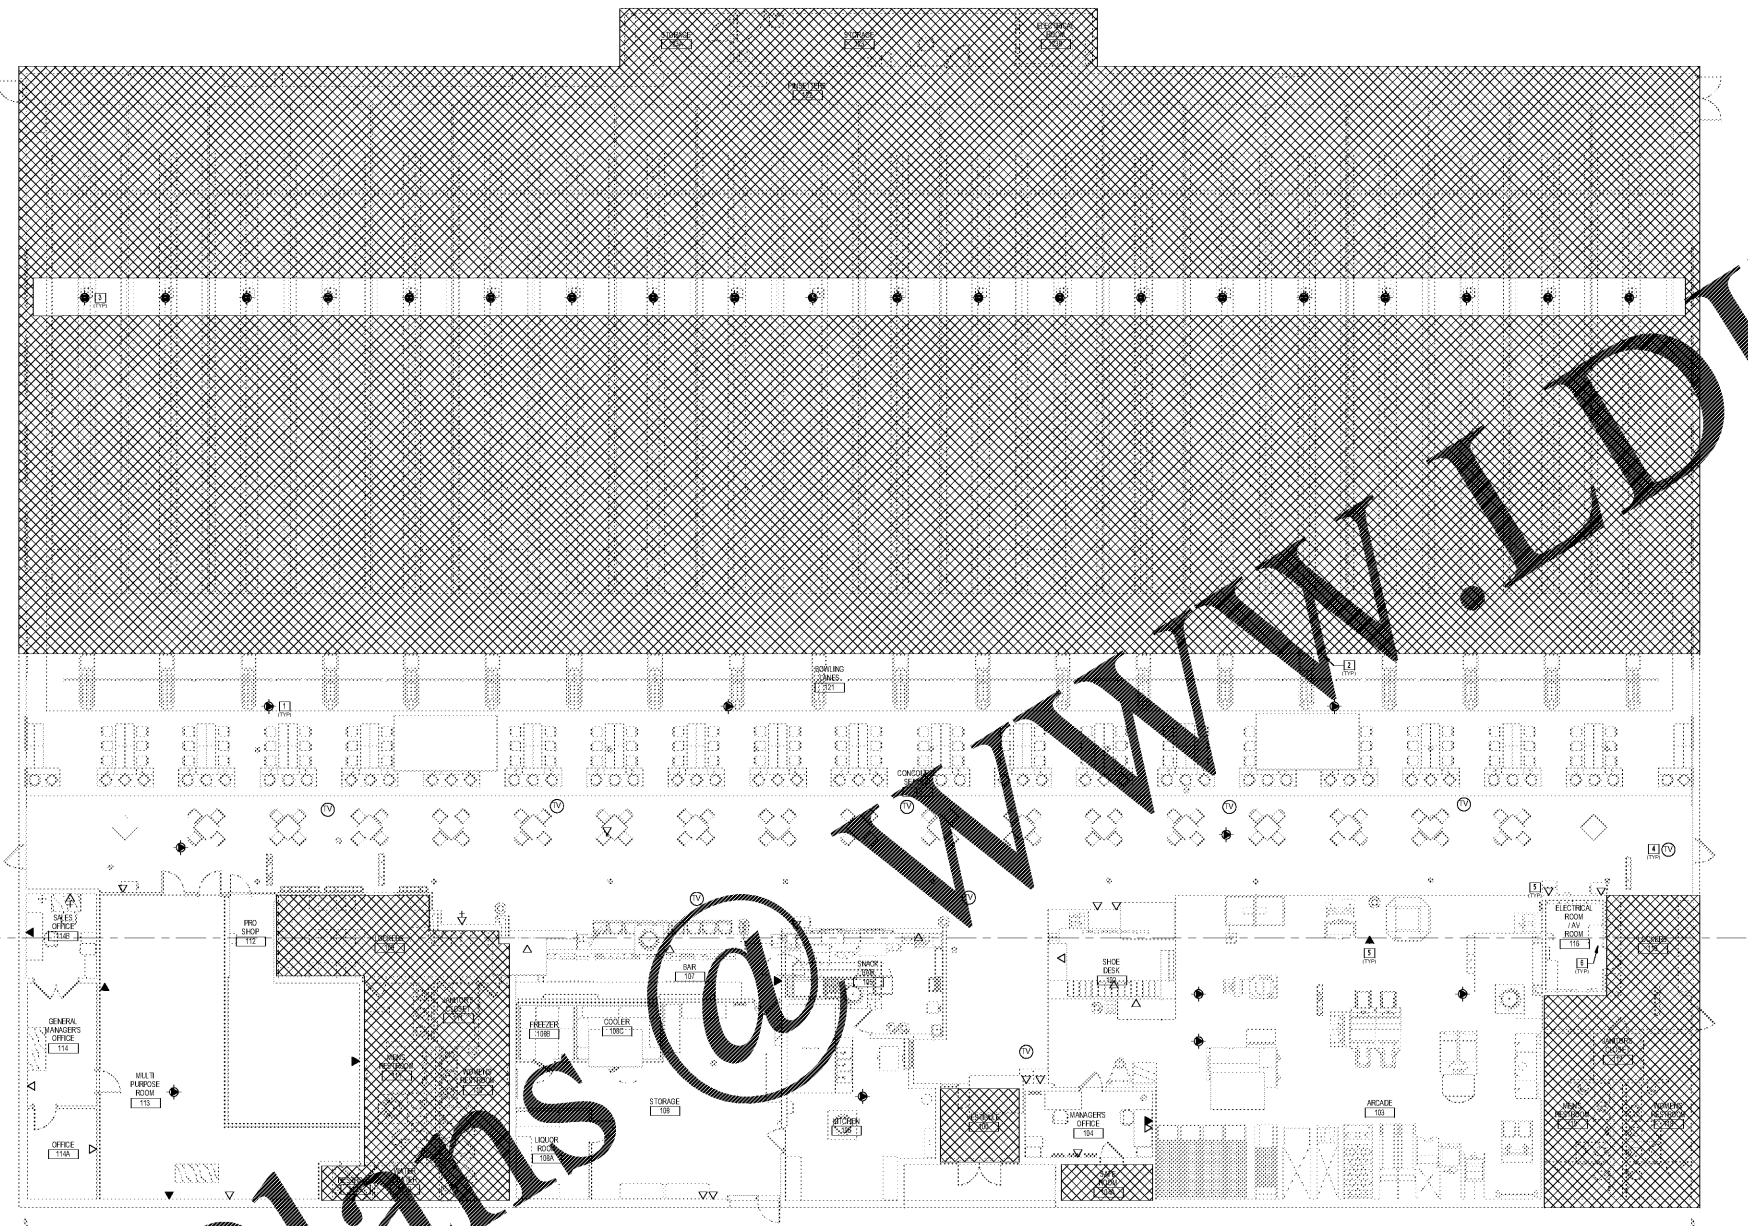

1 LOW VOLTAGE PLAN
1/8" = 1'-0"

16

BOWLERO - AUGUSTA

ISSUE FOR PERMIT / BID

Client/Owner/Project Address

Bowlero | AMP
Client Address:
222 WATER STREET
New York, NY 10038
Project Address:
2077 Washington Rd
Augusta, GA 30907

Issue Drawing Log

Date	Description
2018-05-29	ISSUE FOR PERMIT
2018-05-29	ISSUE FOR BID

Seal

THIS DOCUMENT IS RELEASED FOR THE PROJECT ONLY. IT IS NOT TO BE USED FOR OTHER PROJECTS.

Sheet Identification
LOW VOLTAGE PLAN

NOTE: EXISTING CONDITIONS WERE TAKEN FROM ORIGINAL DRAWINGS & SITE VISITS AND MAY NOT REFLECT EXACT "AS-BUILT" CONDITIONS. FIELD VERIFY ALL EXISTING CONDITIONS PRIOR TO SUBMITTING FINAL BIDS. CAREFULLY COORDINATE NEW WORK AND DEMOLITION WITH ALL OTHER DISCIPLINES AND EXISTING CONDITIONS.

Order Plans @