



14 MAKE-UP AIR UNIT CONNECTIONS
NTS

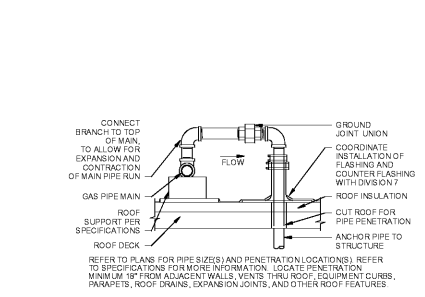


15 GAS PIPE ROOF PENETRATION
NTS

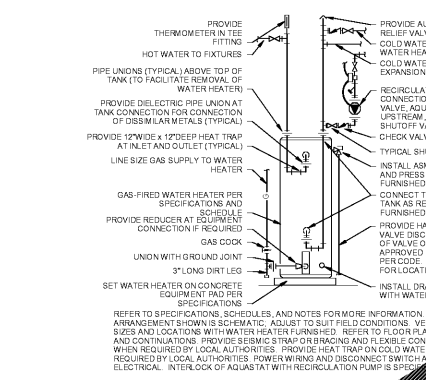


16 GAS FIRED WATER HEATER AND PUMP - FOR REFERENCE ONLY
NTS




17 SMALL EXPANSION TANK
NTS

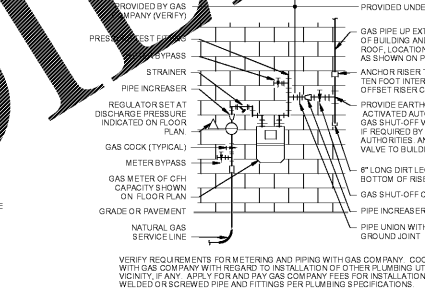


18 GAS METER SETTING
NTS

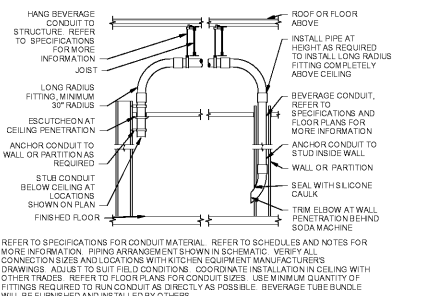


19 ABOVE-CEILING BEVERAGE CONDUIT
NTS

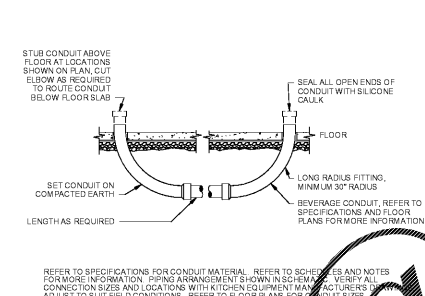


20 BEVERAGE CONDUIT BELOW SLAB
NTS

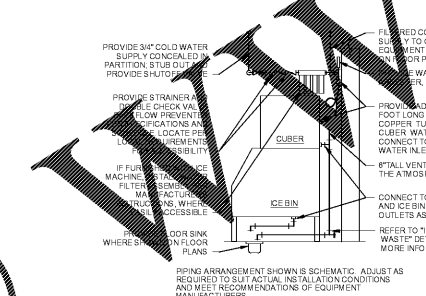


21 ICE MACHINE CONNECTIONS
NTS

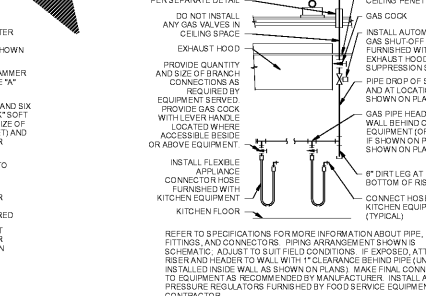


22 COOKING APPLIANCE GAS PIPE
NTS

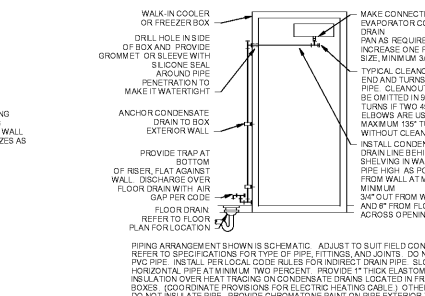


23 WALK-IN BOX CONDENSATE DRAIN
NTS

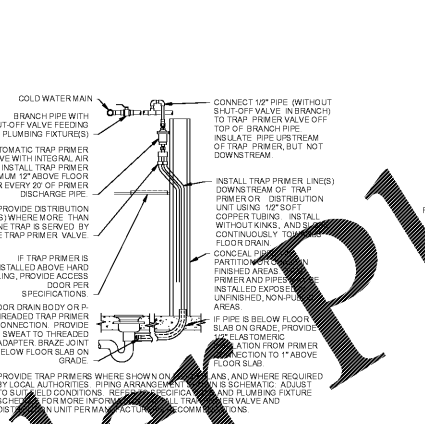


24 TRAP PRIMER OVERHEAD
NTS

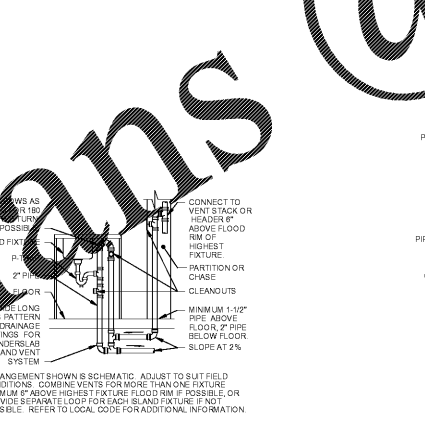


25 ISLAND FIXTURE VENT
NTS

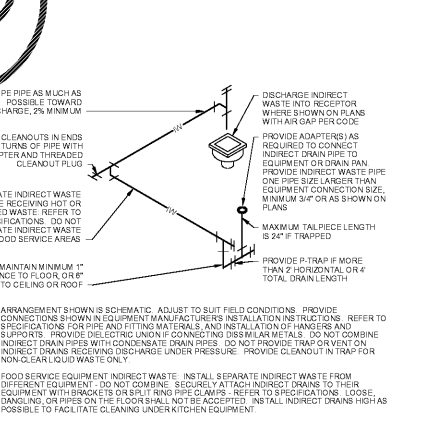

26 INDIRECT WASTE INSTALLATION - IPC
NTS

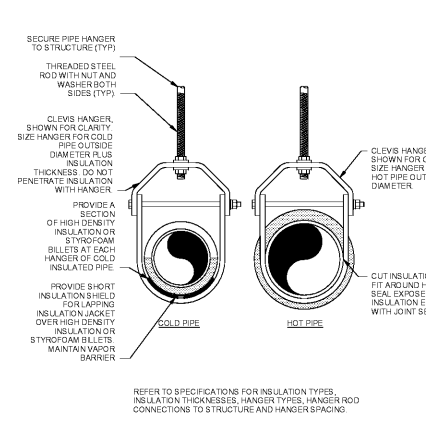

27 PIPE HANGER DETAIL
NTS

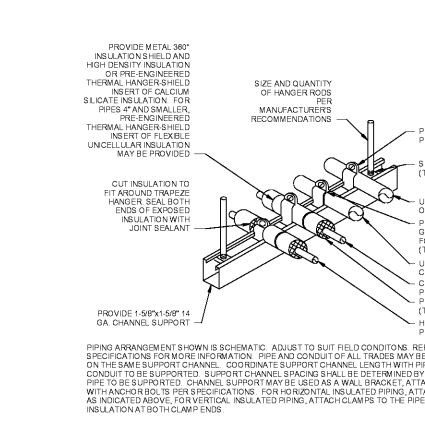

28 TRAPEZE PIPE HANGER
NTS

Client/Owner/Project Address
Bowler / AMP
222 W 44th Street
New York, NY 10036
Project Address
507 Washington Rd
Augusta, GA 30907

Issue Drawing Log

NO.	DATE	ISSUE FOR PERMIT	ISSUE FOR BID
2018 05 29			
2018 05 29			

THIS DOCUMENT IS RELEASED FOR THE PROJECT ONLY. IT IS NOT TO BE USED FOR ANY OTHER PURPOSES.

Sheet Identification
PLUMBING DETAILS

P-300

NOTE:
EXISTING CONDITIONS WERE TAKEN FROM ORIGINAL DRAWINGS & SITE VISITS AND MAY NOT REFLECT EXACT "AS-BUILT" CONDITIONS. FIELD VERIFY ALL EXISTING CONDITIONS PRIOR TO SUBMITTING FINAL BIDS. CAREFULLY COORDINATE NEW WORK AND DEMOLITION WITH ALL OTHER DISCIPLINES AND EXISTING CONDITIONS.

ORDER PLANS @