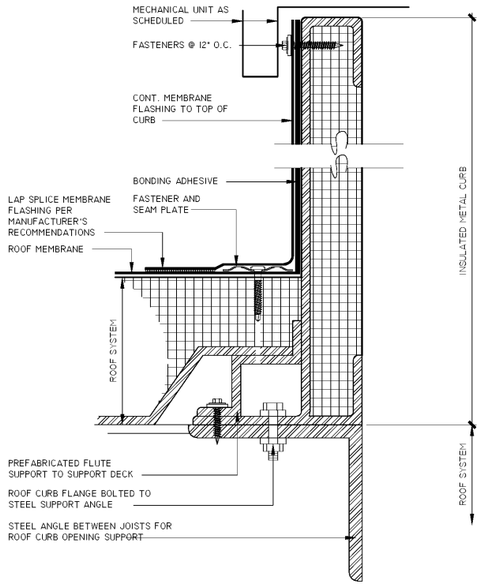

A7 DETAIL AT ROOF CURB

SCALE: 3" = 1'-0"

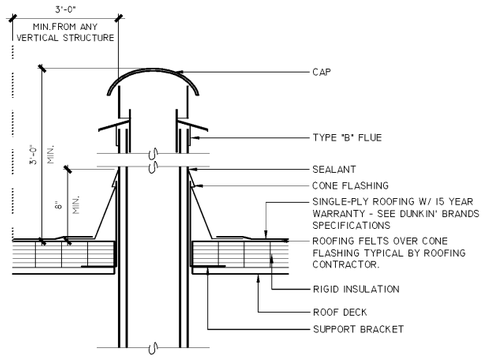

E9 EXHAUST PIPE PENETRATION DETAIL

SCALE: 3" = 1'-0"

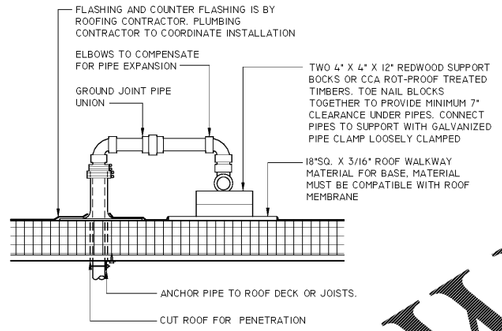

NOTES:

1. REFER TO PLANS FOR PIPE SIZE(S) AND LOCATION(S). USE WELDED OR SCREWED FITTINGS AS SPECIFIED FOR PIPE SIZE. LOCATE PENETRATION MINIMUM 18" FROM ADJACENT WALLS, EQUIPMENT CURBS, PARAPETS, EXPANSION JOINTS, ETCETERA.
2. LOCATE SUPPORTS AT THE FOLLOWING SPACING: 1-1/2"=9', 2"=8', 2-1/2"=7' & 3"=6'. PROVIDE SUPPORTS AS CLOSE AS POSSIBLE TO EACH ELBOW AND TEE.

E5 ROOF PENETRATION DETAIL

SCALE: 3" = 1'-0"

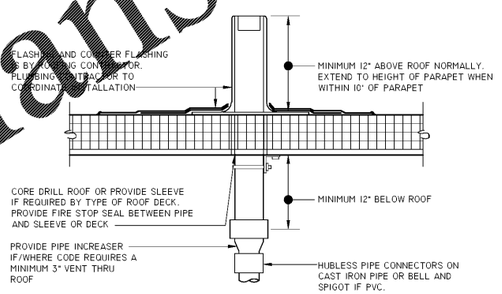

REFER TO PLANS FOR VTR PIPE SIZES AND LOCATIONS. LOCATE VTR MINIMUM THREE FEET FROM PROPERTY LINE, OR TEN FEET HORIZONTAL OR THREE FEET VERTICAL ABOVE ANY BUILDING OPENING OR FRESH AIR INTAKE, OR ONE FOOT FROM ANY VERTICAL SURFACE. LOCATE VTR MINIMUM 18" FROM PARAPET, EXPANSION JOINT, EQUIPMENT CURB, ETC. OFFSET IN CEILING SPACE WHERE REQUIRED TO MEET THESE CONDITIONS.

E1 VENT TO ROOF DETAIL

SCALE: 3" = 1'-0"

ROOF PLAN KEY NOTES: (0.0)

7.02 PROVIDE ROOF CRICKETS AT CURBS AS REQUIRED.

7.04 PROVIDE PITCH POCKETS AS REQUIRED FOR GAS AND ELECTRICAL ROOF PENETRATIONS, TYP.

23.05 NEW EXHAUST FAN ON NEW CURB - SEE MECHANICAL PLANS.

23.06 NEW RTU ON NEW CURB - SEE MECHANICAL PLANS. GC TO FIELD LOCATE AS REQUIRED FOR DROPS TO FALL BETWEEN JOISTS / BEAMS.

23.07 EXHAUST ISOLATION ARC - NO INTAKE SHALL BE INSTALLED WITHIN 10'-0" OF EXHAUST, TYP.

23.08 FLUE THROUGH ROOF.

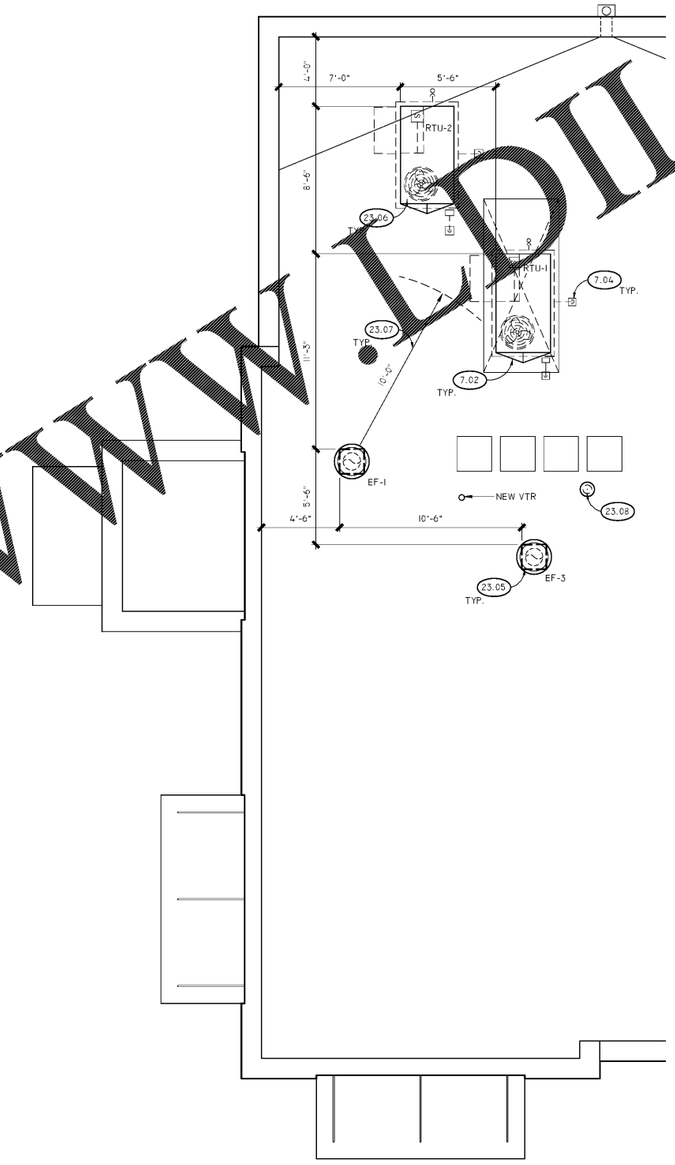

J1 ROOF PLAN

SCALE: 1/4" = 1'-0"

Order Plans @ WWW.CDLine.com

QSR|R
Quick Service Restaurant and Retail Design Group, LLC
1 Bellevue Road, Suite 3D Annapolis, MD 21409
Ph. No. (301) 364-9080

DUNKIN'

dunkin' brands.
STORE #357281
JEFFERSON DAVIS HWY
DUMFRIES, VA

REVISION		
No.	DATE	DESCRIPTION

DWG DATE:	06-29-2018
DRAWN BY:	STAFF
PROJECT No.:	17157

DWG TITLE:

ROOF PLAN

SHEET No.

A-2