LIGHTING SCHEDULE

CODE	DESCRIPTION	MANUFACTURER	PRODUCT
		INTERIOR	
C	10W INTEGRAL LED TRACK HEAD W/ 2', 4', OR 8' TRACK(S)	JUNO	R6OOL40K / 80CRI FL
LED-8	LED EXTERIOR STRIP LIGHT	SLOAN	701912 C175 (12" LONG)
P1	8' 3X3 SURFACE LED LINEAR DIR. PENDANT W/ALL ACCESS.	PINNACLE ARCHITECTURAL LIGHTING	EX33A-3500-12X12-AC48JB-120-1C35K
P2	4' 3X3 SURFACE LED LINEAR DIR. PENDANT W/ALL ACCESS.	PINNACLE ARCHITECTURAL LIGHTING	EX33A-3500-12X12-AC48JB-120-1C35K
P3	ALVA PENANDANT / CHANDELIER	TECH LIGHTING	700TD-ALVPMC-BB-LED930
R1	6" 2000LM 0-10V LED DOWNLIGHT	HALO	PD6-10-D010B/ PDM6B-835-61VCWF
R1A	6" 1000LM 0-10V LED DOWNLIGHT	HALO	PD6-10-D010B/ PDM6B-835-61VCWF (BLACK FINISH)
R2-2X2	2X2 REC. LED FLAT PANEL	LSI	EPANL 22 34L 40K
R2-2X4	2X4 REC. LED FLAT PANEL	LSI	EPANL 24 40L 40K
R4	20'X10' "L" LINEAR LED RUN OVER COUNTER	PINNACLE ARCHITECTURAL LIGHTING	EX33-A-N-35-4
OC	OPTIONAL- WALL MOUNTED OCCUPANCY SENSOR- WHITE	WS	WS-200-W
W-EBU-B	2-HEAD BATTERY PACK	EXITRONIX	LL50H (BLACK FINISH)
W-EBU-W	2-HEAD BATTERY PACK	EXITRONIX	LL50H (WHITE FINISH)
X	LED EXIT W/ BATTERY	EXITORNIX	VEX-U-BP-WH
COMBO EXIT	COMBO LED EXIT / (2) HEAD EBU	EXITORNIX	VLED-U-WH-EL90-R
		EXTERIOR	
RH	EXT. WEATHERPROOF EM REMOTE HEAD	EX	ZIP-2
LED-8	LED EXTERIOR STRIP LIGHT	SLOAN	701912 C175 (12" LONG)

LIGHTING SCHEDULE NOTES

1. PROVIDE ALL FIXTURES COMPLETE WITH LAMPS. REFER TO NATIONAL ACCOUNT SOURCE INFO FOR LAMP SPECS & VILLA LIGHTING RE-LAMPING PROGRAM. ALTERNATES FOR DRYWALL OR EMERGENCY FIXTURES CAN BE FOUND UNDER NATIONAL ACCOUNTS.
2. PROVIDE HOLD-DOWN CLIPS FOR EACH CORNER OF LED GRID TROFFERS.
3. PROVIDE ALL REQUIRED MOUNTING OR HANGING HARDWARE.
4. COORDINATE AND VARIFY ALL FIXTURE INFORMATION, TYPE AND FINAL LOCATIONS WITH THE REFLECTED CEILING PLAN.
5. LAMPS SHALL BE AS MANUFACTURED BY SYLVANIA, WESTINGHOUSE, GENERAL ELECTRIC OR APPROVED EQUAL.
6. ALL SUSPENDED FIXTURES AND SURFACE OR RECESSED FIXTURES IN SOFFIT PAINTED P-2 SHALL HAVE BLACK TRIM IN LIEU OF WHITE.

LIGHTING PLAN GENERAL NOTES

A. SEE SHEET A-3 FOR LIGHT FIXTURE SCHEDULE, MOUNTING AND FIXTURE LOCATIONS.

B. CONTRACTOR IS ADVISED THAT ADJUSTMENTS TO EMERGENCY AND EXIT LIGHT FIXTURE LOCATIONS/QUANTITIES MAY BE REQUIRED BY AHJ UPON FINAL INSPECTION.

C. ALL NIGHT LIGHT, EMERGENCY AND EXIT LIGHT FIXTURES SHALL BE CONNECTED AHEAD OF SWITCHED LIGHTING CIRCUIT.

FLOOR PLAN – LIGHTING NOTES

1. LIGHTING CONTROL RELAY PANEL (CIRCUIT B-20) AS SPECIFIED BY THE LIGHTING VENDOR. PROVIDE AND INSTALL DIGITEL SWITCH(ES) AS REQUIRED. LOCATION OF SWITCHES BY ARCHITECT OR OWNER. SEE SCHEDULE ON SHEET E-1A.
2. WALL MOUNTED OCC SENSOR EQUAL TO HUBBELL LHIRS1.
3. LIGHTING FIXTURES IN KITCHEN AND FOOD HANDLING AREAS SHALL HAVE SHATTERPROOF LENSES.
4. LIGHT FIXTURES FURNISHED BY WALK-IN BOX VENDOR. ELECTRICAL CONTRACTOR TO INSTALL AND CONNECT FIXTURES. SEE SHEET E-2.
5. EXHAUST FAN OVER RESTROOMS SHALL BE CONTROLLED ON/OFF WITH DINING ROOM LIGHTS.
6. TRACK LIGHTING SHALL BE PROVIDED WITH CURRENT LIMITING DEVICE IN THE WATTAGE AS INDICATED.
7. CIRCUIT SHALL BE CONTROLLED BY LIGHTING CONTROL RELAY PANEL. SEE SCHEDULE ON SHEET E-1A.
8. LINE VOLTAGE LOW TEMP WALK-IN FREEZER SENSOR EQUAL TO KASON 1901A. PROVIDE UNSWITCHED POWER TO SENSOR.
9. PROVIDE EMERGENCY FIXTURE WITH "REMOTE" OPTION TO POWER REMOTE HEAD. PROVIDE COMPATIBLE REMOTE HEAD WITH SAME LAMPING AS EMERGENCY FIXTURE.

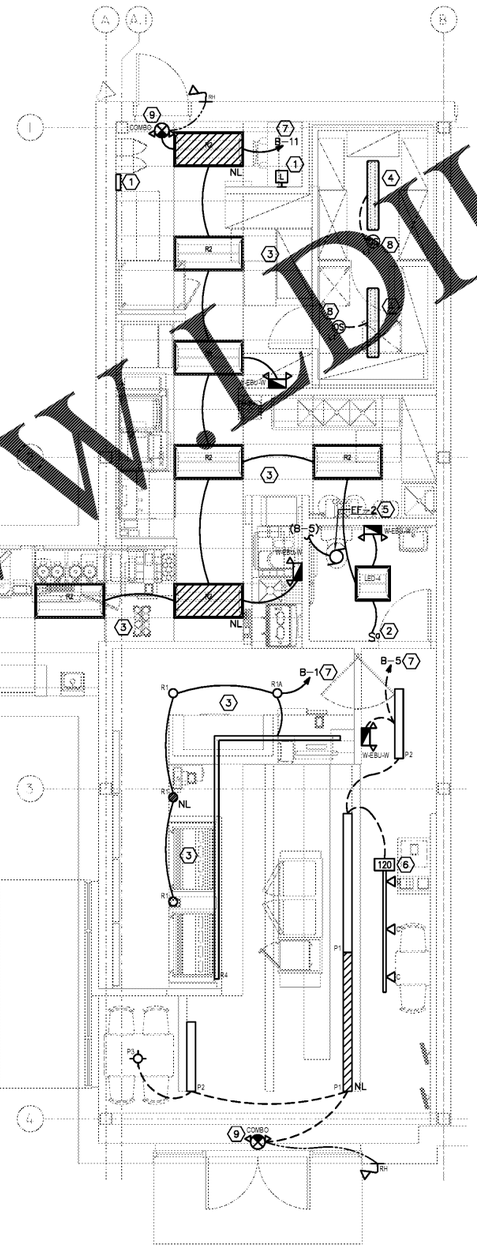

LIGHTING PLAN
SCALE: 1/4"=1'-0"

QSR
ARCHITECT OF RECORD
JAMES D. SMITH, AIA
522 BAY LN.
CENTERVILLE, MA 02632

Craig Kalhoefer, P.E.
CONSULTING ENGINEER
6928 W. LINEBAUGH AVE. • STE. 101
TAMPA, FLORIDA 33625
Telephone: (813) 287-2719
Fax: (813) 961-1585

DUNKIN'

dunkin' brands

STORE #357281
JEFFERSON DAVIS HWY
DUMFRIES, VA

REVISION		
No.	DATE	DESCRIPTION

DWG DATE:	06-29-2018
DRAWN BY:	AM
PROJECT No.:	18123

DWG TITLE:

LIGHTING PLAN

SHEET No.

E-1

Order Plans @ WWW.PDLine.com