GENERAL NOTES

1. ALL 120V, 15A AND 20A RECEPTACLES IN KITCHEN AREA SHALL BE "GFCI" PROTECTED IN ACCORDANCE WITH NEC ART. 210.8(B). PROVIDE GFI RATED BREAKER AT PANEL FOR KITCHEN EQUIPMENT.
2. SEE ARCHITECTURAL ELEVATIONS FOR PLACEMENT OF DEVICES.
3. SEE SHEET E-3 FOR POINT OF SALES POWER AND DATA WIRING.

POWER PLAN NOTES

1. PROVIDE FLUSH MOUNTED RECEPTACLE ABOVE WINDOW HEADER OR IN LAY-IN CEILING TILE. RECEPTACLE TO BE MOUNTED WITHIN 18" OF TOP OF WINDOW. IF CEILING MOUNTED, J-BOX SHALL BE SUPPORTED TO STRUCTURE ABOVE WITH THREADED ROD.
2. SEE ENLARGED OFFICE POWER PLAN ON THIS SHEET.
3. POWER POLE. SEE DETAIL ON THIS SHEET.
4. VERIFY LOCATION AND ELECTRICAL REQUIREMENTS OF WALK-IN REFRIGERATION EQUIPMENT PRIOR TO ELECTRICAL ROUGH-IN.
5. CONNECT COOLER AND FREEZER DOOR/VENT HEATER AS REQUIRED.
6. VERIFY REQUIREMENTS FOR DRAIN HEATER IN WALK-IN FREEZER.
7. MAKE FINAL CONNECTION TO LIGHT SWITCH AND LIGHT FIXTURE(S). FIXTURES AND SWITCH PROVIDED BY COOLER/FREEZER MANUFACTURER, INSTALLED BY THIS CONTRACTOR.
8. EXHAUST FAN FURNISHED AND INSTALLED BY MECHANICAL CONTRACTOR. SERVICE DISCONNECT FURNISHED WITH FAN. EXHAUST FAN SHALL BE CONTROLLED VIA HVAC CONTROL PANEL. E.C. SHALL PROVIDE ALL INTERCONNECTION WIRING REQUIRED. COORDINATE INSTALLATION AND WIRING REQUIREMENTS WITH MECHANICAL CONTRACTOR. COORDINATE EXACT LOCATION WITH MECHANICAL DRAWINGS.
9. PROVIDE J-BOX IN WALL ADJACENT TO GAS WATER HEATER FOR CONTROLS. PROVIDE LIQUID-TIGHT FLEX CONNECTION. COORDINATE EXACT LOCATION IN FIELD PRIOR TO ROUGH-IN.
10. CONNECT BOOSTER PUMP; PROVIDE GFI RECEPTACLE OR HARDWIRED CONNECTION, AS REQUIRED. IF HARDWIRED, INSTALL 20A, 1-POLE SNAP SWITCH FOR DISCONNECTING MEANS.
11. WIRE A/C POWER TO OUTLET LOCATED WITHIN PRE-INSTALLED DRIVE-THRU WINDOW.
12. MOUNT RECEPTACLE AT BULKHEAD ABOVE. SEE ARCHITECTURAL FOOD SERVICE SHEETS FOR LOCATION.
13. WIRE PRE-INSTALLED DRIVE-THRU RECEPTACLE FOR WIRELESS HEADSET TRANSMITTER AFTER WINDOW INSTALLATION. SEE ARCHITECTURAL PLANS FOR DETAIL.
14. RECEPTACLE MOUNTED AT MENU BOARD. SEE ARCHITECTURAL FOOD SERVICE SHEETS FOR LOCATION.
15. PROVIDE COMBINATION USB CHARGER/RECEPTACLE, HUBBELL #USB15X2W OR EQUAL. COORDINATE EXACT LOCATION, ORIENTATION AND MOUNTING HEIGHT WITH ARCHITECTURAL PLANS PRIOR TO ROUGH-IN.
16. COORDINATE FINAL PLACEMENT OF ALL DEVICES WITH FRANCHISEE.



ENLARGED OFFICE POWER PLAN
SCALE: 3/8"=1'-0"

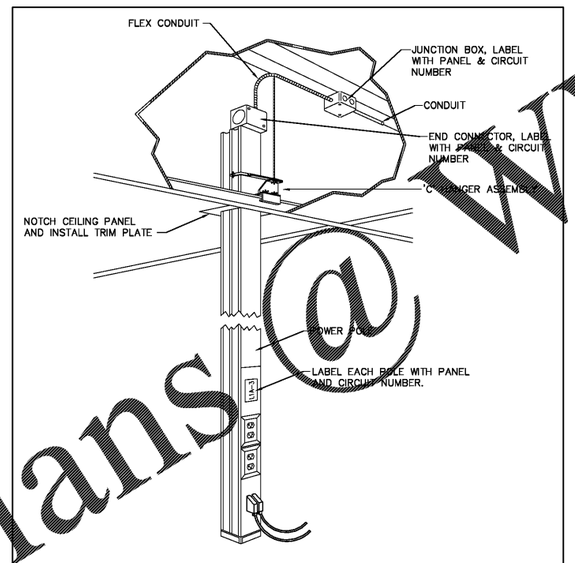

MOUNTING DETAIL FOR POWER POLE
N.T.S.

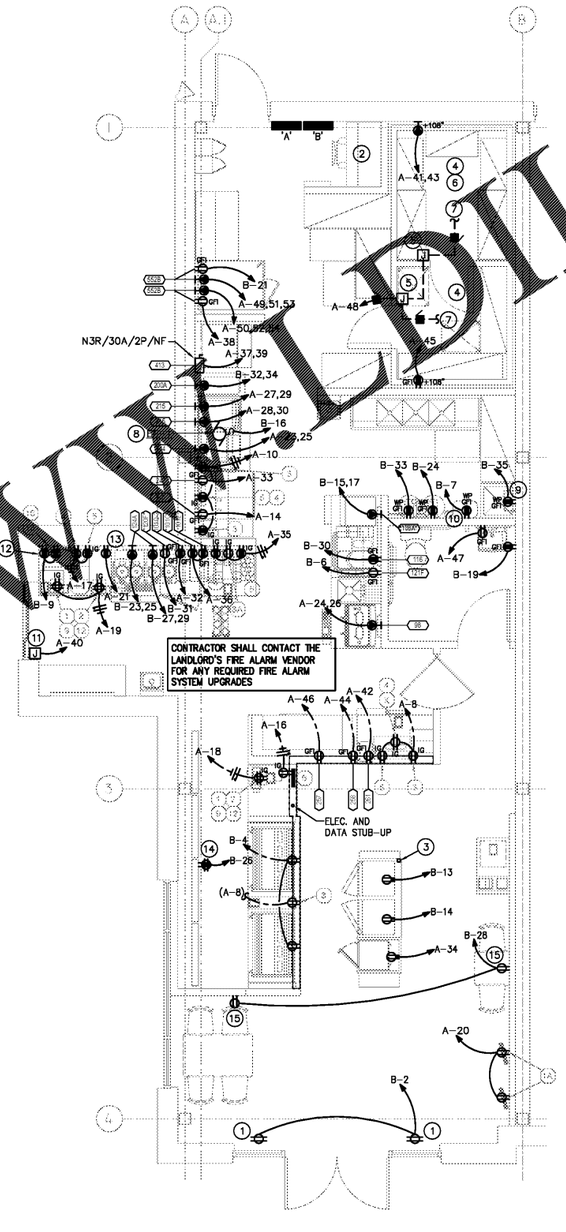

POWER PLAN
SCALE: 1/4"=1'-0"

Order Plans@WWDLine.com

QSR R
ARCHITECT OF RECORD
JAMES D. SMITH, AIA
522 BAY LN.
CENTERVILLE, MA 02632

Craig Kalhoefer, P.E.
CONSULTING ENGINEER
6928 W. LINEBAUGH AVE. • STE. 101
TAMPA, FLORIDA 33625
Telephone: (813) 287-2719
Fax: (813) 961-1585

DUNKIN'

dunkin' brands.
STORE #357281
JEFFERSON DAVIS HWY
DUMFRIES, VA

REVISION		
No.	DATE	DESCRIPTION
DWG DATE:	06-29-2018	
DRAWN BY:	AM	
PROJECT No.:	18123	

DWG TITLE:
POWER PLAN

SHEET No.
E-2