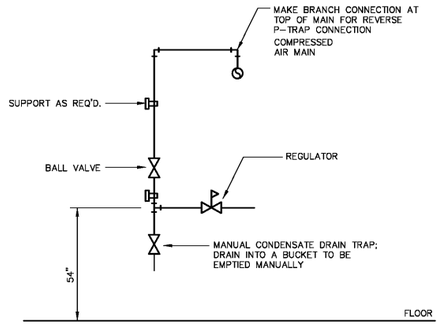

1 AIR AT BAG-IN-BOX
SCALE: NONE

ROOF PIPE SUPPORT SCHEDULE	
PIPE SIZE	MAXIMUM SPACING
1"	6'-0"
1 1/4"	6'-0"
1 1/2"	6'-0"
2"	6'-0"
2 1/2"	8'-0"
3"	8'-0"
4"	8'-0"

NOTES:
1. SUPPORTED PIPE AT ALL ELBOWS AND AT SPACING SPECIFIED.
2. PIPE SUPPORT BLOCK SHALL BE A MINIMUM OF ONE PIPE SIZE LARGER THAN PIPE
3. DO NOT ATTACH PIPESTANDS TO ROOF

MIRO INDUSTRIES, INC.
170 WEST COTTAGE AVE
SANDY, UTAH 84070
(801) 566-3680

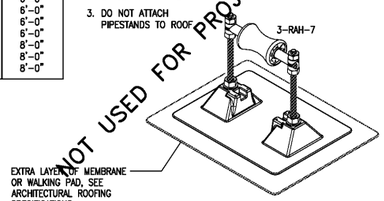

2 SUPPORT FOR ROOF MOUNTED PIPE
SCALE: NONE

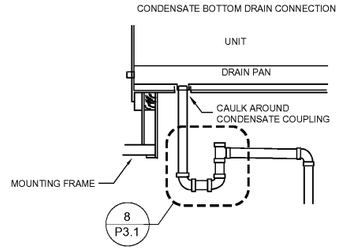

3 CONDENSATE CONNECTION @ RTU
SCALE: NONE

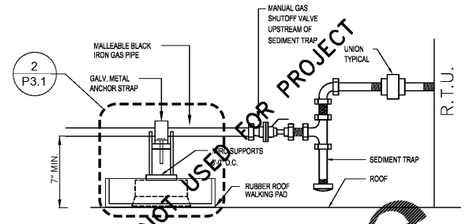

4 GAS CONNECTION @ RTU
SCALE: NONE

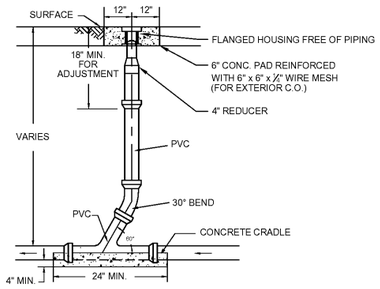

SECTION VIEW

NOTES:
1. COVER SHALL HAVE A LOCKING LID MARKED "SEWER".
2. DESIGN BASIS IS JAY R. SMITH MODEL 4250; REFER TO SPECIFICATION 15423

LOCATE CLEAN OUTS OUT OF TRAFFIC PATTERNS.

5 SANITARY SEWER CLEANOUT
SCALE: NONE

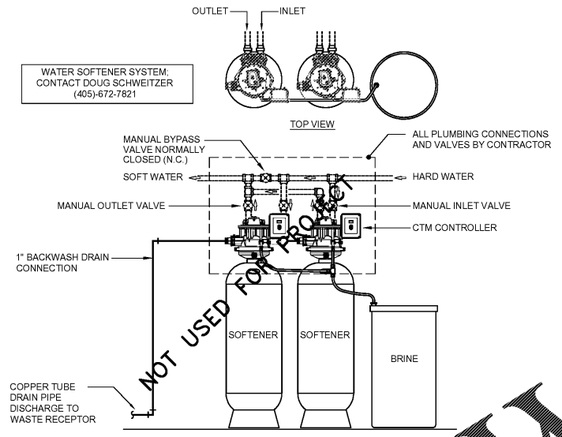

6 TYPICAL SOFTENER SCHEMATIC
SCALE: NONE

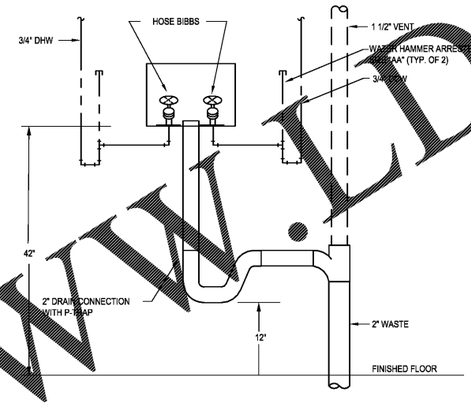

7 DETAIL OF WASHER UTILITY BOX
SCALE: NONE

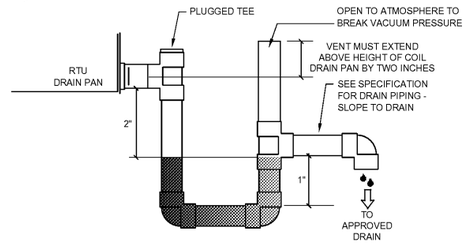

CONDENSATE DRAIN PIPE SIZE = UNIT DRAIN CONNECTION SIZE

DRAW-THROUGH UNIT

8 CONDENSTE DRAIN TRAP
SCALE: NONE

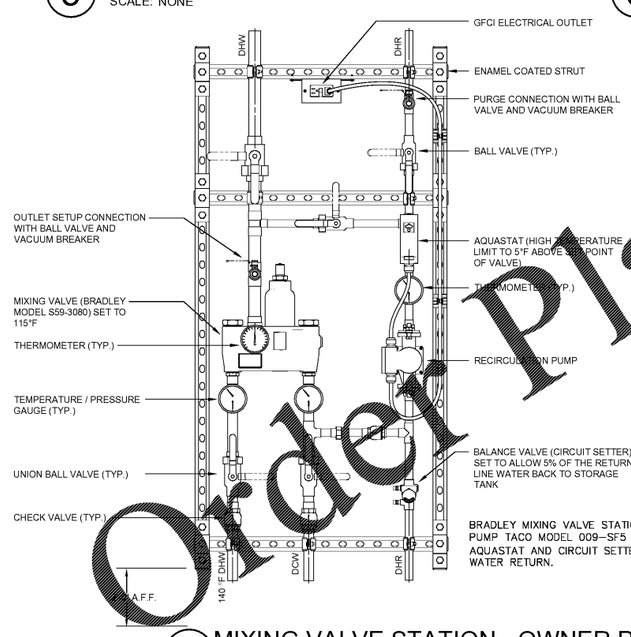

BRADLEY MIXING VALVE STATION NRS-8 WITH PUMP TACO MODEL 009-SF5 (120v, 1/8 HP), AQUASTAT AND CIRCUIT SETTER WITH ¾" HOT WATER RETURN.

9 MIXING VALVE STATION - OWNER PROVIDED
SCALE: NONE

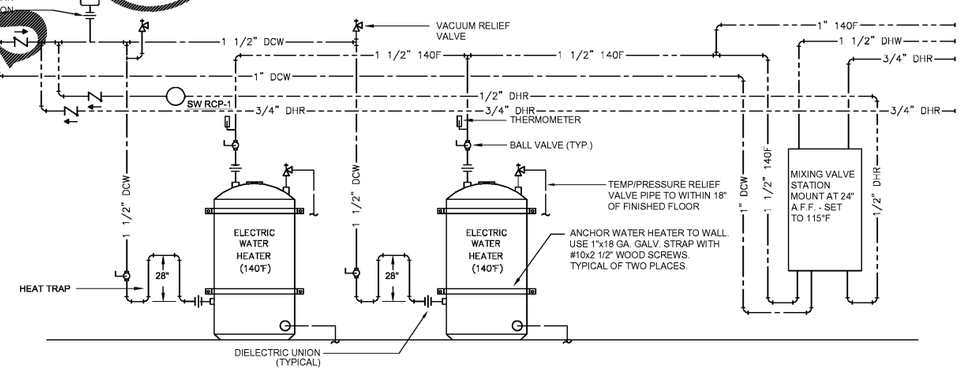

NOTE: WATER HEATERS MUST BE PIPED IN REVERSE RETURN MANNER FOR EQUAL FLOW THROUGH THE HEATERS.

ELECTRIC STORAGE

10 PARALLEL WATER HEATERS SCHEMATIC
SCALE: NONE

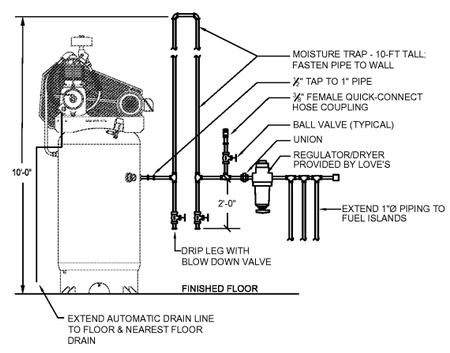

11 AIR COMPRESOR PIPING
SCALE: NONE

Order Plans @ WWW.LDILine.com
NOT USED FOR PROJECT

Pascal Aughtry & Associates,PC
405.463.3494
Fax: 405.463.3493
927 East Britton Road
Oklahoma City, OK 73114
pascalarch.com

A NEW TRAVEL STOP
STORE NO. 735
CALHOUN, GA

Love's Travel Stops

Revisions:	
No.	Date

Project No.: LVS - 18735
Date: 05-22-18
Sheet No.:
P3.1
OF: