


ELECTRICAL GENERAL NOTES

- EMERGENCY BATTERY LIGHTING UNITS AND EXIT SIGNS SHALL BE CONNECTED TO THE UN-SWITCHED HOT LEG OF THE BRANCH CIRCUIT.
- FIXTURES SHOWN HATCHED ARE THE 'E' TYPE OF THE FIXTURE AND HAVE AN EMERGENCY BATTERY. CONNECT TO AN UNSWITCHED HOT CONDUCTOR.

(X) ELECTRICAL KEYED NOTES:

- BACKLITE FASCIA LIGHT BOXES WILL BE ERRECTED BY OWNER, IN 60' LONG SECTIONS, (4) 15' SECTIONS AT A TIME. FASCIAS ARE ALWAYS LAID OUT STARTING FROM THE LEFT TO THE RIGHT. THE ELECTRICAL CONNECTION POINT ALWAYS THE TOP CENTER OF THE LEFT BOX. INSTALL J-BOX ON INSIDE OF EXTERIOR WALL AND CONNECT CABLE THROUGH WALL TO BOX. CABLES CONTINUE INSIDE THE REMAINING LIGHT BOXES TO EACH FEED POINT SHOWN.
- ELECTRICAL CONTRACTOR SHALL COMPLETE THE "SYSTEM 90 INSTALLATION SUMMARY" LOCATED IN DIVISION 10 OF THE SPECIFICATIONS BOOKLETS AND MAKE TO:

MR. PAUL MAYFIELD
SHARPLINE CONVERTING
1520 S. TYLER RD.
WICHITA, KS 67277
1-800-888-4888
- SPEAKERS BY OWNER.
- AIM EMERGENCY EXIT LIGHT HEADS TOWARDS EXIT DISCHARGE AREAS.
- SEE ARCH. ELEVATIONS FOR MOUNTING HEIGHTS OF SIGNS.
- OWNER PROVIDE FOR OCCUPANCY SENSORS. LOCATE ABOVE ACCESSIBLE CEILING. CIRCUIT OVERRIDE SWITCH IF SHOWN PER MANUFACTURER'S INSTRUCTIONS.
- NO "HOT" USE.
- SET THE OCCUPANCY SENSOR SWITCH TO BE AUTO ON / AUTO OFF.
- PROVIDE CONNECTION TO INTERNALLY LIT MIRRORS. SEE ARCHITECTURAL ELEVATIONS FOR ROUGH-IN LOCATIONS. COORDINATE WITH EQUIPMENT SUPPLIER.
- MOUNT J-BOX FOR SIGNS AT 10'-8" AFF AND CENTERED IN VAULTED AREA.



Pascal Aughtry & Associates, PC

405.463.3434
Fax: 405.463.3493

937 East Britton Road
Oklahoma City, OK 73114
pasc@arch.com



A NEW TRAVEL STOP
STORE NO. 735
CALHOUN, GA




Revisions:

No.	Date

Project No.: LVS - 18735
Date: 05-22-18
Sheet No.:

E-2.1

OF:

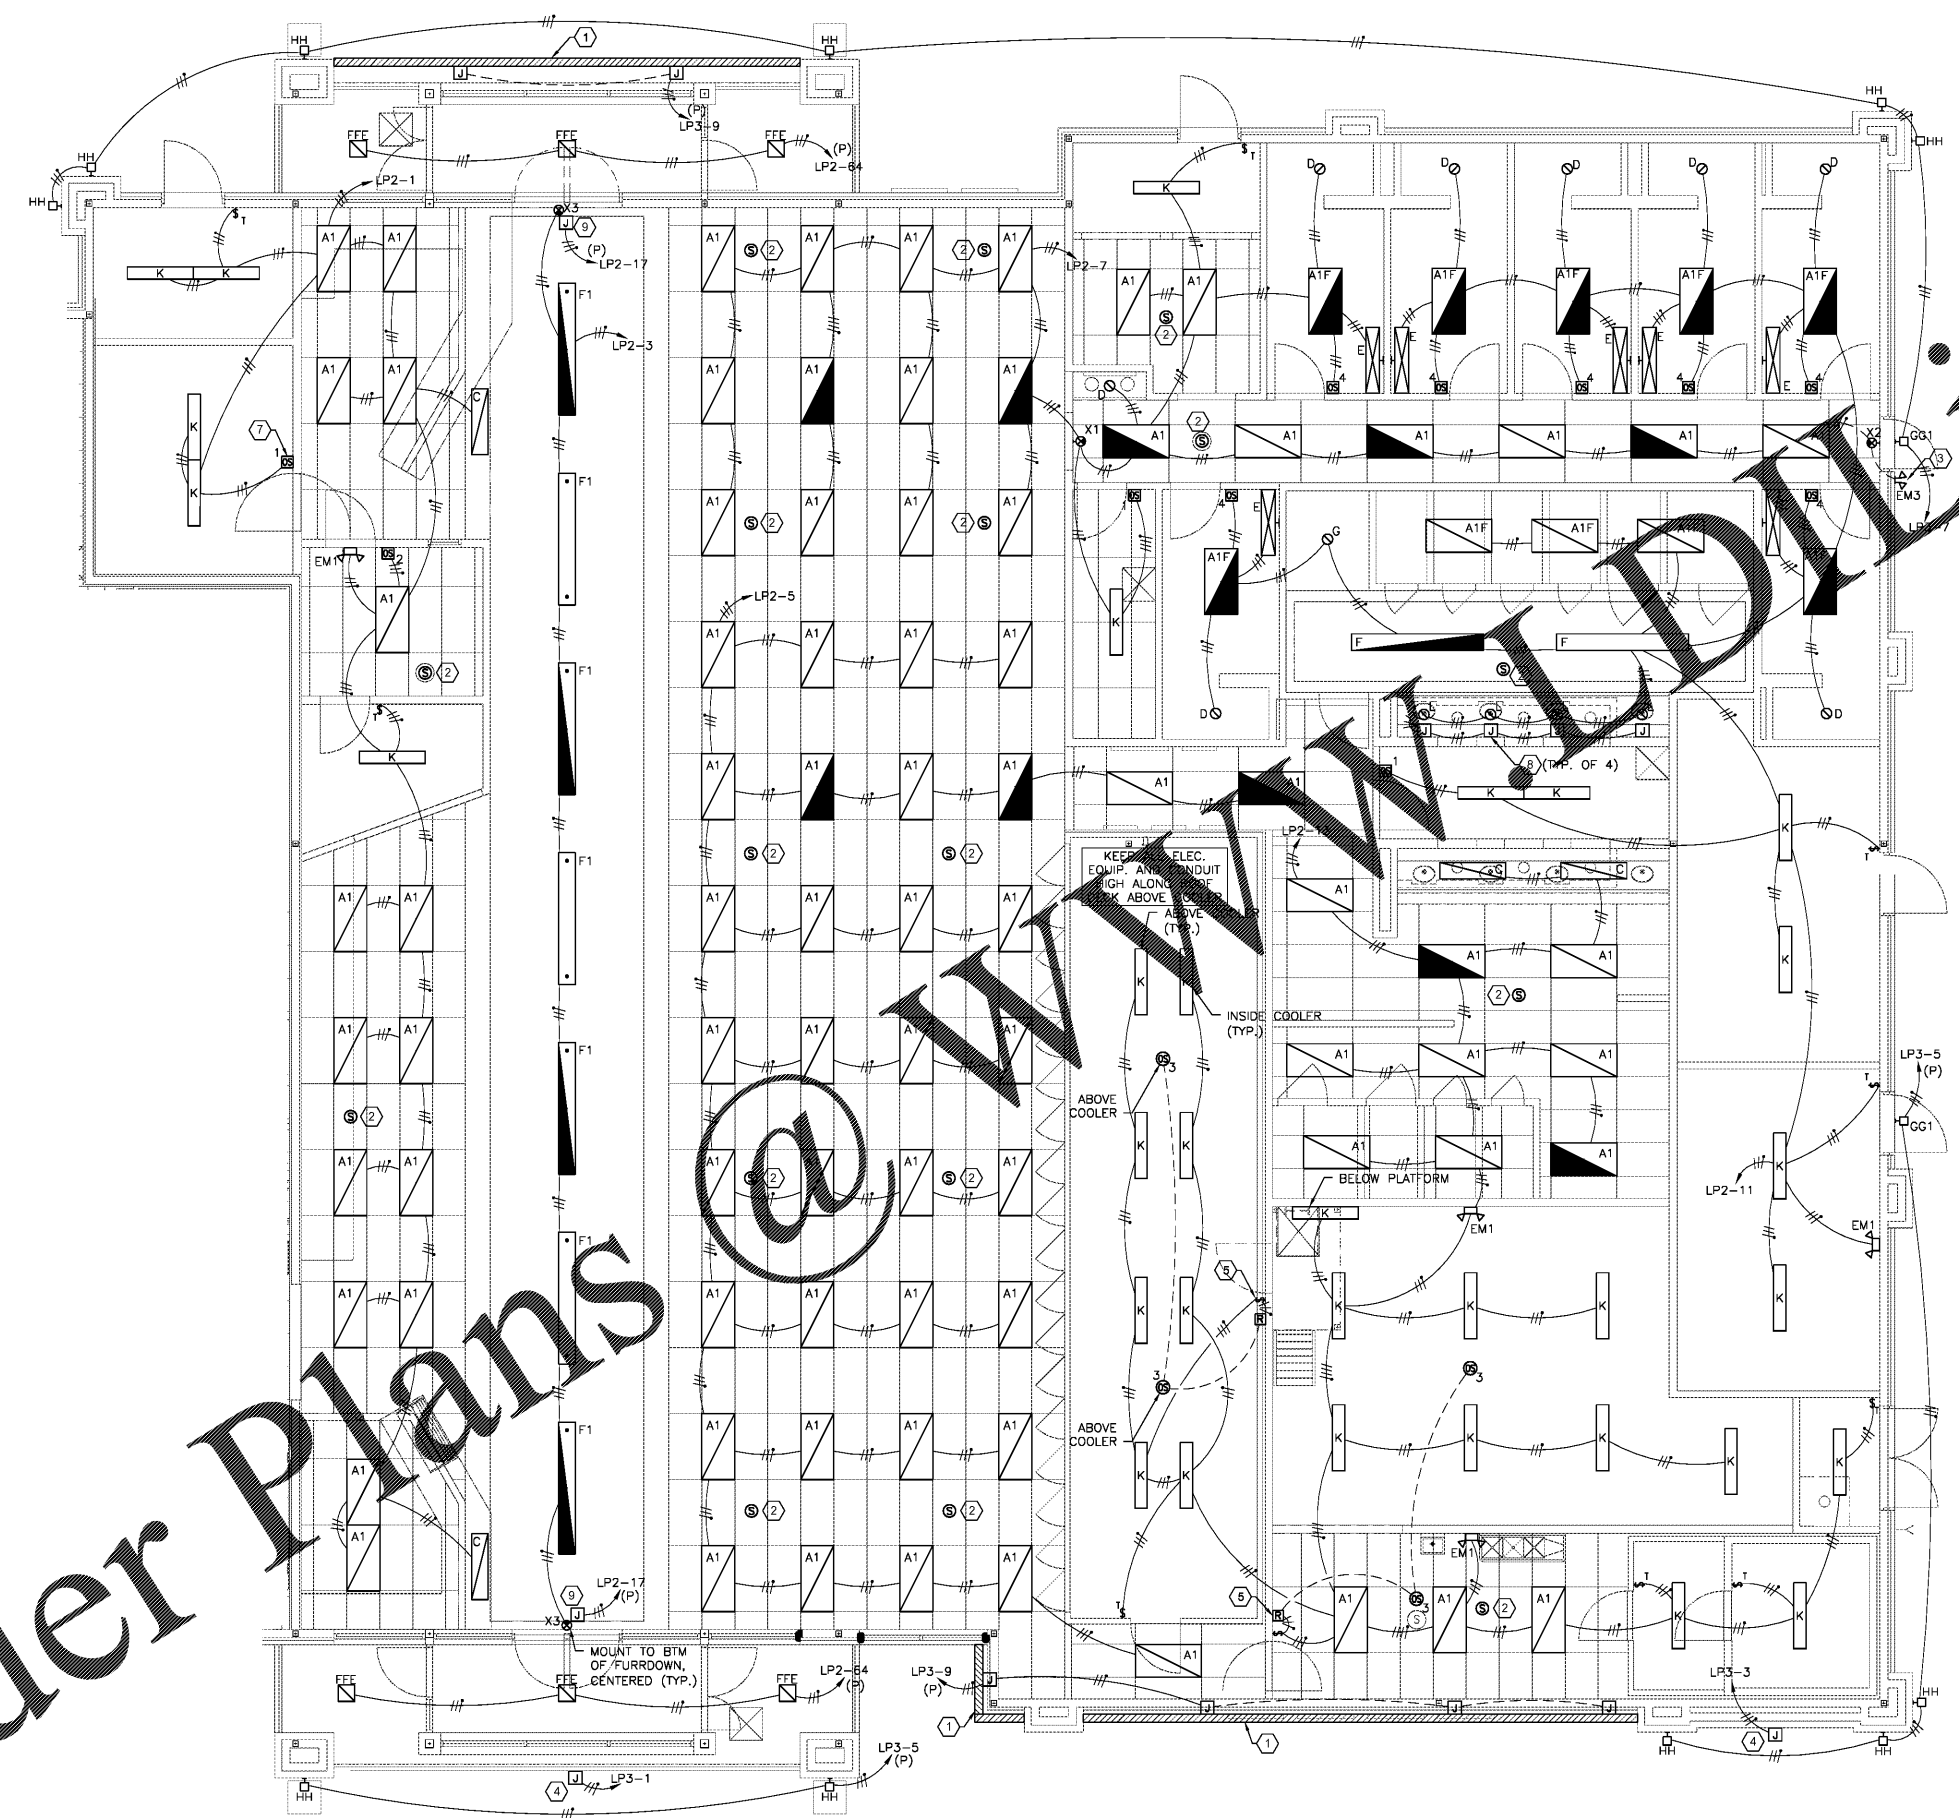

1 FLOOR PLAN - LIGHTING
3/16" = 1'-0"

Order Plans

www.dline.com