

Pascal Aughtry & Associates, PC
 405.463.3434
 Fax: 405.463.3493
 937 East Burton Road
 Oklahoma City, OK 73114
 pascaarch.com



A NEW TRAVEL STOP
 STORE NO. 735
 CALHOUN, GA



Revisions:	
No.	Date


Project No.: LVS - 18735
 Date: 05-22-18
 Sheet No.:

E-5.1

OF:

Order Plans

WWW.DIYLine.com

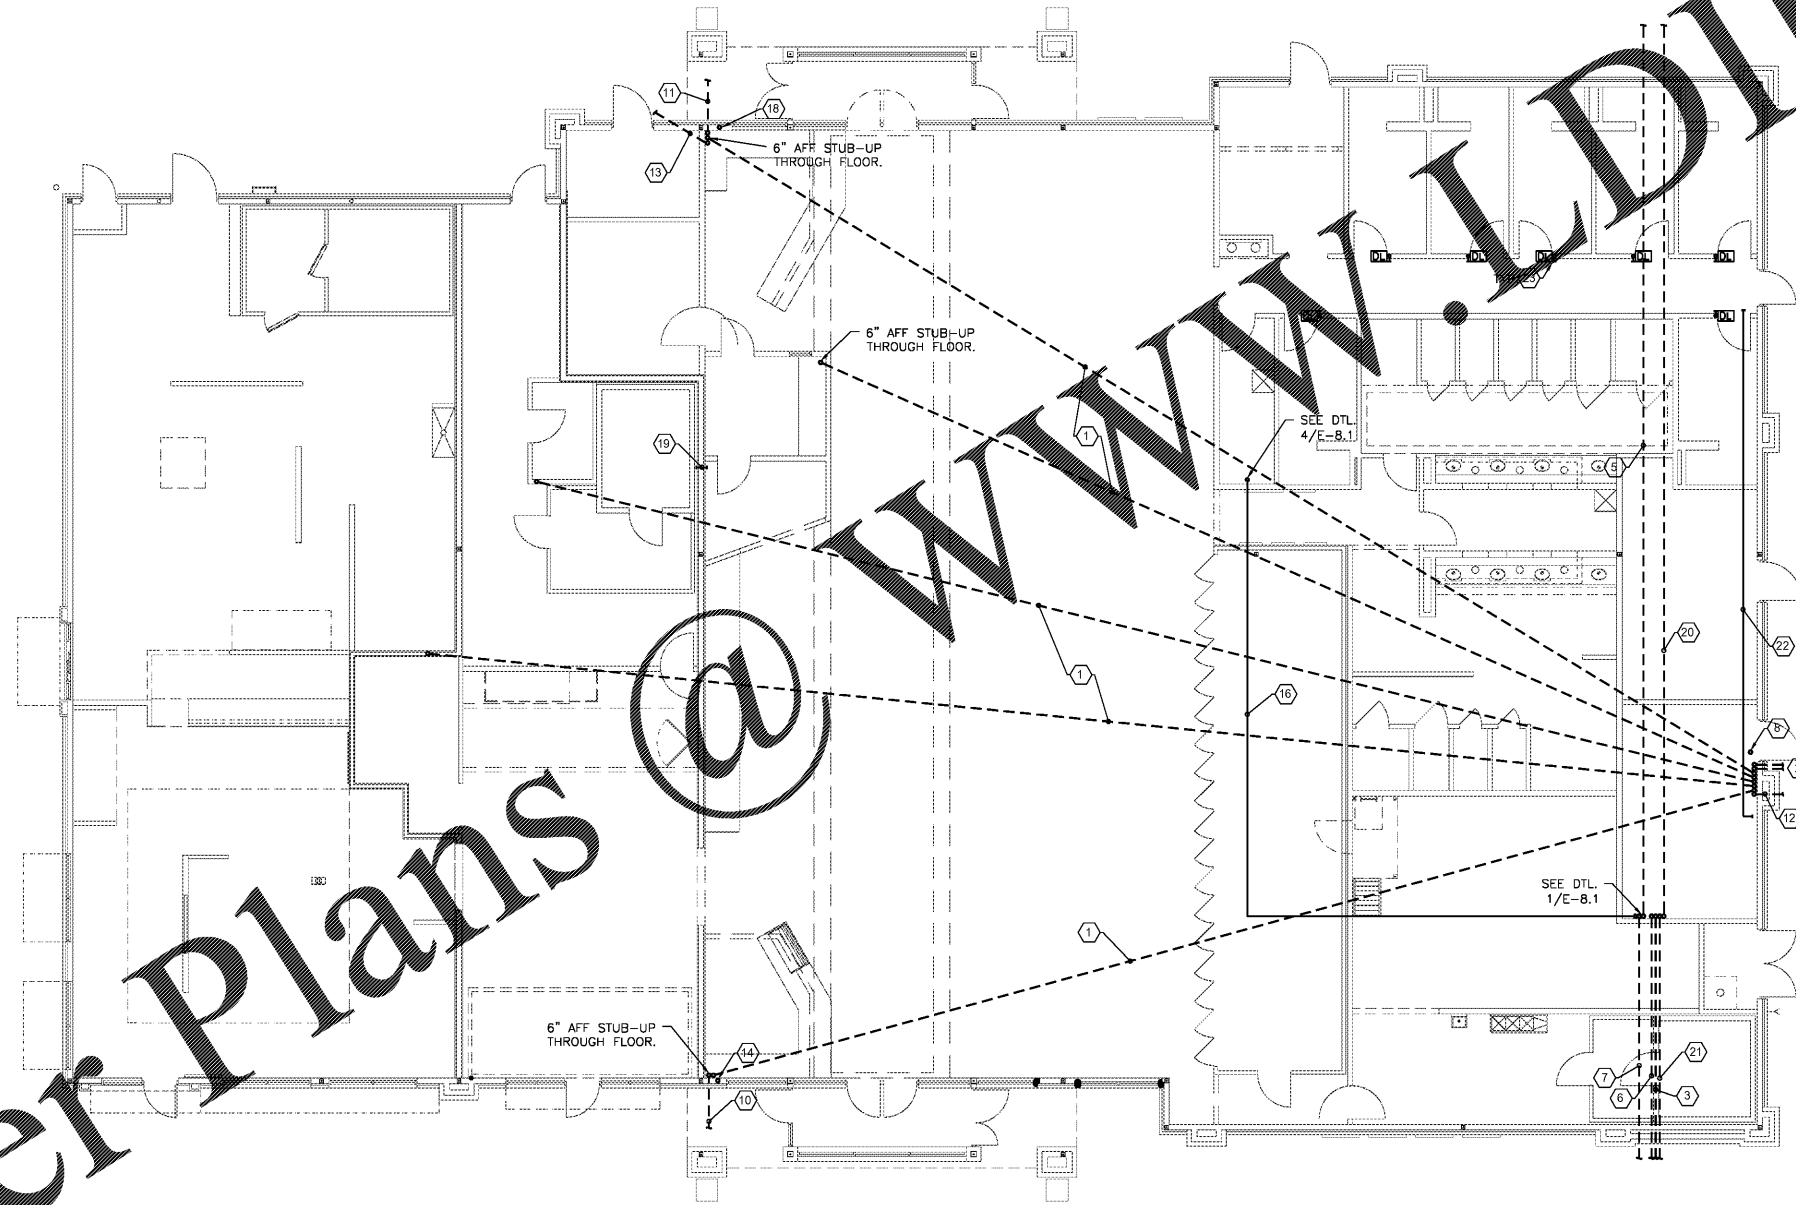

CONDUIT PLAN GENERAL NOTES

- * * COORDINATE CONDUIT QUANTITY WITH FUEL CONTRACTOR.
- RESPONSIBILITY OF E.C. AND FUEL CONTRACTOR:
 E.C. SHALL FURNISH AND INSTALL CONDUITS SHOWN FROM PANELS AND FUEL POWER CENTER (P-1) TO EXTERIOR OF BUILDING AS INDICATED. FUEL CONTRACTOR SHALL EXTEND ALL IN-GROUND CONDUITS AND TERMINATE FROM THAT POINT TO ALL ISLANDS. FUEL CONTRACTOR SHALL HOOK UP ALL ITEMS EXCEPT HORN AND INTERCOM. G.C. SHALL FURNISH ALL SEALOFFS, WIREWAYS, & BREAKERS INSIDE BUILDING INCLUDING FUEL SYSTEM ITEMS. G.C. SHALL HOOK UP ALL WIRING AT PANEL. COORDINATE FUEL SYSTEM ITEMS.

CONDUIT PLAN KEYED NOTES:

- 3" DIAMETER EMPTY PVC CONDUITS UNDER SLAB W/ LONG SWEEPS EACH END. STUB UP 12" ABOVE SLAB UNLESS NOTED OTHERWISE. SEE SHEET FSE-3.1 FOR ADDITIONAL INFO AT THE RESTAURANT END.
- INCOMING TELEPHONE SERVICE. SEE SHEET E-1.1 FOR CONTINUATION. PROVIDE A #6 GROUND WIRE FROM SERVICE GROUND POINT FOR TELEPHONE EQUIPMENT GROUND.
- E.C. SHALL STUB OUT CONDUITS 10'-0" FROM BUILDING FOR GAS & DIESEL U.S.T LIQUID SENSORS AND LEVEL PROBES. PROVIDE SEAL-OFFS IN BUILDING. EXTENSION OF THESE CONDUITS BY FUEL CONTRACTOR. SEE ELEVATION 1/E-8.1. (COORDINATE WITH FUEL DRAWINGS SHEET FE-3).
- NOTE NOT USED
- E.C. SHALL STUB OUT CONDUITS 10'-0" FROM BUILDING TO TRUCK CANOPY FOR LIQUID SENSORS AND LEVEL PROBES. PROVIDE SEAL-OFFS IN BUILDING. EXTENSION OF THESE CONDUITS BY FUEL CONTRACTOR. (COORDINATE WITH FUEL DRAWINGS SHEET FE-4).
- E.C. SHALL STUB OUT CONDUITS 10'-0" FROM BUILDING TO CAR CANOPY FOR LIQUID SENSORS AND LEVEL PROBES. PROVIDE SEAL-OFFS IN BUILDING. EXTENSION OF THESE CONDUITS BY FUEL CONTRACTOR. (COORDINATE WITH FUEL DRAWINGS SHEET FE-2).
- EXTEND (1) 3/4" CONDUIT FROM THIS LOCATION TO THE OIL WATER SEPARATOR ON SITE FOR ALARM WIRING. SEE SHEET E-1.1.
- 2" CONDUIT SLEEVE THROUGH ROOF FOR SATELLITE CABLES. SEE ARCH. DETAILS.
- NOTE NOT USED
- E.C. SHALL INSTALL (2) 1" CONDUITS TO CAR FUEL ISLANDS FOR INTERCOM AND HORNS. STUB OUT OF WALL 24" AFF AT CASHIER'S AREA. WIRING BY OWNER. PROVIDE SEAL OFFS ON ALL CONDUITS.
- E.C. SHALL INSTALL (2) 1" CONDUITS TO TRUCK FUEL ISLANDS FOR INTERCOM AND HORNS. STUB OUT OF WALL 24" AFF AT CASHIER'S AREA. WIRING BY OWNER. PROVIDE SEAL OFFS ON ALL CONDUITS.
- PROVIDE AND INSTALL 2-2" CONDUITS FROM TELEPHONE EQUIPMENT AREA TO TRUCK CANOPY COLUMN CLOSEST TO THE BUILDING. CONNECT TO 2-2" CONDUITS (FURNISHED WITH CANOPY) AT THAT LOCATION (FOR SECURITY CAMERAS). PROVIDE SEAL-OFFS ON ALL CONDUITS.
- STUB UP (2) 1/2" CONDUITS FROM TRUCK SCALES TO THIS LOCATION ON FLOOR PLAN (IF APPLICABLE). RE: E-1.1 FOR SCALE LOCATION.
- INSTALL 2" EMPTY CONDUIT TO ATTIC SPACE. TERMINATE CONDUIT IN A 6" X 8" X 4" BOX IN DEAD CORNER OF MILLWORK AT 26" AFF.
- NOTE NOT USED
- ROUTE A 2" CONDUIT FROM THE INTRINSIC GUTTER TO JANITOR CLOSET ABOVE CEILING PER DETAILS 1 & 4 ON SHEET E-8.1.
- NOTE NOT USED
- INSTALL 3" EMPTY CONDUIT TO ATTIC SPACE. TERMINATE CONDUIT IN A 8" X 8" X 4" BOX IN DEAD CORNER OF MILLWORK AT 26" ABOVE SLAB.
- 3" CONDUIT SLEEVE ABOVE CEILING FOR DATA CABLING. INSTALL TO MAINTAIN FIRE RATING OF WALL.
- E.C. SHALL STUB OUT CONDUITS 10'-0" FROM BUILDING TO TRUCK CANOPY FOR FUTURE DATA USE. PROVIDE SEAL-OFFS IN BUILDING AND PULLSTRINGS. EXTENSION OF THESE CONDUITS BY FUEL CONTRACTOR. (COORDINATE WITH FUEL DRAWINGS SHEET FE-4).
- E.C. SHALL STUB OUT CONDUITS 10'-0" FROM BUILDING TO CAR CANOPY FOR FUTURE DATA USE. PROVIDE SEAL-OFFS IN BUILDING AND PULLSTRINGS. EXTENSION OF THESE CONDUITS BY FUEL CONTRACTOR. (COORDINATE WITH FUEL DRAWINGS SHEET FE-2).
- 3" CONDUIT W/ PULLSTRING ABOVE CEILING FOR SECURITY SYSTEM CABLES. ROUTE TO VICINITY OF IT RACK.
- PROVIDE 3/4" CONDUIT W/ PULLSTRING AND STUB OUT ABOVE CORRIDOR CEILING FOR SECURITY CABLES. CABLES AND ALL FINAL CONNECTIONS PROVIDED BY OWNER.

2 FLOOR PLAN - SYSTEMS CONDUITS
 1/8" = 1'-0"
 North