

Pascal Aughtry & Associates, PC

405.463.3494
Fax: 405.463.3493
937 East Brison Road
Oklahoma City, OK 73114
pascalarch.com



May 24 2018 10:17 AM Drawn: [Signature]

Love's
Travel Stops
A NEW TRAVEL STOP
STORE NO. 735
CALHOUN, GA



Revisions:	
No.	Date

Project No.: LVS - 18735
Date: 05-22-18
Sheet No.:

BKP1.1


OF:

PLUMBING GENERAL NOTES:

- ALL PLUMBING WORK SHALL BE PERFORMED IN STRICT ACCORDANCE WITH THE BASE BUILDING SPECIFICATION AND WITH THE LATEST EDITION OF THE PREVAILING STATE MECHANICAL/PLUMBING AND BUILDING CODES AS WELL AS ALL REGULATIONS THAT MAY APPLY. IN CASE OF CONFLICT BETWEEN THE CONTRACT DOCUMENTS AND A GOVERNING CODE OR ORDINANCE THE MOST STRINGENT STANDARD SHALL APPLY.
- INSTALL ALL REQUIRED CLEANOUTS TO CLEAR EQUIPMENT AND FIXTURES.
- SANITARY AND VENT PIPING SHALL BE SCHEDULE 40 PVC WITH INSTALLATION IN ACCORDANCE WITH ASTM D-232.1. ALL FITTINGS SHALL BE APPROVED SANITARY TYPE.
- ALL FIXTURES ARE PROVIDED WITH STANDARD TRAP AND CLEANOUT (NOT SHOWN).
- ALL WORK SHALL BE PROPERLY TESTED, BALANCED, CLEANED AND DISINFECTED. PROVIDE A ONE YEAR WARRANTY FROM DATE OF FINAL INSPECTION ON ALL PARTS AND LABOR.
- ALL WASTE PIPING SMALLER THAN 3" SHALL BE SLOPED @ 1/4" PER FT; PIPING LARGER THAN 3" SHALL BE SLOPED @ 1/8" PER FT.
- REFER TO PLUMBING FIXTURE SCHEDULE ON SHEET BKP4.1 FOR FIXTURE SPECIFICATIONS.
- UNDERGROUND PLUMBING IS SHOWN SCHEMATICALLY FOR VIEWING PURPOSES ONLY; DURING INSTALLATION FIELD MODIFICATIONS TO ROUTING MAY BE REQUIRED.
- TERMINATE PLUMBING VENTS AT A MINIMUM OF 10' FROM ALL AIR HANDLING EQUIPMENT INTAKE VENTS.
- CONDENSATE PIPING SHALL BE TYPE "L" HARD DRAWN SEAMLESS COPPER TUBE.
- PROVIDE ASSE 1072 BARRIER-TYPE TRAP SEAL PROTECTION FOR ALL FLOOR DRAINS AND FLOOR SINKS EQUIVALENT TO SURE SEAL.
- ALL VENT TERMINATIONS MUST BE A MINIMUM OF 3" IN DIAMETER AND BE A MINIMUM OF 12" ABOVE THE ROOF.
- REFER TO ARCHITECTURAL SHEETS FOR SECONDARY ROOF DRAINAGE VIA SCUPPERS.
- ALL HORIZONTAL ROOF DRAINAGE PIPING SHALL BE SLOPED @ 1/2" PER FT MINIMUM.

(X) SHEET KEYNOTES

- ROUTE 1-INCH, INSULATED COPPER TUBING FOR COOLER / FREEZER CONDENSATE TO FLOOR DRAIN; PROVIDE AND INSTALL HEAT-TAPE ON CONDENSATE LINES EXPOSED IN FREEZER AREA - RAY CHEM H611050 (6W / FT, 120 VOLT). COORDINATE WITH ELECTRICAL CONTRACTOR FOR POWER.
- SODA SYRUP BUNDLE SHALL BE INSTALLED OVERHEAD FROM THE BAG-IN-BOX STATION TO LOCATION SHOWN AND ROUTED DOWN IN WALL FRAMING. SODA VENDOR SHALL PROVIDE ALL TEES NECESSARY FOR FINAL CONNECTIONS TO SODA DISPENSERS.
- ROUTE IDW FROM VEGETABLE SINK TO 3" FS-2 WITH AIR GAP.
- ROUTE IDW FROM POT SINK TO 3" FS-2 WITH AIR GAP.
- SEAL WALL PENETRATIONS AIR TIGHT AND STRAP PIPING DOWN TO FLOOR; REFER TO DETAIL 7/BKP3.1.
- RUN DRAIN LINES FROM DRINK DISPENSER, COUNTER DRAIN, ICE MACHINE, AND ICE BINS UNDER COUNTER TO FUNNELED TYPE RECEPTOR.
- ROUTE 1" INDIRECT WASTE FROM THE ICE MACHINE TO FS-2 WITH AIR GAP.

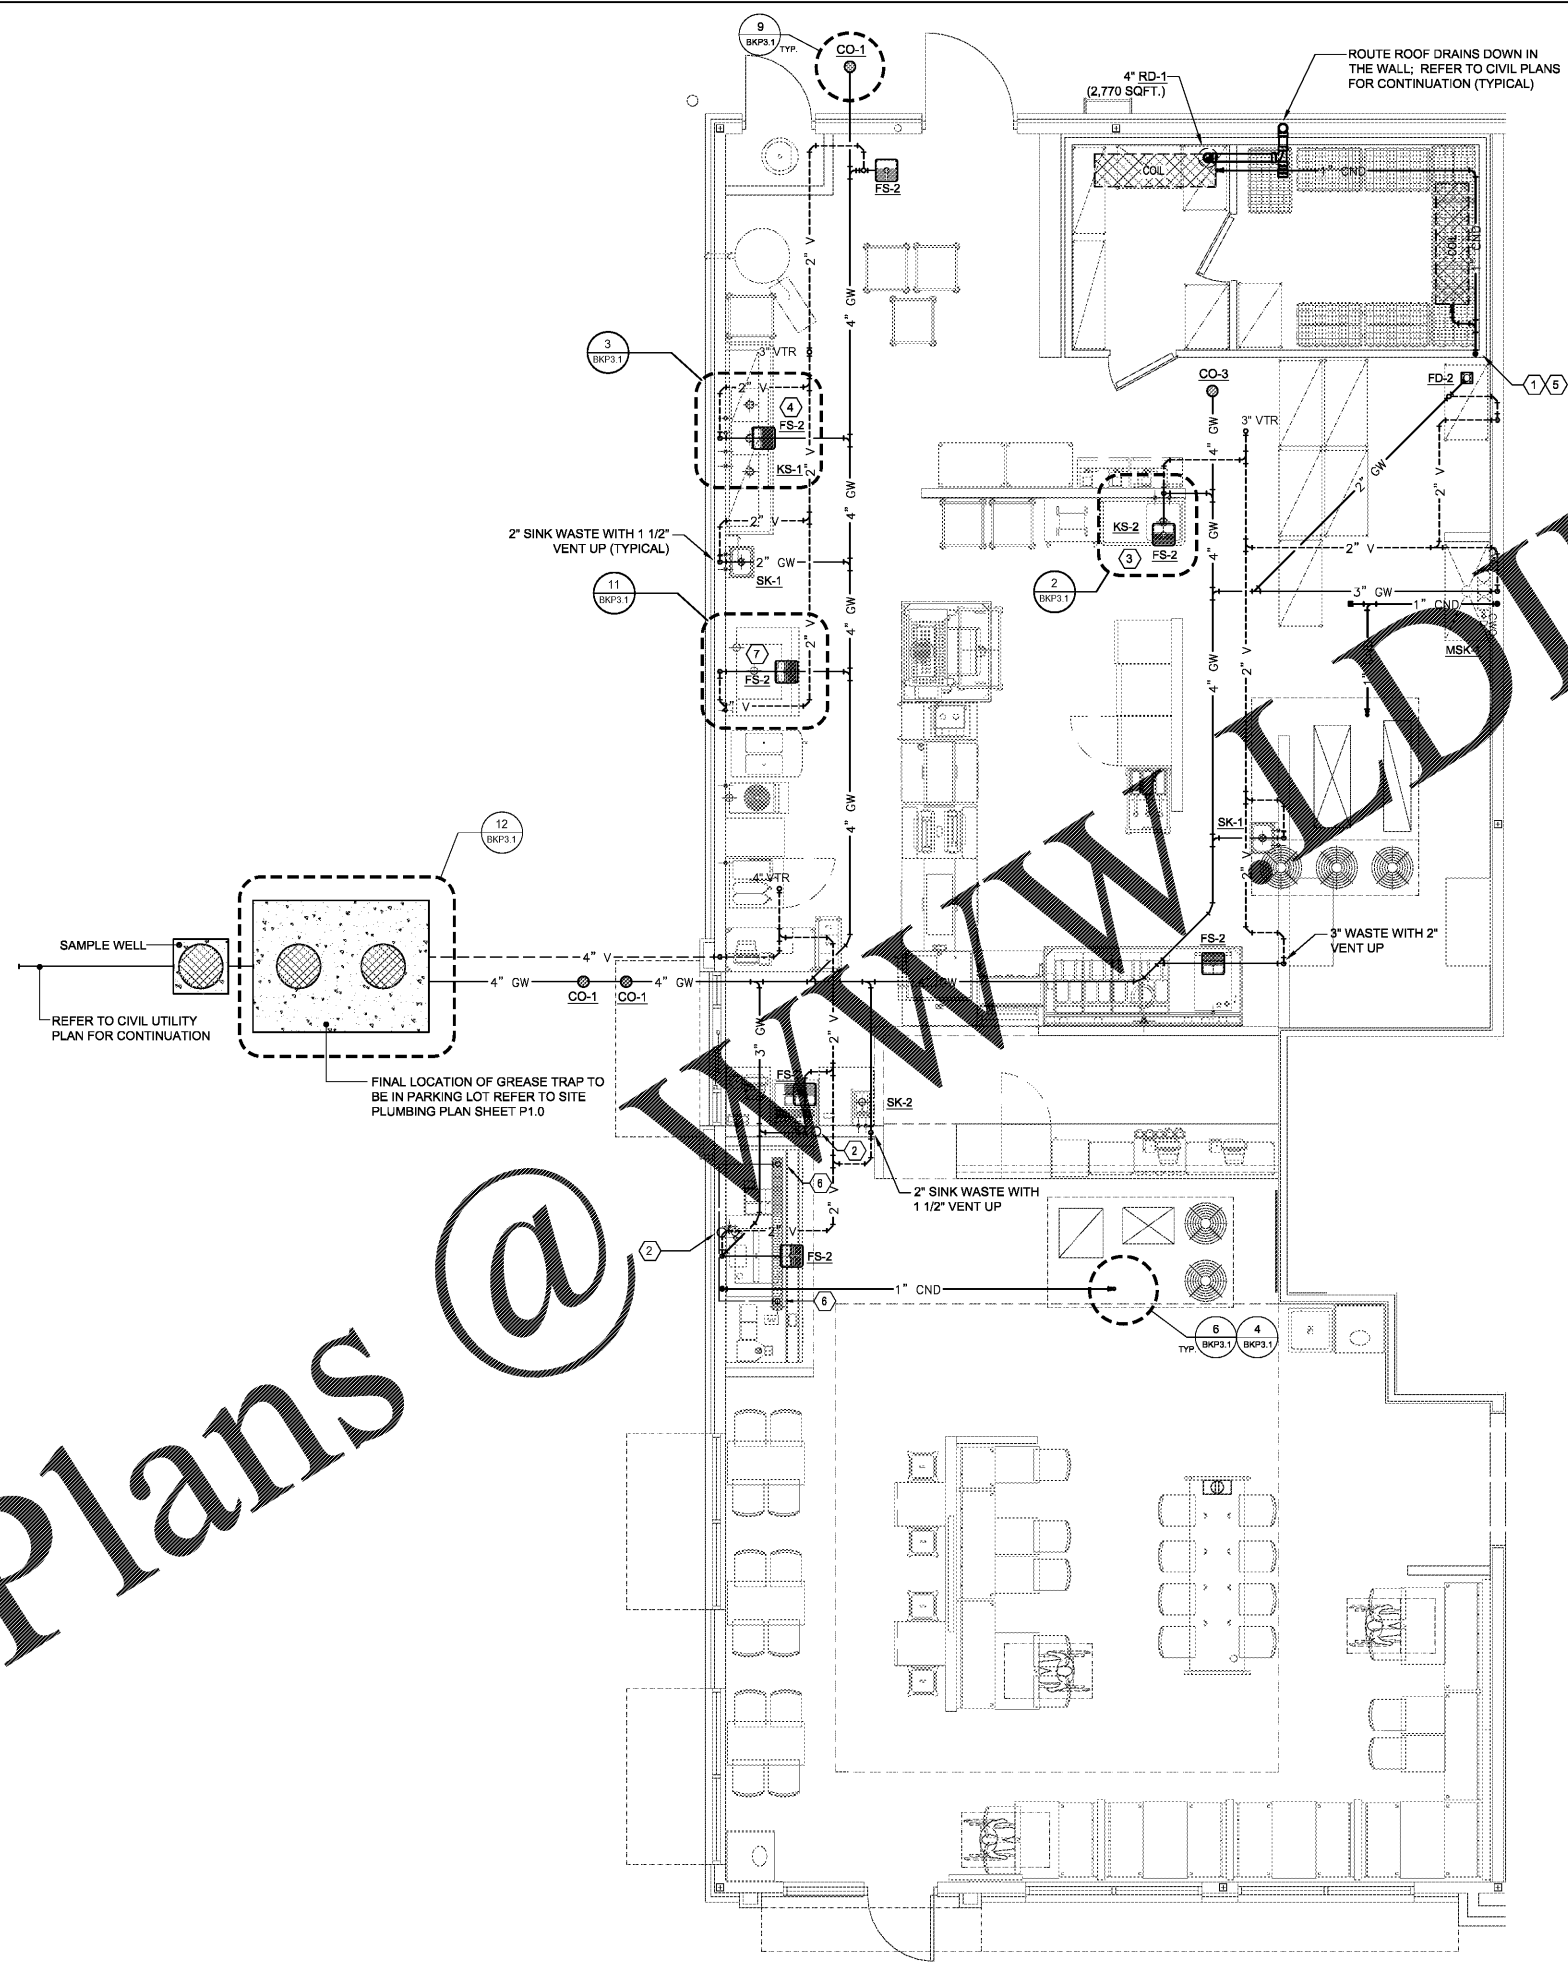

1 WASTE & VENT FLOOR PLAN
SCALE: 1/4" = 1'-0"



Order Plans @