

LIFE SAFETY PLAN NOTES

- G1. REFERENCE PROJECT MANUAL FOR GENERAL NOTES, RESPONSIBILITIES, AND PROCEDURES. EXECUTION OF CONSTRUCTION CONTRACT OR PERFORMING WORK ACCEPTS THE CONDITIONS AND PROVISIONS DOCUMENTED WITHIN PROJECT MANUAL AND CONSIDERS THE FOLLOWING NOTATION SUPPLEMENTAL TO THOSE CONDITIONS.
- G2. BRACE PARTITIONS TO STRUCTURE IN ACCORDANCE WITH APPLICABLE BUILDING CODE(S). COORDINATE WITH LOCAL JURISDICTION FOR RELEVANT ISSUE OF LISTED CODE REFERENCES AND FOR ANY LOCAL OR STATE CODE AMENDMENTS.
- G3. PARTITION COMPONENTS SHALL PROVIDE A FIRE RESISTIVE ASSEMBLY WITH FIRE RATINGS AS NOTED EACH TYPE.
- G4. DOOR HARDWARE FUNCTION SHALL PROVIDE MECHANICAL FREE EGRESS TO EGRESS SIDE OF DOOR.
- G5. REFERENCE CONSTRUCTION SHEET(S) FOR PARTITION TYPES.
- G6. PROVIDE FIRE EXTINGUISHERS PER APPLICABLE FIRE CODE. COORDINATE WITH LOCAL JURISDICTION FOR RELEVANT ISSUE OF LISTED CODE REFERENCES AND FOR ANY LOCAL OR STATE CODE AMENDMENTS.
- G7. ALL ANGLES ARE TO BE 0, 45 OR 90 DEGREES UNLESS NOTED OTHERWISE.

LIFE SAFETY PLAN KEYNOTES

- ITEMS LABELED WITH KEYED NOTE INDICATOR ARE FOR SPECIFIC LOCATIONS ON PLANS
- 1001. PROVIDE SURFACE MOUNTED FIRE EXTINGUISHER CABINETS AND EXTINGUISHER AS SPECIFIED. SEE ELEVATION 1/A-410 FOR TYPICAL MOUNTING HEIGHT. COORDINATE WITH 2014 FLORIDA FIRE PREVENTION CODE AND FBC ACCESSIBILITY REQUIREMENTS.
- 1002. SEE SHEET A-151 FOR OIL STORAGE NOTES.
- 1003. PROVIDE SEMI-RECESSED FIRE EXTINGUISHER CABINET AND EXTINGUISHER AS SPECIFIED. SEE ELEVATION A1/A-401 FOR TYPICAL MOUNTING HEIGHT.
- 1004. PARTITION SHALL BE CONSTRUCTED SO AS TO STOP THE PASSAGE OF AIR/FUME/GASES FROM SERVICE SHOP TO RETAIL AREA. GWB SHALL EXTEND FROM F.F. TO ROOF DECK. ALL PENETRATIONS, JOINTS AND CHANGES IN MATERIALS SHALL BE CALKED. HEAD OF WALL SHALL BE CALKED TO DECK AND DOORS SHALL HAVE SMOKE SEAL GASKETS.

LIFE SAFETY PLAN LEGEND

| | |
|---|---|
| <p>OCCUPANCY TYPE - B 7,724 S.F. / 100 = 78 OCCUPANTS 2 EXITS REQ. / 3 EXITS PROVIDED 78 OCCUPANTS / 2 EXITS = 39 OCCUPANTS PER EXIT</p> <p>B OCCUPANCY 78 OCCUPANTS X 0.2' = 15.6" MIN REQ. EGRESS WIDTH 2 EXITS @ 34" + 1 EXITS @ 66" = 136" TOTAL PROVIDED EGRESS WIDTH</p> <p>OCCUPANCY TYPE - S-1 6,490 S.F. / 300 = 22 OCCUPANTS 2 EXITS REQ. / 2 EXITS PROVIDED 22 OCCUPANTS / 2 EXITS = 11 OCCUPANTS PER EXIT</p> <p>S-1 OCCUPANCY 22 OCCUPANTS X 0.2' = 4.4" MIN REQ. EGRESS WIDTH 2 EXITS @ 34" = 68" TOTAL PROVIDED EGRESS WIDTH</p> | <p>EXIT</p> <p>PATH OF EGRESS TRAVEL</p> <p>COMMON PATH OF TRAVEL</p> <p>SMOKE BARRIER</p> <p>ILLUMINATED EXIT SIGN</p> <p>FEC</p> <p>POINT OF CHOICE</p> |
|---|---|



ISSUANCE

REVISIONS

| NO. | DATE | DESCRIPTION |
|-----|------|-------------|
| | | |

FILE NUMBER: 79800009
PROJECT MANAGER:
PROFESSIONAL:
DRAWN BY:
CHECKED BY:

THE AUTO CLUB GROUP
AAA - CAR CARE CENTER
TAMPA, FL 33607
1701 NORTH WESTSHORE BLVD

Progressive.com

PROGRESSIVE ARCHITECTURE ENGINEERING, PC
1075 South Towne St. Suite 600 - Clearwater, FL 34622 - 784.721.4500 | www.progressiveae.com

C

B

A


BUILDING EXIT #2 (B)
-EGRESS WIDTH
8 OCCUPANTS X 0.2' = 1.6" REQ.
34" PROVIDED
-MAXIMUM TRAVEL DISTANCE
200' MAXIMUM PERMITTED
-MAXIMUM COMMON PATH TRAVEL DISTANCE
75' MAXIMUM PERMITTED
@ TAX OFFICE 126
36'-2" TRAVEL DISTANCE

BUILDING EXIT #3 (B)
-EGRESS WIDTH
35 OCCUPANTS X 0.2' = 7" REQ.
34" PROVIDED
-MAXIMUM TRAVEL DISTANCE
200' MAXIMUM PERMITTED
-MAXIMUM COMMON PATH TRAVEL DISTANCE
75' MAXIMUM PERMITTED
@ WAITING 123
113'-11" TRAVEL DISTANCE / 50'-0" COMMON PATH

BUILDING EXIT #1 (B)
-EGRESS WIDTH
100 OCCUPANTS X 0.2' = 20" REQ.
34" PROVIDED
-MAXIMUM TRAVEL DISTANCE
200' MAXIMUM PERMITTED
-MAXIMUM COMMON PATH TRAVEL DISTANCE
75' MAXIMUM PERMITTED
@ WAITING 123
88'-4" TRAVEL DISTANCE / 50'-0" COMMON PATH

BUILDING EXIT #4 (S-1)
-EGRESS WIDTH
14 OCCUPANTS X 0.2' = 2.8" REQ.
34" PROVIDED
-MAXIMUM TRAVEL DISTANCE
200' MAXIMUM PERMITTED
-MAXIMUM COMMON PATH TRAVEL DISTANCE
75' MAXIMUM PERMITTED
@ PARTS STORAGE 119
109'-5" TRAVEL DISTANCE / 55'-6" COMMON PATH

BUILDING EXIT #5 (S-1)
-EGRESS WIDTH
14 OCCUPANTS X 0.2' = 2.8" REQ.
34" PROVIDED
-MAXIMUM TRAVEL DISTANCE
200' MAXIMUM PERMITTED
-MAXIMUM COMMON PATH TRAVEL DISTANCE
75' MAXIMUM PERMITTED
@ PARTS STORAGE 119
192'-3" TRAVEL DISTANCE / 55'-6" COMMON PATH

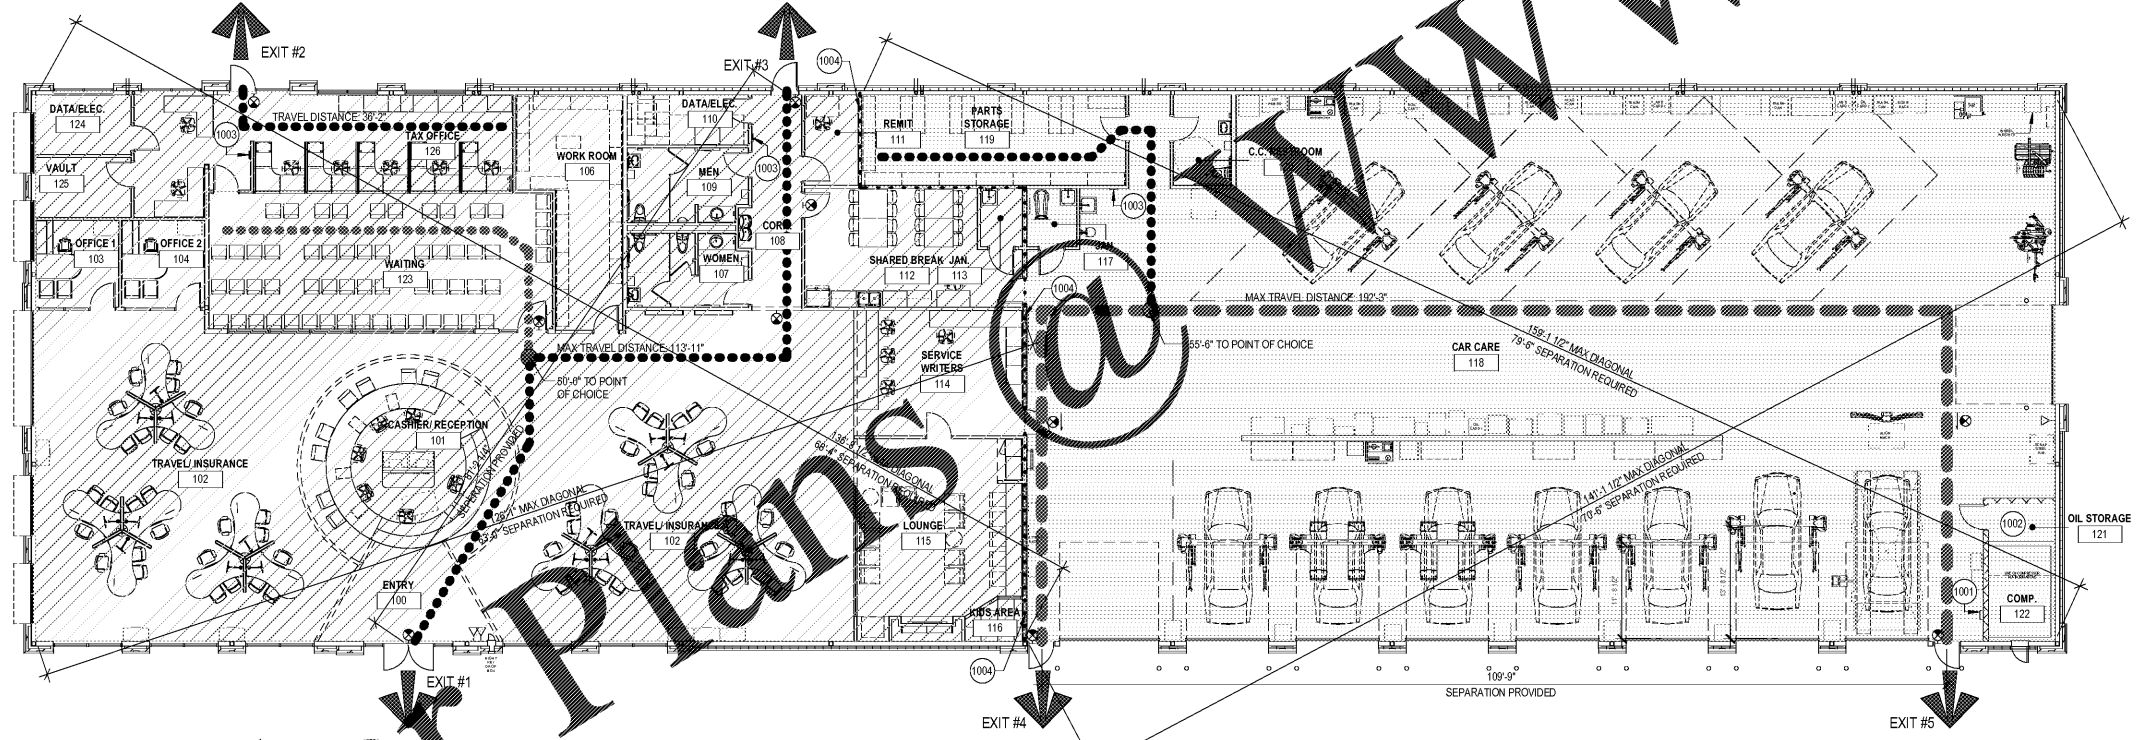

Order Plans

A1 LIFE SAFETY PLAN
SCALE: 3/32" = 1'-0"

6/22/2018 10:32:42 AM
D:\Draws\Local\Plan\2018\798000090 - Westshore - CENTRAL - 2018 - 2018.rvt
THIS DOCUMENT HAS BEEN PREPARED BY PAGE BC AS AN INSTRUMENT OF SERVICE AND PAGE BC SHALL RETAIN ALL COMMERCIAL, STATUTORY AND OTHER RESERVED RIGHTS, INCLUDING THE COPYRIGHT THEREO.