



STANDARD CONCRETE PAVEMENT SECTION

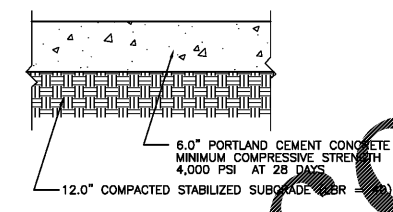


HEAVY DUTY PAVEMENT SECTION

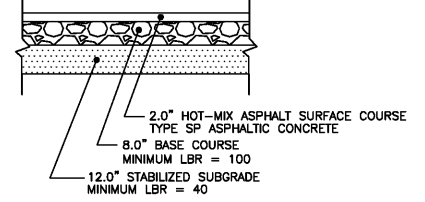


BASE MATERIALS SHOULD MEET FDOT REQUIREMENTS COMPACTED TO 98 PERCENT MAXIMUM DRY DENSITY PER ASTM D-1557, MODIFIED PROCTOR, AND HAVE A MINIMUM LBR OF 100. CRUSHED CONCRETE SHOULD BE GRADED IN ACCORDANCE WITH FDOT STANDARD SPECIFICATIONS SECTION 204.

STANDARD PAVEMENT SECTION

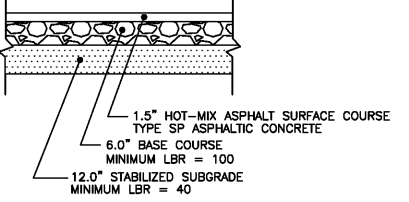


BASE MATERIALS SHOULD MEET FDOT REQUIREMENTS COMPACTED TO 98 PERCENT MAXIMUM DRY DENSITY PER ASTM D-1557, MODIFIED PROCTOR, AND HAVE A MINIMUM LBR OF 100. CRUSHED CONCRETE SHOULD BE GRADED IN ACCORDANCE WITH FDOT STANDARD SPECIFICATIONS SECTION 204.

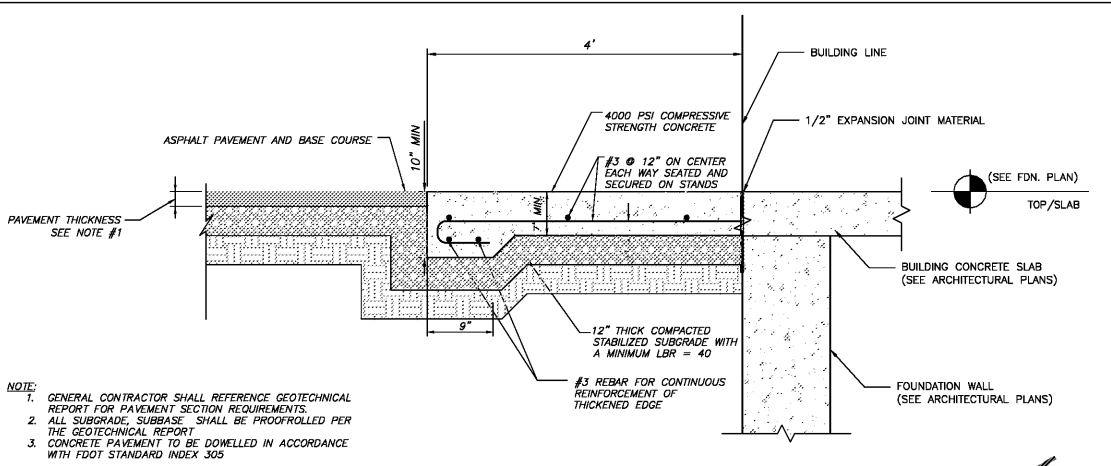

NOTE:
 1. GENERAL CONTRACTOR SHALL REFERENCE GEOTECHNICAL REPORT FOR PAVEMENT SECTION REQUIREMENTS.
 2. ALL SUBGRADE, SUBBASE SHALL BE PROOFROLLED PER THE GEOTECHNICAL REPORT.
 3. CONCRETE PAVEMENT TO BE DOWELED IN ACCORDANCE WITH FDOT STANDARD INDEX 305.


CONCRETE APRON ADJACENT TO BUILDING AT SERVICE BAYS
 NOT TO SCALE

STABILIZED CONSTRUCTION ENTRANCE PLAN

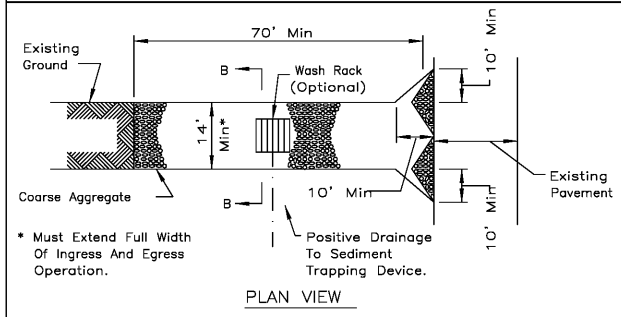


* Must Extend Full Width Of Ingress And Egress Operation.

PLAN VIEW

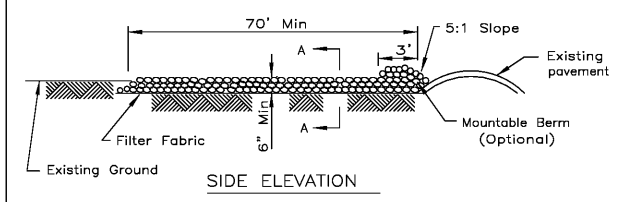

SIDE ELEVATION

NOTES:
 1. Filter fabric shall meet the requirements of material specification 592 GEOTEXTILE, Table I or 2, Class I, II or IV and shall be placed over the cleared area prior to the placing of rock.
 2. Rock or reclaimed concrete shall meet one of the following IDOT coarse aggregate gradation, CA-1, CA-2, CA-3 or CA-4 and be placed according to construction specification 25 ROCKFILL using placement Method 1 and Class III compaction.
 3. Any drainage facilities required because of washing shall be constructed according to manufacturers specifications.
 4. If wash racks are used they shall be installed according to the manufactures specifications.

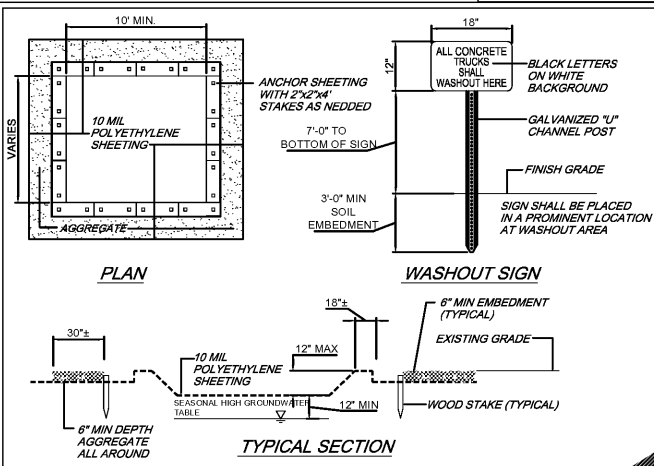


PLAN

WASHOUT SIGN

TYPICAL SECTION

NOTES:
 1. CONTAINMENT MUST BE STRUCTURALLY SOUND AND LEAK FREE AND CONTAIN ALL LIQUID WASTES.
 2. CONTAINMENT DEVICES MUST BE OF SUFFICIENT QUANTITY OR VOLUME TO COMPLETELY CONTAIN THE LIQUID WASTES GENERATED.
 3. WASHOUT MUST BE CLEANED OR NEW FACILITIES CONSTRUCTED AND READY TO USE ONCE WASHOUT IS 75% FULL.
 4. WASHOUT AREA(S) SHALL BE INSTALLED IN LOCATION EASILY ACCESSIBLE BY CONCRETE TRUCKS.
 5. ONE OR MORE AREAS MAY BE INSTALLED ON THE CONSTRUCTION SITE AND MAY BE RELOCATED AS CONSTRUCTION PROGRESSES.
 6. AT LEAST WEEKLY REMOVE ACCUMULATION OF SAND AND AGGREGATE AND DISPOSE OF PROPERLY.



CONCRETE WASHOUT AREA

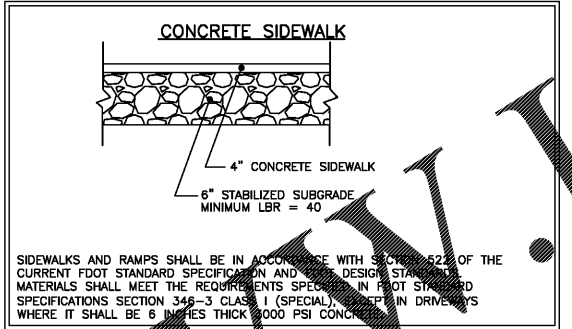


CONCRETE SIDEWALK

SIDEWALKS AND RAMPS SHALL BE IN ACCORDANCE WITH SECTION 322 OF THE CURRENT FDOT STANDARD SPECIFICATION AND DESIGN STANDARDS. MATERIALS SHALL MEET THE REQUIREMENTS SPECIFIED IN FDOT STANDARD SPECIFICATIONS SECTION 346-3 CLASS 1 (SPECIAL) FOR DRIVEWAYS WHERE IT SHALL BE 6 INCHES THICK 4000 PSI CONCRETE.

STORM SEWER CLEANOUT DETAIL

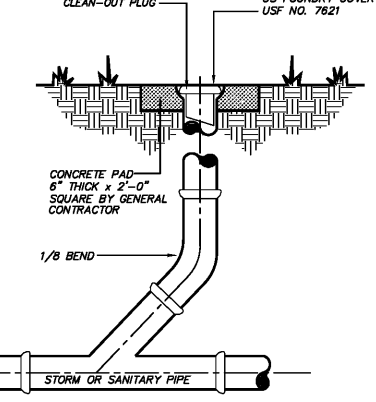


PIPE PLUG
 Not To Scale

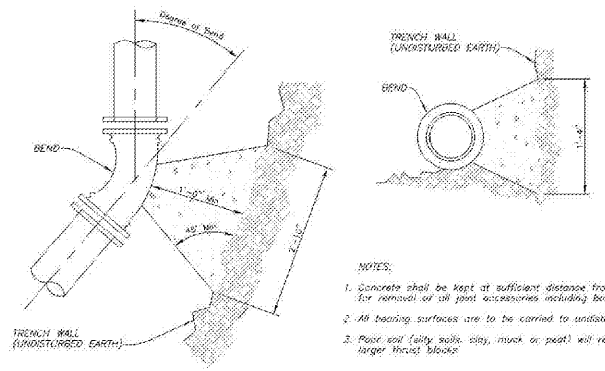

THRUST BLOCK
 Not To Scale

NOTES:
 1. Concrete shall be kept at sufficient distance from joints for removal of oil past accessories including bolts.
 2. All bedding surfaces are to be carried to undisturbed soil.
 3. Poor soil (silty soils, clay, much or peat) will require larger thrust blocks.

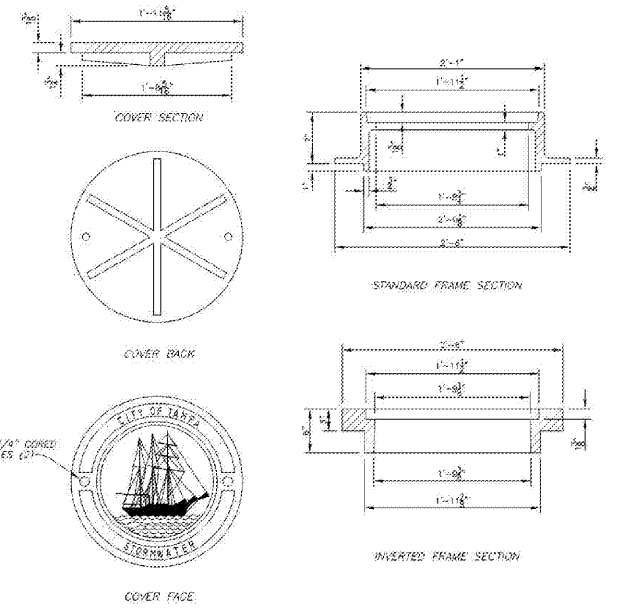


MANHOLE FRAMES & COVER
 Not To Scale

NOTE:
 Manhole structures shall be per FDOT Standard Index #200.

REFERENCE Project	DESIGNED	DATE	U.S. DEPARTMENT OF AGRICULTURE	STANDARD DWG. NO.
Checked	DATE	DATE	SOIL CONSERVATION SERVICE	IL-630
Approved	DATE	DATE		SHEET 1 OF 2
				DATE 8-18-94

STOCKPILE DETAIL

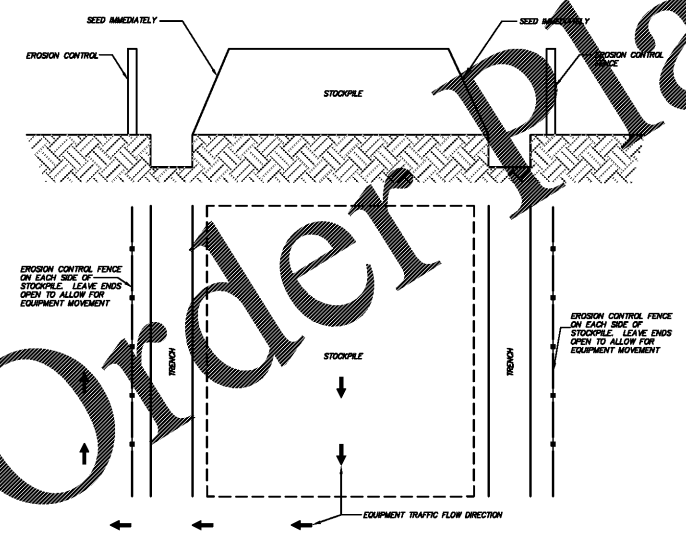

Order Plans

No.	DATE	REVISIONS	No.	DATE	REVISIONS
1			1		
2			2		
3			3		
4			4		

DES: Storm
 TBM: Storm
 CAD:
 DATE: 7/03

CITY OF TAMPA
 STORMWATER DEPARTMENT

MISCELLANEOUS DETAILS

NO. 06
 SHEET

DRAWING
 C-06

BAR IS ONE INCH ON OFFICIAL DRAWINGS
 0 1"
 IF NOT ONE INCH, ADJUST SCALE ACCORDINGLY

DRAWN BY: ERN
 APPROVED: JFV
 JOB DATE: 06/20/2018
 JOB NO: 160122

CAR CARE PLUS CENTER
 AAA - AMERICAN AUTOMOBILE ASSOCIATION
 1701 N. WESTSHORE BLVD., TAMPA, FL 33607
 CIVIL
 STANDARD CONSTRUCTION DETAILS

ILLINOIS DESIGN FIRM
 # 184-001322
 420 N. FRONT STREET, SUITE 100
 McHENRY, IL 60050
 PHONE: 815.385.1778
 FAX: 815.385.1781



NO.	DATE	BY	REVISION DESCRIPTION

WWW.LDILine.com

PRELIMINARY 28
 NOT FOR CONSTRUCTION