

PARTITION TYPE: A		PARTITION TYPE IDENTIFICATION SYMBOL					
STUD TO STRUCTURE (SEE DETAILS)	1 HR-RATED W/ GYP. BD. TO DECK NON-RATED W/ GYP. BD. TO DECK NON-RATED W/ GYP. BD. TO 6" ABOVE CEILING	A1	A2	A3	A4	A5	A6
STUD & GYP. BD. TO 6" ABOVE CEILING		A1A	A2A	A3A	A4A	A5A	A6A
STUD & GYP. BD. TO BOTTOM OF CEILING		A1B	A2B	A3B	A4B	A5B	A6B
METAL STUD SIZE		3-1/2"	2-1/2"	3-5/8"	3-5/8"	4"	6"
GYP BOARD THICKNESS		5/8"	5/8"	5/8"	5/8"	5/8"	5/8"
ACOUSTICAL INSULATION		NO	YES	NO	YES	NO	YES
BASE PARTITION THICKNESS		3-5/8"	3-3/4"	4-7/8"	4-7/8"	7-5/8"	7-1/4"
UL #							
REMARKS							

PARTITION TYPE: M		PARTITION TYPE IDENTIFICATION SYMBOL					
FIRE RESISTANCE FOR NON-LOAD BEARING PARTITIONS BUILT TO THE STRUCTURE ABOVE. SEE BELOW FOR EQUIVALENT THICKNESS REQUIRED	RATING NOT REQUIRED	M1	M2	M3	M4	M5	M6
1 HR-RATED		M1A	M2A	M3A	M4A	M5A	M6A
2 HR-RATED		M1B	M2B	M3B	M4B	M5B	M6B
3 HR-RATED		M1C	M2C	M3C	M4C	M5C	M6C
4 HR-RATED		M1D	M2D	M3D	M4D	M5D	M6D
NON RATED PARTITIONS	TO 6" ABOVE CEILING TO 4'-0" ABOVE FINISHED FLOOR (LOW WALL) TO 8'-0" ABOVE FINISHED FLOOR	M1E	M2E	M3E	M4E	M5E	M6E
BASE PARTITION THICKNESS		1-3/4"	3-5/8"	5-5/8"	7-5/8"	9-3/8"	11-1/2"
NOMINAL MASONRY THICKNESS		2"	4"	8"	8"	12"	12"
UL #							
REMARKS							

CONSTRUCTION PLAN LEGEND

	NEW PARTITIONS		PARTITION CONSTRUCTION TYPE
	SMOKE BARRIER		SCHEDULED DOOR NUMBER
	FIRE EXTINGUISHER		KEYNOTE INDICATOR
	FIRE EXTINGUISHER CABINET - FULLY RECESSED		WINDOW TYPE
	FIRE EXTINGUISHER CABINET - SEMI RECESSED		REVISION INDICATOR
	FIRE EXTINGUISHER CABINET - SURFACE MOUNTED		ROOM NAME
	FIRE HOSE CABINET		ROOM NUMBER AND ROOM NAME
	TYPICAL DOOR INSTALLATION CLEARANCES		NEW GRID LINE & INDICATOR


	ELEVATIONS		SECTIONS
	BUILDING		INTERIOR MILLWORK
	INTERIOR		WALL SECTION
	MILLWORK		DETAIL

CONSTRUCTION PLAN NOTES

- G1. BRACE PARTITIONS TO STRUCTURE IN ACCORDANCE WITH MOST UP-TO-DATE INTERNATIONAL BUILDING CODE SECTION AND ASCE FOR SEISMIC SUPPORT. COORDINATE WITH LOCAL JURISDICTION FOR RELEVANT ISSUE OF LISTED CODE REFERENCES AND FOR ANY LOCAL OR STATE CODE AMENDMENTS.
- G2. PARTITION COMPONENTS SHALL PROVIDE A FIRE RESISTIVE ASSEMBLY WITH FIRE RATINGS AS NOTED FOR EACH TYPE. MATERIALS AND COMPONENTS OF PARTITION ASSEMBLY AND MATERIAL WITHIN WALL SHOULD BE NON-COMBUSTIBLE OR FIRE RESISTIVE TREATED MATERIAL.
- G3. DOOR HARDWARE FUNCTION SHALL PROVIDE MECHANICAL FREE EGRESS TO EGRESS SIDE OF DOOR.
- G4. REFERENCE CONSTRUCTION PLAN SHEETS FOR PARTITION TYPES.
- G5. PROVIDE FIRE EXTINGUISHERS PER INTERNATIONAL FIRE CODE. COORDINATE WITH LOCAL JURISDICTION FOR RELEVANT ISSUE OF LISTED CODE REFERENCES AND FOR ANY LOCAL OR STATE CODE AMENDMENTS. G.C. TO COORDINATE FINAL PLACEMENT AND QUALITIES OF FIRE EXTINGUISHERS WITH FIRE MARSHAL ON SITE. EXTINGUISHERS COMMONLY LOCATED IN CUSTOMER AREAS SHALL BE IN SEMI-RECESSED CABINETS, UNLESS NOTED OTHERWISE.
- G6. ALL ANGLES ARE PARALLEL, PERPENDICULAR, OR 45 DEGREE UNLESS NOTED OTHERWISE.
- G7. BUILDING ELEMENTS / MATERIALS TO BE IN CONSTRUCTION, UNO.
- G8. ALIGNMENT DIMENSIONS SHALL BE FINISHED TO FINISH SURFACE.
- G9. DIMENSIONS ARE FROM FACE OF FINISHED SURFACE ON NEW PARTITION SURFACE, UNO. CENTERLINE DIMENSIONS SHALL BE MEASURED FROM CENTERLINE OF ASSEMBLY, FIXTURE, OR CASE.
- G11. ALL TRADES AND GENERAL CONTRACTOR(S) SHALL REFERENCE ALL ASSOCIATED DRAWINGS (ENGINEER'S, VENDOR SHOP DRAWINGS PROVIDED BY OWNER, ETC.) AND COORDINATE REQUIREMENTS FOR INSTALLATION OF ALL SPECIFIED SYSTEMS.

CONSTRUCTION PLAN KEYNOTES

- ITEMS LABELED WITH KEYNOTE INDICATOR ARE FOR SPECIFIC LOCATIONS ON PLANS
- 1101 PROVIDE SEMI-RECESSED (GWB SUBSTRATE) FIRE EXTINGUISHER CABINET AND EXTINGUISHER PER LEGEND, SHEET G-101. SEE ELEVATION ON SHEET A-401 FOR TYPICAL MOUNTING HEIGHT. COORDINATE W/ 2017 FLORIDA FIRE PREVENTION CODE AND FBC ACCESSIBILITY REQUIREMENTS.
 - 1102 NEW METAL LOCKERS BY G.C. SEE DETAILS ON SHEET A-410.
 - 1103 HAND SINK, TYPICAL. SEE PLUMBING DRAWINGS.
 - 1104 PROVIDE 4" X 4" DIAMOND PLATE BACKSLASH BEHIND SINK.
 - 1107 METAL ROOF ACCESS LADDER.
 - 1108 EYEWASH STATION. REF PLUMBING DWGS.
 - 1113 LINE OF O.H. DOOR ABOVE.
 - 1122 MOP SINK. REFER TO PLUMBING DRAWINGS.
 - 1133 PROVIDE (GWB SUBSTRATE) FIRE EXTINGUISHER CABINET AND EXTINGUISHER PER LEGEND, SHEET G-101. SEE ELEVATION ON SHEET A-401 FOR TYPICAL MOUNTING HEIGHT. COORDINATE W/ 2017 FLORIDA FIRE PREVENTION CODE AND FBC ACCESSIBILITY REQUIREMENTS.
 - 1137 6" GALV. STEEL BOLLARD. PAINT TO MATCH SHOP SAFETY STRIPING COLOR (YELLOW) ON INTERIOR BOLLARD ONLY.
 - 1138 COORDINATE ALIGNMENT LIFT PIT DIMENSIONS & EXACT LOCATION WITH LIFT SUPPLIER.

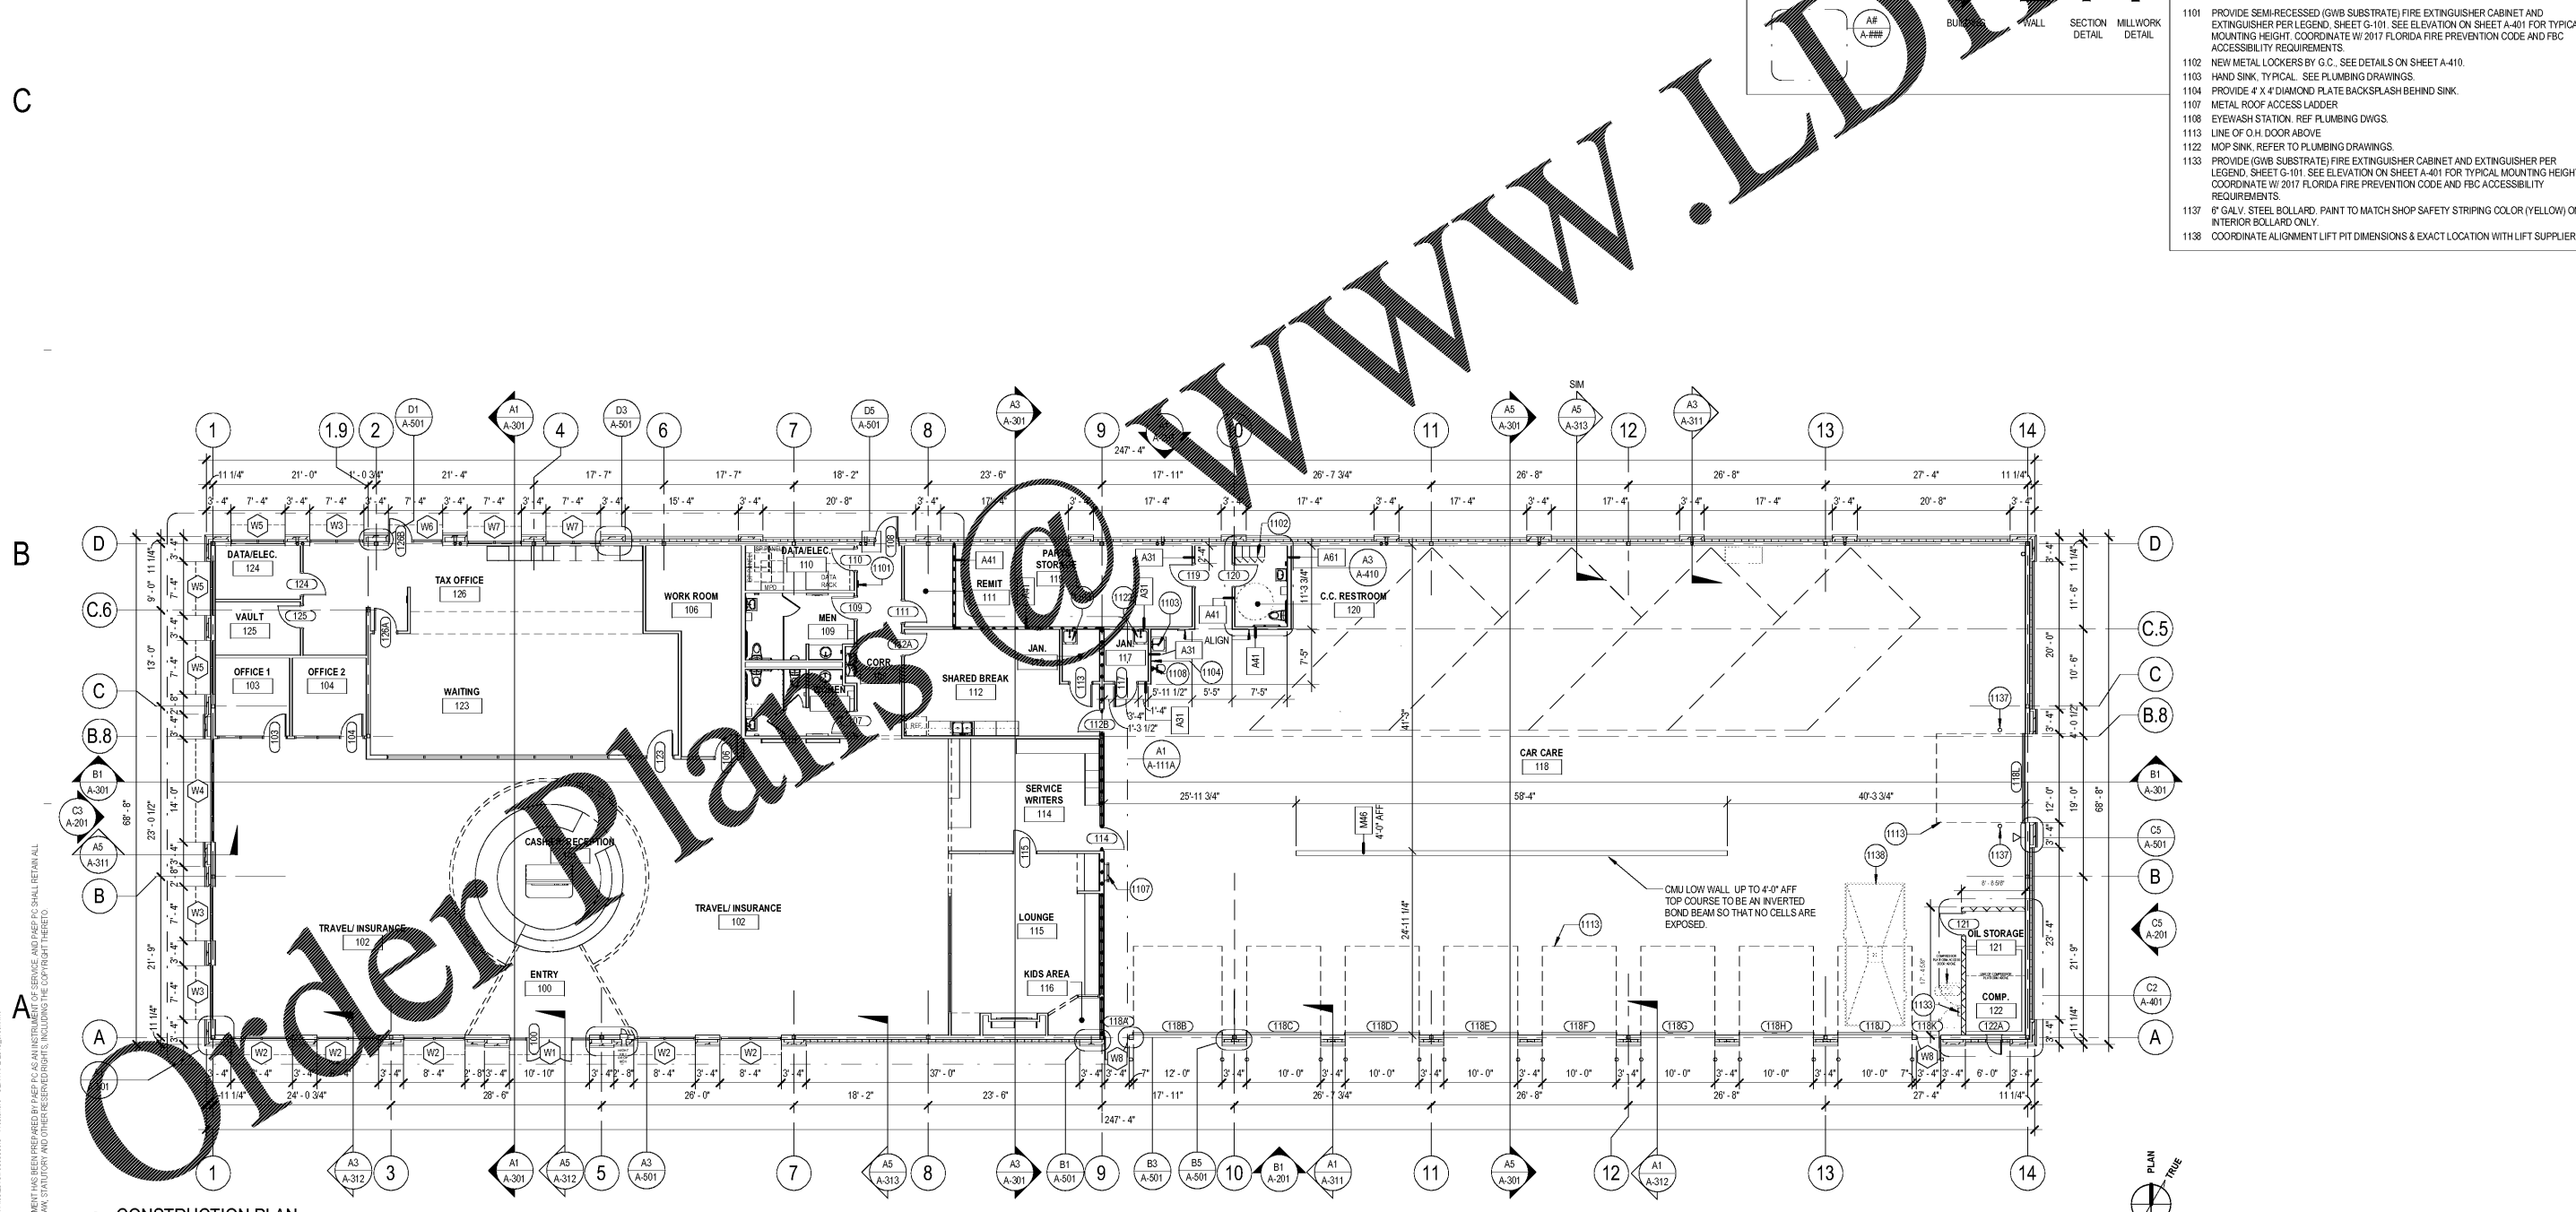

(A1) CONSTRUCTION PLAN
SCALE: 3/32" = 1'-0"

THE AUTO CLUB GROUP
AAA - CAR CARE CENTER
TAMPA, FL 33607
 1701 NORTH WESTSHORE BLVD



ISSUANCE	
REVISIONS	
NO. DATE DESCRIPTION	
FILE NUMBER	79890009
PROJECT MANAGER	
PROFESSIONAL	
DRAWN BY	
CHECKED BY	

CONSTRUCTION PLAN
A-111