SHEET SYMBOLS

- LED TRIMLESS DOWNLIGHT - SEE LIGHTING PLAN FOR ADDITIONAL INFORMATION
- RECESSED MULTI-SPOT LED LIGHT- SEE LIGHTING PLAN FOR ADDITIONAL INFORMATION
- FLUORESCENT LIGHT - SEE LIGHTING PLAN FOR ADDITIONAL INFORMATION
- HVAC GRILLES - SEE MECHANICAL DRAWINGS FOR ADDITIONAL INFORMATION.
- EXISTING EXHAUST FAN
- PENDANT LIGHT - SEE LIGHTING PLAN FOR ADDITIONAL INFORMATION

SHEET NOTES

1. EXISTING SUSPENDED 2X2 LAY-IN CEILING GRID WITH NEW TILES, ACT-2, @11'-1".
2. EXTEND NEW SUSPENDED 2X2 LAY-IN CEILING GRID TO MATCH EXISTING, WITH NEW TILES, ACT-1, @11'-1".
3. ANGLE LAY-IN TILE @ CEILING TRANSITION FROM 11'-1" TO 11'-9".
4. EXISTING GYP BD SOFFIT, @10'-2" VIF, SHALL REMAIN. G.C. SHALL PATCH/REPAIR GYP BD. PAINT P-1.
5. EXTEND EXISTING GYP BD, @10'-2" VIF, TO NEW WALL. PAINT P-1.
6. LINE OF EXISTING SOFFIT.
7. EXISTING 2X4 LIGHT FIXTURE TO REMAIN. G.C. SHALL CLEAN TO LIKE NEW CONDITION AND VERIFY PROPER WORKING ORDER. RELAMP.
8. NEW RECESSED DOWNLIGHTS IN EXISTING LOCATIONS. G.C. SHALL PATCH/REPAIR GYP BD.
9. STOREFRONT SHALL HOLD TIGHT TO LEASE LINE AND MILLWORK BELOW. REF: 2/A3.1 AND 3/A3.1.
10. EXISTING SUSPENDED 2X4 LAY-IN CEILING SYSTEM @9'-0" A.F.F. G.C. SHALL REPLACE ANY MISSING OR DAMAGED TILES, MATCH EXISTING VIF.
11. NEW FRAMELESS ACCESS PANEL, PAINT P-1.
12. EXISTING EXHUST FAN SHALL REMAIN. G.C. SHALL VERIFY PROPER WORKING ORDER. CLEAN TO LIKE NEW CONDITION.
13. EXISTING DIFFUSER. G.C. TO CLEAN TO LIKE NEW.
14. EXISTING SUPPLY. G.C. TO CLEAN TO LIKE NEW.
15. EXISTING AUNTIE ANNE'S STORE. FOR REFERENCE ONLY. NO WORK.
16. EXISTING AUNTIE ANNE'S CEILING. NO WORK.
17. SS-1 LEDGE AT STOREFRONT, REFER TO 6/A3.1 FOR ADDITIONAL INFORMATION.
18. GYP BD DECORATIVE CURTAIN WALL. REF:6/A3.1. PAINT P-6.
19. EXISTING LIFE SAFETY SYSTEM/ALARM SYSTEM, IF EXISTING AND REQUIRED, SHALL REMAIN AND BE RECONFIGURED FOR NEW TENANT BUILD-OUT. DO NOT REMOVE, MODIFY ONLY. G.C. SHALL VERIFY PRIOR TO DEMOLITION/CONSTRUCTION.
20. EXISTING EMERGENCY LIGHTS AND EXIT LIGHTS SHALL BE REMOVED AND DISCARDED, UNLESS OTHER WISE NOTED, #23.
21. EXISTING SUSPENDED TRANSFORMER TO REMAIN.
22. EXISTING SPRINKLER HEADS. COORDINATE EXISTING, RELOCATION AND ADDITION WITH NEW CONSTRUCTION.
23. EXISTING EMERGENCY LIGHT IN THE TOILET ROOM SHALL REMAIN.
24. G.C. TO MODIFY EXISTING GYP BD SOFFIT AND FRAMING FOR NEW RECESSED LIGHT FIXTURE. VIF.
25. G.C. TO MODIFY EXISTING GYP BD SOFFIT AND FRAMING FOR NEW HVAC GRILLES. VIF.

SPRINKLER NOTES

THIS SPACE IS CURRENTLY PROVIDED WITH AN AUTOMATIC WET PIPE SPRINKLER SYSTEM. THE FIRE PROTECTION CONTRACTOR SHALL BE RESPONSIBLE FOR THE MODIFICATIONS TO THE ORIGINAL DESIGN PROVIDING A NEW LAYOUT, AND ALL MATERIALS REQUIRED FOR A COMPLETE AND OPERATIONAL SYSTEM FOR THIS PROPOSED TENANT SPACE OF THE BUILDING. CONTRACTOR SHALL PREPARE ALL NEEDED DRAWINGS AND OBTAIN APPROVAL FROM ALL STATE, LOCAL AND FIRE UNDERWRITING AGENCIES AS WELL AS MEETING ALL NFPA 13 REQUIREMENTS. THE SPRINKLER SYSTEM SHALL BE TESTED PRESSURE BY FIRE PROTECTION CONTRACTOR, INSPECTED AND APPROVED BY LOCAL FIRE MARSHALL PRIOR TO ACCEPTANCE BY OWNER. CONSULT WITH LANDLORD REPRESENTATIVE FOR VERIFICATION OF EXISTING CONDITIONS OF FIRE PROTECTION SYSTEMS FOR LOCATION, CONNECTION POINT, SIZE, TYPE, ETC. PROVIDE SIGNED AND SEALED DRAWINGS AS REQUIRED TO THE LOCAL AUTHORITY. DRAWINGS SHALL BE SIGNED AND SEALED BY THE PROFESSIONAL ENGINEER EMPLOYED BY FIRE PROTECTION CONTRACTOR, WHO IS IN RESPONSIBLE CHARGE OF THIS WORK.

SPRINKLER HEADS IN PUBLIC VIEWABLE CEILINGS MUST BE OF AN APPROVED CONCEALED TYPE. SURFACE MOUNTED HEADS ARE PERMITTED IN AREAS NOT VISIBLE TO CUSTOMER.

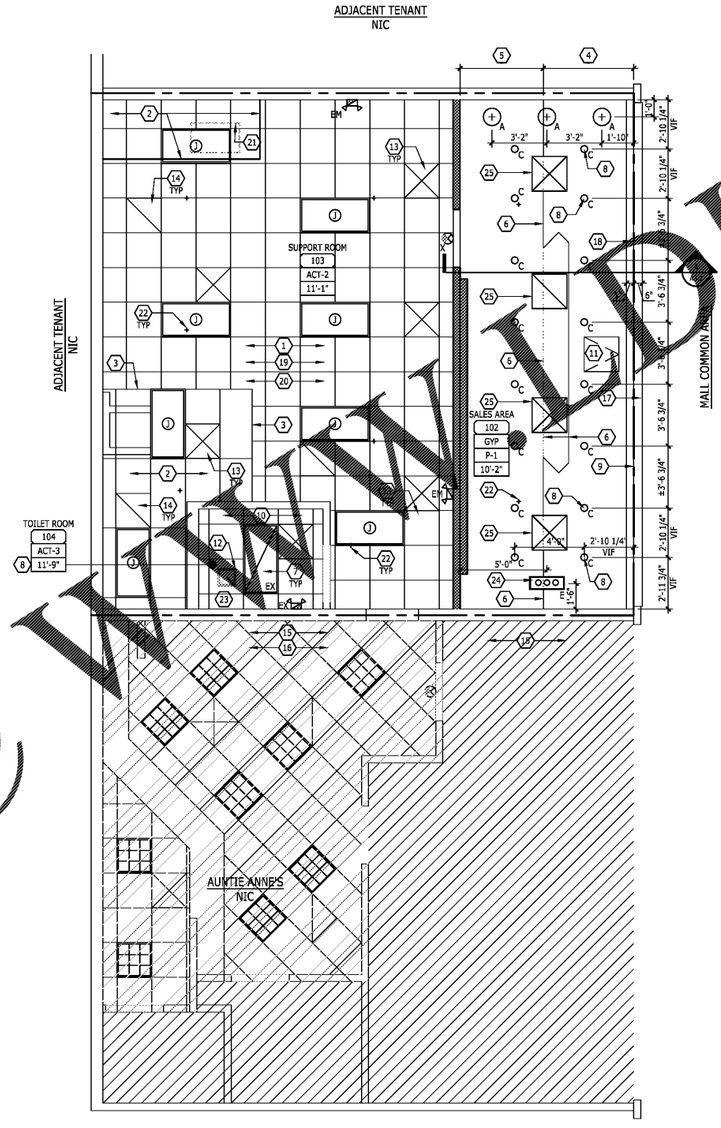

NOTE:
ALL LIGHTS IN FRONT PREP AREA AND THE REAR SERVICE AREA ARE TO BE CONSTRUCTED OF SHATTERPROOF MATERIALS OR PROTECTED W/ SHATTERPROOF SHIELDS.

1 REFLECTED CEILING PLAN

1/4"=1'-0"

www.BIDLine.com
Bidder Plans @ Web

Häagen-Dazs

SHOP# 1306
SPACE #1164
WEST TOWN MALL
7600 KINGSTON PIKE
KNOXVILLE, TN
37919

No.	Revisions	Date

pdms design group
pdmsdesign.com
2225 East Randol Mill Road, Suite #300
Arlington, Texas 76011
817.633.4200 p • 817.633.4153 f

The document contains information proprietary to PDMS Design Group and is furnished for consideration, for the limited purpose of evaluation, bidding, review or construction. This document is to be returned and not to be used for any other purpose and may not in any manner or form be published or copied without the prior written consent of PDMS Design Group

MICHAEL R. BLACK, AIA
2225 E. RANDOL MILL RD., SUITE 300
ARLINGTON, TEXAS 76011
817.701.4819
TENNESSEE REG. NO.: 104432

MICHAEL R. BLACK — REGISTERED ARCHITECT — 2009 — STATE OF AGRICULTURE — No. 0010443 — STATE OF TENNESSEE

Project No.	180165
Scale	AS NOTED
Drawn	CAL
Checked	RER
Date	06/29/2018

Drawing Title

REFLECTED CEILING PLAN

Drawing No. **A2.0**

V:\180165\180165 A2.0, 6/29/2018 9:29:59 AM, CLIVINGSTON