

HOOD INFORMATION - Job#3364331

HOOD NO.	TAG	MODEL	LENGTH	MAX COOKING TEMP.	EXHAUST PLENUM						TOTAL SUPPLY CFM	HOOD CONSTRUCTION	HOOD CONFIG				
					TOTAL EXH. CFM	WIDTH	LENG.	HEIGHT	DIA.	CFM			VEL.	S.P.	END TO END	ROW	
1		5424 ND-2-PSP-F	16' 0"	600 Deg.	3500	12"	26"	4"		3500	1615	-0.962"	2800	430 SS	Where Exposed	ALONE	ALONE

PATENT NUMBERS

AC-PSP (United States) - US Patent 7963830 B2
 AC-PSP Wall (Canada) - CA Patent 2820509
 AC-PSP Island (Canada) - CA Patent 2520330

HOOD INFORMATION


HOOD NO.	TAG	TYPE	FILTER(S)				LIGHT(S)				UTILITY CABINET(S)				FIRE SYSTEM PIPING	HOOD HANGING WGT	
			QTY.	HEIGHT	LENGTH	EFFICIENCY @ 7 MICRONS	QTY.	TYPE	WIRE GUARD	LOCATION	SIZE	FIRE SYSTEM	SIZE	ELECTRICAL			SWITCHES
1		Captrate Solo Filter	12	20"	16"	85% See Filter Spec.	5	L55 Series E26	NO	Right	12"x54"x24"	Ansul R102	3.0/3.0	DCV-1111	1 Light 1 Fan	YES	970 LBS

HOOD OPTIONS


HOOD NO.	TAG	OPTION
1		LEFT END STANDOFF (FINISHED) 3" Wide 54" Long

PERFORATED SUPPLY PLENUM(S)

HOOD NO.	TAG	POS.	LENGTH	WIDTH	HEIGHT	TYPE	RISER(S)			
							WIDTH	LENG.	DIA.	CFM
1		Front	207"	14"	6"	MUA	12"	28"	700	0.185"
						MUA	12"	28"	700	0.185"
						MUA	12"	28"	700	0.185"
						MUA	12"	28"	700	0.185"

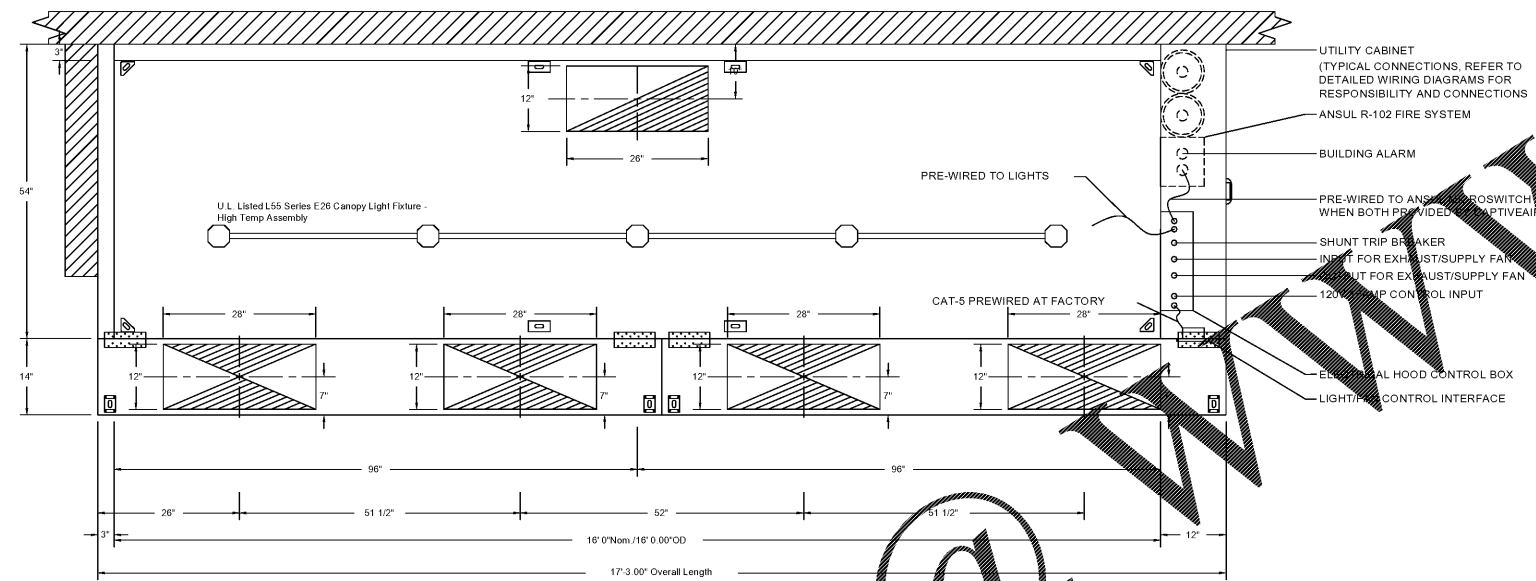

PLAN VIEW - Hood #1
 16' 0.00" LONG 5424ND-2-PSP-F
 NOTE: Additional hanging angles provided for hoods 12' and longer

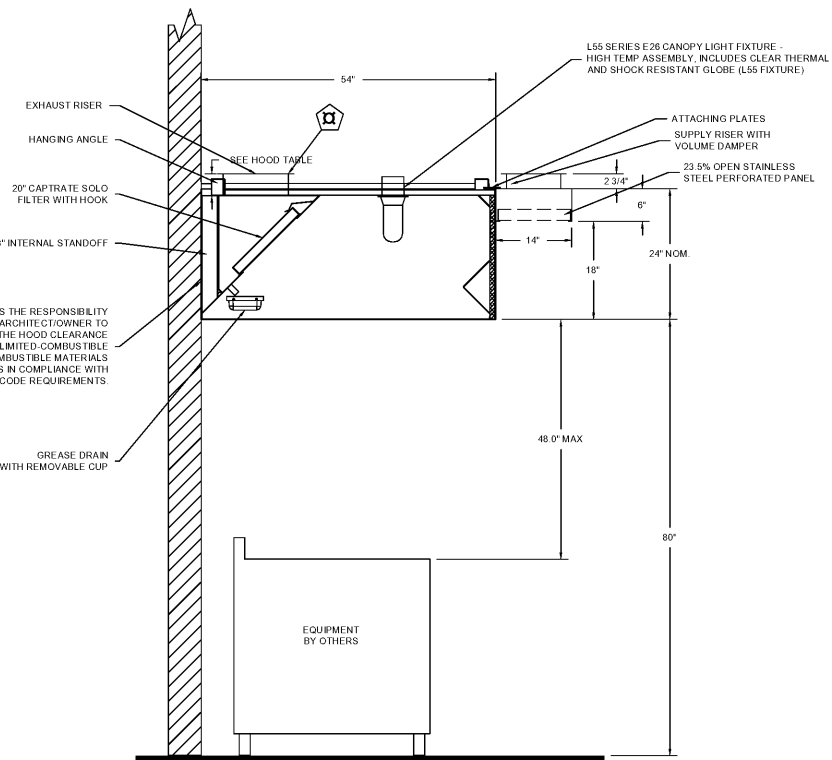

SECTION VIEW - MODEL 5424ND-2-PSP-F
 HOOD - #1

REVISIONS	
DESCRIPTION	DATE

REVISIONS	NO
4/28/2018	
5/15/2018	

CAPTIVE
 Southern California Office
 3002 Dow Ave., Suite 410, Tustin, CA 92780 PHONE: (714) 957-1500 FAX: (919) 227-5975 EMAIL: reg86@captivair.com

Del Taco - Hiram GA
 4525 Jimmy lee Smith Parkway,
 HIRAM, GA, 30141

DATE: 4/6/2018
 DWG.#: 3364331
 DRAWN BY: AHJ-86
 SCALE: 3/4" = 1'-0"
 MASTER DRAWING

SHEET NO.
 1

Del Taco - Hiram, GA 30141
 4525 Jimmy Lee Smith Pkwy DELTACO

ChainLink services
 In a Hurry? We're here to help!
 Turnkey solutions for your business

DRAWN: CHECKED:
 DATE: 4/5/2018
 SCALE:
K8
 SHEET
 OF 11 SHEETS

Order Plans @ WWW.LDILine.com

System Information Job#3364331

FIRE SYSTEM NO.	TYPE	SIZE	FLOW POINTS	INSTALLATION	
				SYSTEM	LOCATION ON HOOD
1	Ansul R102	3.0/3.0	4	Fire Cabinet Right	Right