

**GENERAL NOTES**

- A. CONTRACTOR SHALL REFER TO SHEET M001 FOR GENERAL MEP NOTES APPLICABLE TO ALL PLANS.
- B. REFER TO KITCHEN DRAWINGS FOR MORE INFORMATION AND ELECTRICAL ROUGH-INS.
- C. ALL SWITCHES, OUTLETS, IN KITCHEN AND MANAGER'S OFFICE ARE TO HAVE NAME PLATES ETCHED ON STAINLESS STEEL.
- D. ALL LOW VOLTAGE WIRING SHALL BE IN 3/4" EMT CONDUIT OR SIZED AS INDICATED. PROVIDE WALL CHASES FOR ALL SECURITY TYPE EQUIPMENT AS NECESSARY. EXACT LOCATION TO BE COORDINATED.
- E. RECEPTACLES MOUNTED IN KITCHEN EQUIPMENT, CONSULT ARCHITECT OR KITCHEN CONSULTANT FOR INSTALLATION.
- F. CONSULT EQUIPMENT VENDOR FOR CONNECTION REQUIREMENTS AND PROVIDE CONNECTORS TO MATCH ACCORDINGLY.
- G. CONTRACTOR TO VERIFY ALL CONDITIONS, LOCATIONS, AND CONNECTIONS TO EQUIPMENT WITH OWNER AND/OR ARCHITECT PRIOR TO BEGINNING CONSTRUCTION. ALL COST IN BID.
- H. ALL ELECTRICAL CONNECTIONS SHALL BE MADE FROM THE CEILING UNLESS NOTED OTHERWISE.
- I. REFER TO MECHANICAL PLANS FOR LOCATION OF THERMOSTATS AND REMOTE SENSORS. PROVIDE PULL BOX, AND CONDUIT WITH PULL STRING TO ABOVE CEILING.
- J. ELECTRICAL COVER PLATES FOR WIRING DEVICES AND SWITCHES SHALL BE 1/2" THICK UNLESS SHOWN OTHERWISE.
- K. DOUBLE HOMERIS MAY BE SHOWN ON THESE PLANS FOR CLARITY. E.C. IS TO DEFINE HOMERIS IN CONDUIT AND WIRES SO AS TO OBSERVE ALL REQUIREMENTS FOR 2, 110.14. IT IS NOT THE INTENTION OF THIS DESIGN TO ALLOW MULTIPLE TYPED CIRCUIT BREAKERS.

**KEYED POWER PLAN NOTES**

1. SHOW WINDOW RECEPTACLE AS REQUIRED. PROVIDE ONE FOR EVERY 12 LINEAR FT. OF SHOW WINDOW WITHIN 18" OF TOP OF WINDOW PER NEC 210.62. CONTROL VIA TIMELOCK.
2. NOT USED.
3. EQUIPMENT CALL OUT. REFERENCE FOOD SERVICE (KITCHEN) DRAWINGS FOR COORDINATION. REFER TO ELECTRICAL SCHEDULE ON SHEET KITCHEN DRAWINGS.
4. ELECTRICAL DISTRIBUTION EQUIPMENT. REFER TO SHEET E301 FOR FURTHER COORDINATION.
5. NOT USED.
6. NOT USED.
7. PROVIDE POWER FOR FLY FAN ABOVE DOOR. VERIFY EXACT LOCATION WITH OWNER.
8. SEE ARCHITECTURAL INTERIOR ELEVATIONS FOR MOUNTING OF MENU BOARD. SEE MENUBOARD SHOP DRAWINGS. PROVIDE J-BOX ABOVE CEILING AND WHIP DOWN TO MENUBOARD CONNECTION.
9. NOT USED.
10. J-BOX MOUNTED AT 48" AFF FOR HAND DRYERS IN RESTROOM.
11. PROVIDE 4"C. FOR TELEPHONE SERVICE. ROUTE TO TELEPHONE SERVICE CONNECTION NEAR PROPERTY LINE. COORDINATE WITH LOCAL UTILITY.
12. INTERWIRE TO ROOF MOUNTED CONDENSER. VERIFY WITH EQUIPMENT PROVIDER PRIOR TO ROUGH-IN.
13. ALL RECEPTACLES AND POWER CONNECTORS IN TACO BAR ASSEMBLY ARE PRE-INSTALLED AND WIRED TO PANEL "K2". EXCEPT FOR KDS MONITOR RECEPTACLES. PROVIDE POWER DROP TO PANEL "K2" AND KDS MONITORS SEPARATELY.
14. RECEPTACLES FOR P.O.S. REGISTERS SHALL BE HUBBELL #5262. RECEPTACLES FOR P.O.S. MONITORS, HME DRIVE-THRU SYSTEMS AND STORE COMPUTER SHALL BE HUBBELL #5262.
15. REFER TO LIGHTING PLAN E101 FOR HOOD/COOLER/FREEZER LIGHTS.
16. TELEPHONE TERMINAL CABINET CATALOG NO. 24267 - TSC 24"W X 26"H X 5.75"D BY WIRE GUARD SYSTEM INC. SEE SITE PLAN FOR FURTHER COORDINATION. CONNECT TO GROUND BAR IN PANEL P1 WITH #6AWG IN 3/4"C.
17. EXTERIOR 4"x4" WEATHERPROOF TIGHT BOX AT 16'-0" AFF FOR 1" CONDUIT FOR ANTENNA. ROUTE CONDUIT IN WALL AND CEILING SPACE TO MANAGERS OFFICE.
18. PROVIDE WEATHER PROOF PAD-LOCKABLE FIRE DEPARTMENT APPROVED MAIN POWER SHUT-OFF SWITCH ON EXTERIOR OF BUILDING AS REQUIRED. VERIFY LOCATION WITH FIRE MARSHALL. LABEL MAIN ELECTRICAL DISCONNECT PER FIRE DEPT. REQUIREMENTS.
19. DRIVE THRU LOOPS FURNISHED BY OWNER & INSTALLED BY ELECTRICAL CONTRACTOR.
20. REFER TO ROOF PLAN MEP002 FOR ROOF MOUNTED EQUIPMENT.
21. NOT USED.
22. J-BOX AND CONDUIT DOWN FROM CEILING AT FIRE SUPPRESSION SYSTEM LOOPED TO ANSUL PULL SWITCH AND INTERCONNECTED TO MICRO SWITCH. MICRO SWITCH FURNISHED BY ANSUL SUPPLIER AND INSTALLED AND INTERCONNECTED BY ELECTRICAL CONTRACTOR.
23. ANSUL PULL SWITCH AT 48" AFF. SEE DETAIL 01 ON SHEET E402 FOR FURTHER COORDINATION.
24. 2" CONDUIT BACK TO PHONE BOARD FOR CAT-5 TO ABOVE CEILING.
25. NOT USED.
26. IRRIGATION CONTROLLER (VERIFY LOCATION).
27. NOT USED.
28. NOT USED.
29. TWO 1" C. FOR VARIOUS MENU BOARD ELECTRICAL BRANCH FEEDERS FROM PANEL "LP1".

DO NOT SCALE DRAWINGS  
CONTRACTOR TO VERIFY  
ALL EXISTING CONDITIONS AND  
DIMENSIONS-NOTIFY ARCHITECT  
OF ANY DISCREPANCIES PRIOR  
TO BEGINNING CONSTRUCTION



JULY 5TH, 2018

NO REVISION

DEL TACO STORE # DT2017  
4825 JIMMY LEE SMITH PARKWAY  
HIRAM, GA 30141  
PAULTON COUNTY  
1ST PERMIT SUBMITTAL 05-18-18  
1ST BID SUBMITTAL 07-05-18

PROJECT NUMBER  
**2180148**


SHEET NAME

**ELECTRICAL  
POWER  
PLAN**

SHEET NUMBER

**E201**

DATE OF THIS PRINTING - 7/3/2018

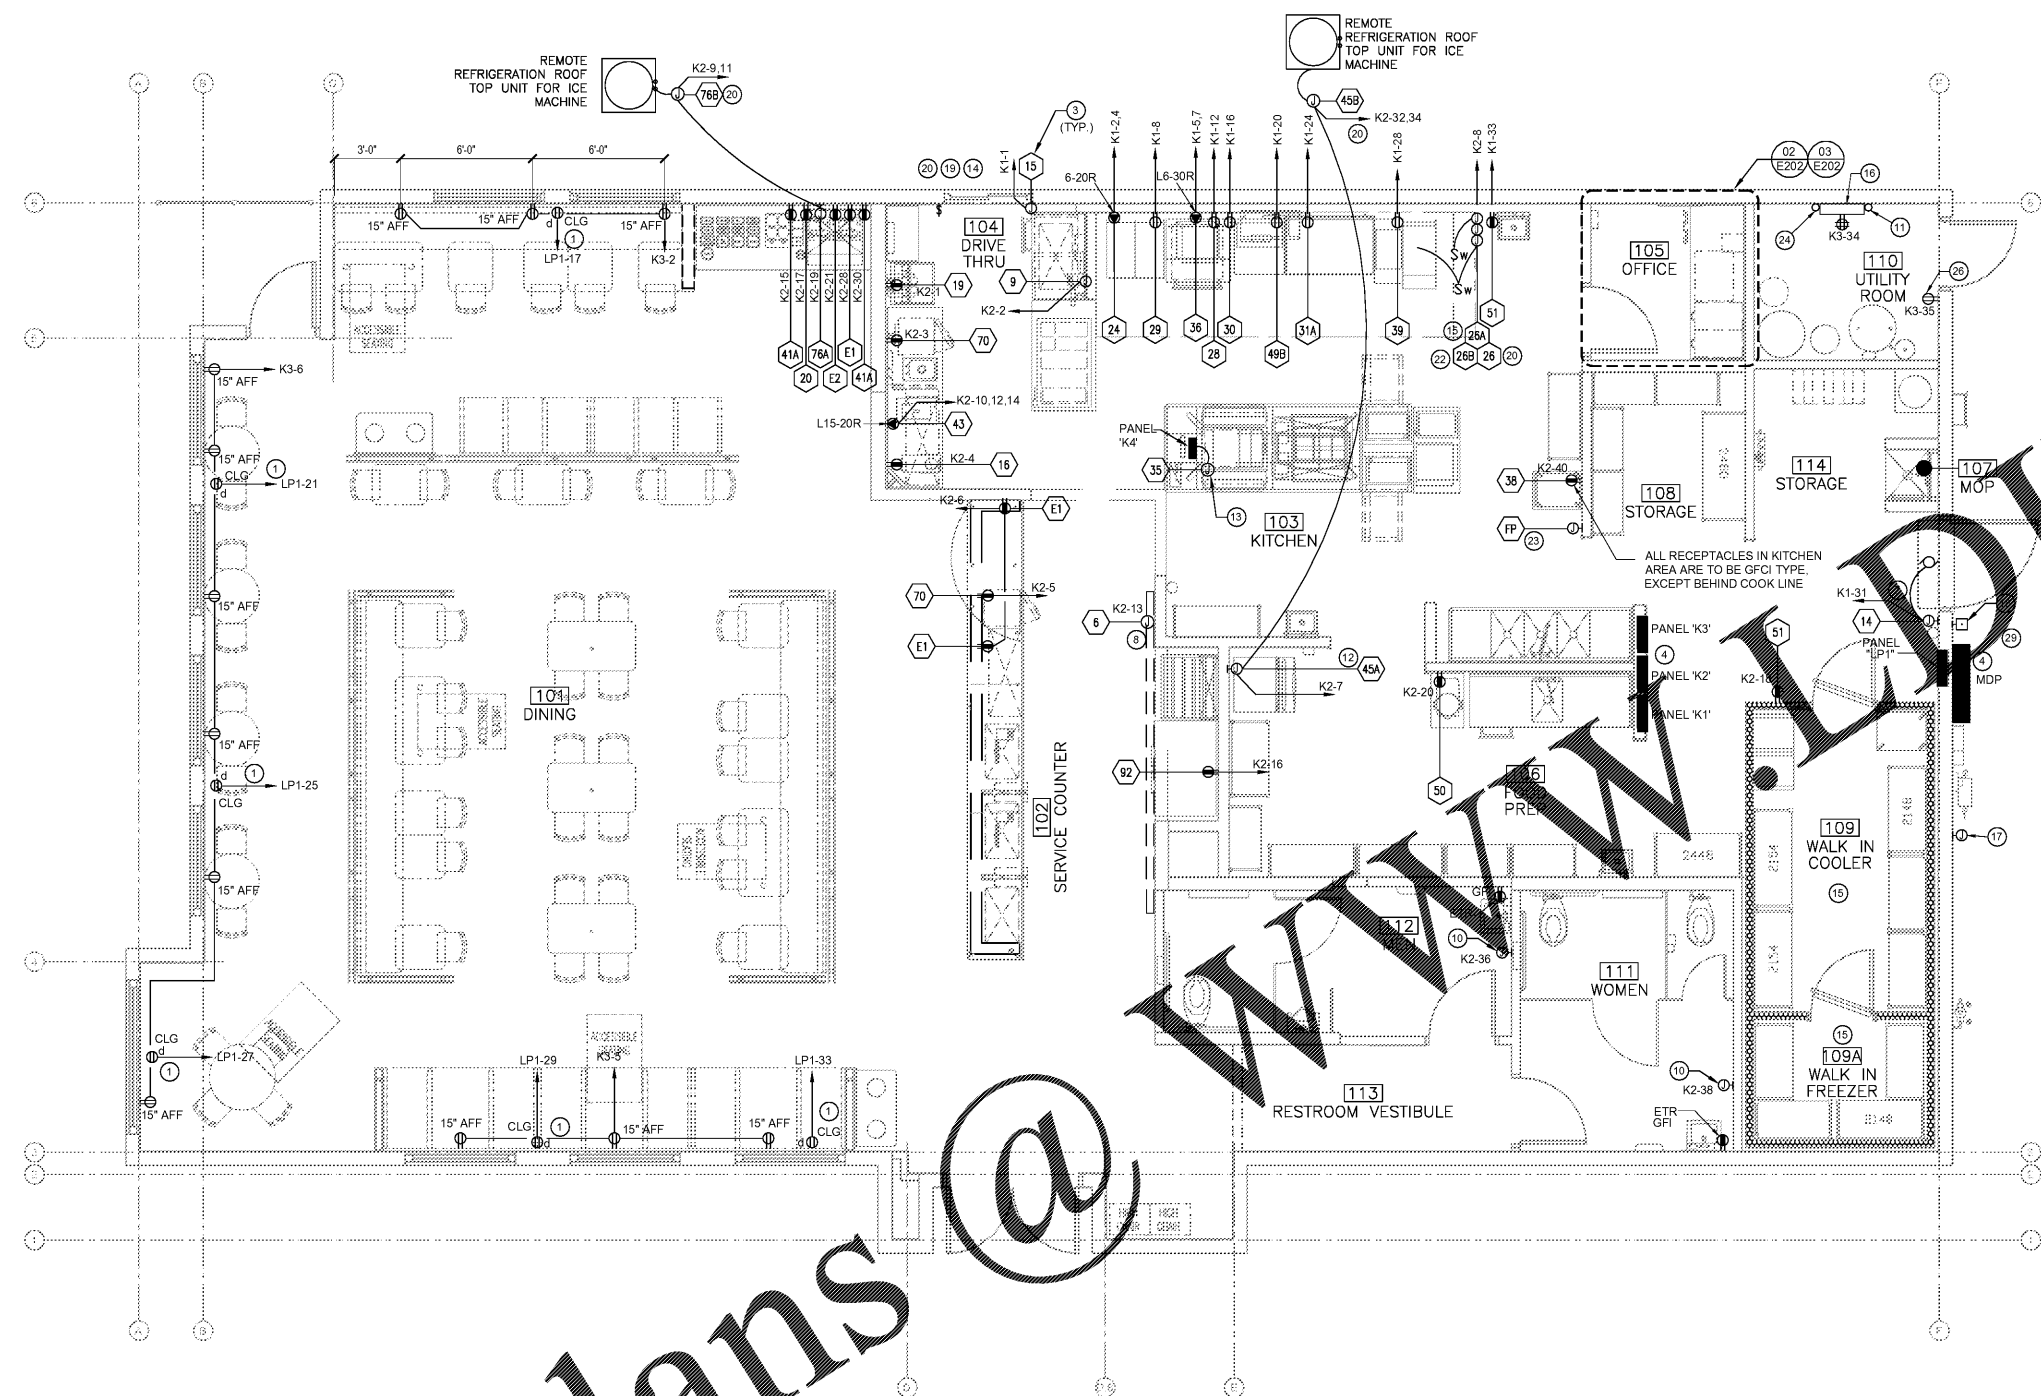

**01 POWER PLAN**  
SCALE: 1/4"=1'-0"

SHEET NO. 01 OF 01  
 DATE: 5/16/2018 9:59 AM  
 PRINTED BY: JIMMY LEE SMITH  
 1200\_2180148\_LEV01.dwg

Order Plans @