


Order Plans

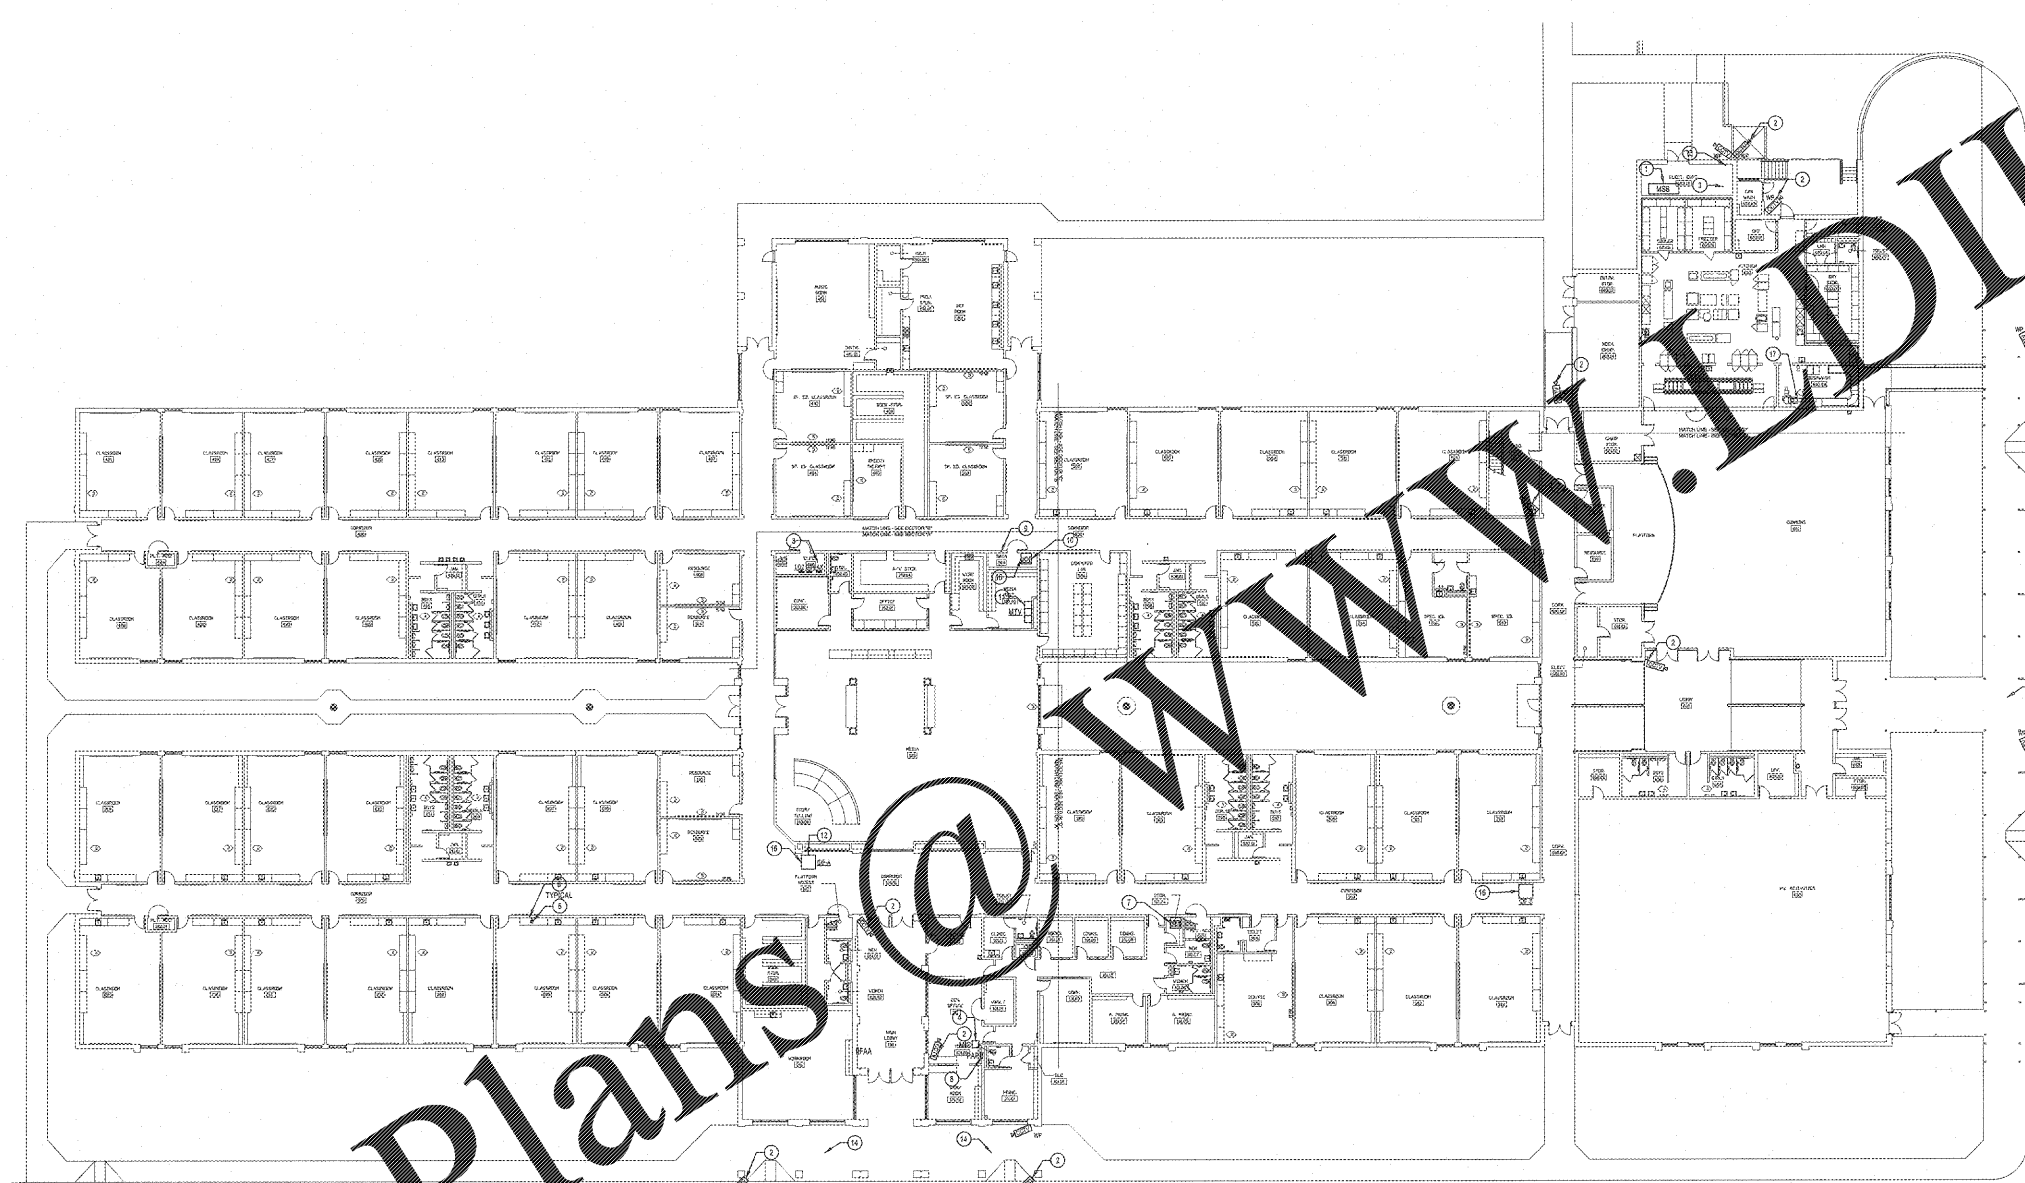


ELECTRICAL OVERALL DEMOLITION PLAN
SCALE: 1"=20'


NOTES: (THIS SHEET ONLY)

1. EXISTING SERVICE BATTERBOARD SHALL REMAIN. SEE NEW WORK PLANS.
2. EXISTING P-BASED VIDEO SURVEILLANCE CAMERA SHALL REMAIN. CONTRACTOR SHALL PROTECT, SECURE, AND MAINTAIN EXISTING CAMERA.
3. EXISTING PANEL OR TRANSFORMER SHALL REMAIN. SEE NEW WORK PLANS.
4. EXISTING INTERCOM SYSTEM CONSOLE SHALL REMAIN IN ITS ENTIRETY. CONTRACTOR SHALL PROTECT, SECURE, AND MAINTAIN EXISTING INTERCOM SYSTEM AND ALL COMPONENTS.
5. DEMOLISH EXISTING TV DISTRIBUTION OUTLET FROM THIS LOCATION AND REMOVE TV DISTRIBUTION CABLE TO THE ABOVE CEILING SPACE. PREPARE EXISTING TV DISTRIBUTION CABLE FOR EXTENSION TO THE NEW CEILING LOCATION.
6. REMOVE EXISTING WALL MOUNTED TV SET AND ASSOCIATED WALL BRACKET IN ITS ENTIRETY. PATCH AND PAINT WALL.
7. EXISTING P-BASED VIDEO SURVEILLANCE SYSTEM HEAD- END EQUIPMENT SHALL REMAIN IN ITS ENTIRETY. CONTRACTOR SHALL PROTECT, SECURE, AND MAINTAIN EXISTING SYSTEM. PREPARE EXISTING FIBER OPTIC CABLE CONNECTIVITY TO THE DATA NETWORK MDF FOR RE-CONNECTION TO THE NEW MDF FIBER OPTIC ENCLOSURE.
8. EXISTING FIRE ALARM PANEL, TO REMAIN IN ITS ENTIRETY. CONTRACTOR SHALL PROTECT, SECURE, AND MAINTAIN EXISTING SYSTEM DURING RENOVATIONS.
9. EXISTING TELEPHONE BACKBOARD SHALL REMAIN. SECURE AND PROTECT ALL EXISTING TELEPHONE SYSTEM EQUIPMENT DURING RENOVATIONS. SYSTEM SHALL REMAIN OPERATIONAL UNTIL NEW TELEPHONE SYSTEM COMES ON LINE. SECURE EXISTING CO LINE ATT.
10. SECURE ALL COMPUTER NETWORK CIRCUIT SWITCHES IN THE MAIN DISTRIBUTION FRAME (MDF). COORDINATE WITH THE DATA NETWORK COMMENCEMENT OF WORK IN THIS AREA. SEE PHASING PLAN AND ACCOMMODATE FOR TEMPORARY RELOCATION DURING PHASED CONSTRUCTION. SYSTEM SHALL REMAIN OPERATIONAL UNTIL NEW SWITCHES COME ON LINE. REMOVE EXISTING CISCO 4506 CHASSIS SWITCH.
11. EXISTING TV DISTRIBUTION HEAD- END EQUIPMENT SHALL REMAIN. CONTRACTOR SHALL PROTECT AND MAINTAIN ALL EQUIPMENT DURING RENOVATIONS.
12. EXISTING CISCO AND DATA NETWORK SWITCH SHALL REMAIN IN THE DISTRIBUTION FRAME IN ITS ENTIRETY. REMOVE EXISTING CISCO 4506 CHASSIS SWITCHES DURING RENOVATIONS. REMOVE EXISTING CISCO 4506 CHASSIS SWITCH.
13. GENERAL: IF ANY LIGHTING, OUTLET, OR DEVICE TO BE REMOVED IS POWERED BY A CIRCUIT UPSTREAM OF OTHER LIGHTING, OUTLET, AND DEVICE TO REMAIN, CONTRACTOR SHALL REMOVE THE EXISTING CIRCUIT, MAINTAIN THE CIRCUIT TO THE DOWNSTREAM DEVICES.
14. REMOVE EXISTING CANOPY LIGHT FIXTURES FROM EXISTING CEILING. PREPARE CANOPY FOR INSTALLATION OF NEW LIGHT FIXTURES. PATCH AND PAINT ALL HOLES TO MATCH.
15. CONTRACTOR SHALL DEMOLISH ALL EXISTING EXTERIOR LIGHTING CIRCUITS. INTERCEPT FOUR EXISTING 120V CIRCUITS AND EXTEND TO NEW EXTERIOR LIGHTING PANEL. REMOVE EXISTING CIRCUITS BACK TO SERVING PANEL.
16. EXISTING DATA NETWORK WITH RELOCATED RACKS AND PATCH PANELS. PATCH POINTS SHALL REMAIN AND BE PREPARED FOR ADDITIONAL PATCHES. SECURE, PROTECT, AND RE-COVER DURING CONSTRUCTION.
17. REMOVE EXISTING TRANSFORMER IN ITS ENTIRETY.

REVISIONS/ISSUANCES		
NO.	DATE	DESCRIPTION



AH&P
CONSULTING
ENGINEERS
ANDREWS, HAMBROCK & POWELL, INC.
250 Chester Lane
Suite 100
MACON, GEORGIA 31210
MACON (478) 416-8001
FAX (478) 416-4210
WWW.AHPENGR.COM



Manley Spangler Smith Architects
A Professional Corporation

525 East Taylor St.
P.O. Box 880
Guthrie, Georgia 30224
Office 770.227.3473
Fax 770.228.3442

PROJECT:
RENOVATIONS,
MODIFICATIONS, &
ADDITIONS TO HENRY
COUNTY SCHOOLS -
GROUP 10
WOOL AND ELEMENTARY
SCHOOL (ITEM A)

CLIENT:
HENRY COUNTY
BOARD OF EDUCATION

SHEET TITLE:
ELECTRICAL OVERALL
DEMOLITION PLAN

LU-65
P.T.E. - 675
FACILITY CODE: 075-0108

PROJECT NUMBER: 201731A
DATE: 06.07.18
SCALE: 1/8"=1'-0"
DRAWN BY: CTS
CHECKED BY: NHO

SHEET NO:
ED001

GENERAL DEMOLITION NOTES

- A. REMOVE ALL EXISTING EXTERIOR LIGHT FIXTURES FROM THE BUILDING. PREPARE EXISTING CIRCUITS FOR CONNECTION TO THE NEW LIGHT FIXTURES SHOWN. ALL EXISTING EXTERIOR LIGHT FIXTURES IN THE BUILDING SHALL REMAIN AND BE PROTECTED. PREPARE EXISTING LIGHTING CIRCUIT QUADRYTES IN ALL INSTRUCTIONAL UNITS TO ROUTE ADDITIONAL CIRCUIT CONDUCTORS FOR ANY WIDE SWITCHING.
- B. REMOVE ALL EXISTING WALL MOUNTED OUTLET DEVICES WHERE NEW DEVICES ARE SHOWN TO BE CONNECTED TO EXISTING CIRCUITS. PREPARE EXISTING CIRCUIT CONDUCTORS FOR CONNECTION TO NEW DEVICES SHOWN ON THE NEW WORK PLANS UNLESS NOTED OTHERWISE. PROVIDE BLANK COVER PLATES FOR ALL ABANDONED IN WALL OUTLET BOXES.
- C. ALL EXISTING ELECTRICAL CIRCUITS FOR TELEPHONE, INTERCOM, TV, SECURITY, FIRE ALARM AND CCTV SHALL BE MAINTAINED IN THE OCCUPIED AREAS DURING RENOVATION UNLESS NOTED OTHERWISE. CONTRACTOR IS CAUTIONED THAT ALL OF THE EXISTING LOW VOLTAGE SYSTEM CABLES IS NOT RUN IN CONDUIT.
- D. REMOVE ALL ELECTRICAL CIRCUITS IN THEIR ENTIRETY FROM ALL MECHANICAL EQUIPMENT SHOWN TO BE DEMOLISHED ON MECHANICAL DEMOLITION PLANS, INCLUDING ROOF TOP UNITS, EXHAUST FANS, WALL HEATERS, WATER SOURCE HPS AND PUMPS, ETC. MECHANICAL EQUIPMENT SHOWN TO BE REMOVED AND REINSTALLED DURING CONSTRUCTION ON MECHANICAL PLANS SHALL BE DISCONNECTED AND RECONNECTED TO THE EXISTING ELECTRICAL CIRCUITS.
- E. ALL EXISTING COMPUTER DATA AND TELEPHONE OUTLETS, CABLES, AND RACKWAYS SHALL REMAIN UNLESS NOTED OTHERWISE OR NEW SHOWN. CONTRACTOR SHALL BE RESPONSIBLE FOR THE PROTECTION OF EXISTING DATA OUTLETS AND ALL ASSOCIATED DATA NETWORKING ELECTRONIC EQUIPMENT DURING DEMOLITION AND RENOVATIONS OF ALL AREAS.
- F. ALL EXISTING FIRE ALARM SYSTEM DEVICES INCLUDING CONTROL PANELS, SMOKE DETECTORS, HORN, STROBES AND ETC. SHALL REMAIN IN THEIR ENTIRETY UNLESS NOTED OTHERWISE.
- G. ALL EXISTING TV DISTRIBUTION SYSTEM CABLES INCLUDING ALL TV HEAD- END EQUIPMENT ETC. SHALL REMAIN. SECURE TV DISTRIBUTION CABLE DURING CONSTRUCTION. PREPARE EXISTING HEAD- END EQUIPMENT FOR CONNECTION TO ANY NEW TV DISTRIBUTION CABLES UNLESS NOTED OTHERWISE. REMOVE ALL WALL MOUNTED TV OUTLETS FROM ALL SPACES. PREPARE EXISTING TV DISTRIBUTION CABLES TO BE EXTENDED TO THE NEW TV OUTLET LOCATIONS AT THE CEILING MOUNTED PROJECTS. PROVIDE BLANK COVER PLATES FOR UNUSED WALL BOXES.
- H. ALL EXISTING INTERCOM SYSTEM COMPONENTS INCLUDING SPEAKERS, CLOCKS, HANDSETS, PUSH BUTTONS, CABLES, AND RACKWAYS ETC. SHALL REMAIN IN THEIR ENTIRETY UNLESS NOTED OTHERWISE. CONTRACTOR SHALL PROTECT AND SECURE ALL COMPONENTS.
- I. ALL EXISTING CCTV (VIDEO SURVEILLANCE) SYSTEM CAMERAS AND RECORDER HEAD- END EQUIPMENT INCLUDING DVR, MONITORS AND CABLES SHALL REMAIN. SECURE, PROTECT, AND RE-MOUNT EXISTING P-BASED SURVEILLANCE CAMERAS IN NEW CEILING TILES.
- J. ALL EXISTING WALL MOUNTED CRT TV SETS INCLUDING TV BRACKETS AND ASSOCIATED S-WEEG OUTLETS WITH CABLES SHALL BE REMOVED IN THEIR ENTIRETY FROM THE BUILDING. PATCH AND PAINT WALLS TO MATCH EXISTING. TV SETS ARE LOCATED IN ALL CLASSROOMS, MAIN OFFICES, COMMONS, AND ETC.
- K. ALL EXISTING NEWLY INSTALLED WIRELESS DATA NETWORK ACCESS POINTS AND ASSOCIATED CABLES SHALL REMAIN. THE CONTRACTOR SHALL SECURE, PROTECT, AND RE-MOUNT ALL AS NECESSARY ALL EXISTING ACCESS POINTS AND CABLES.

NOTE TO CONTRACTOR CONCERNING PROJECT PHASING:
THE WORK SPECIFIED ON THE DRAWINGS AND SPECIFICATIONS ILLUSTRATES THE COMPLETED CONTRACTOR REQUIREMENTS. THIS PROJECT IS PHASED IN MULTIPLE PHASES. THE AREA OF EACH PHASE IS DESCRIBED IN THE ARCHITECTURAL DOCUMENTS AND THE CONTRACTOR SHALL REVIEW THESE PHASING REQUIREMENTS. CONTRACTOR SHALL INCLUDE IN HIS BID COSTS NECESSARY TO ACCOMPLISH THE CONTRACT PHASING. THE CONTRACT DOCUMENTS DO NOT DESCRIBE THE SPECIFIC WORK REQUIRED BY THE CONTRACTOR TO PERFORM THE PROJECT IN PHASES, BUT CONTRACTOR SHALL PREPARE PHASING PLAN AND SUBMIT TO ARCHITECT, ENGINEER, AND HENRY COUNTY MAINTENANCE DEPARTMENT PRIOR TO BEGINNING WORK.