


NOTES: (THIS SHEET ONLY)

- 1 GENERAL: ALL EMERGENCY EGRESS LIGHT FIXTURES, ELOI NORMAL POWER BEARING CIRCUIT, AND EXIT SIGNS SHALL BE UNINTERRUPTED.
- 2 GENERAL: CLASSROOM LIGHTS SHALL SWITCH FRONT TWO ROWS OF LIGHTS, CLOSEST TO MAINER ROWS AND INTERCEPT PROTECTION ON ONE SWITCH AND BACK ROW OF LIGHTS (2 SWITCHES FOR CLASSROOM AV MODE LIGHTING). EXISTING LIGHTING FIXTURES ARE AS SHOWN IN CLASSROOMS.
- 3 INTERCEPT EXISTING LIGHTING CIRCUITS IN ABOVE CEILING LIGHTING JUNCTION BOXES TO PROVIDE ROW SWITCHING AS NOTED. UTILIZE 2P/2C, #12S, 120V TO EXTEND AND MAKE CONNECTION TO EXISTING 277V LIGHTING CIRCUIT.
- 4 INSTALL LIGHTING CONTROL SYSTEM OVERRIDE STATION AT THIS LOCATION. LABEL BUTTON WITH CONTROLLED AREA.
- 5 PROVIDE NEW LIGHT SWITCH CONDUCTOR IN EXISTING 1/2" RACEWAY FOR ROW SWITCHING AS NOTED. THE NEW CONDUCTOR SHALL BE RIGIDLY TIED TO THE EXISTING CONDUCTORS TO REMAIN IN PLACE. PROTECT EXISTING CONDUCTORS DURING INSTALLATION.
- 6 PROVIDE NEW SWITCHES IN EXISTING RECESSED SWITCH LOCATION. OUT, PATUR AND PAINT WALLS TO METAL NEW MULTI-GANG SWITCH BOX FOR ADDITIONAL SWITCH IN EXISTING WALLS. UTILIZE EXISTING IN-WALL RACEWAY SYSTEM TO ROUTE NEW CONDUCTORS FOR ROW SWITCHING.
- 7 PROVIDE LINE VOLTAGE OCCUPANCY SENSOR AS SHOWN. INTERCEPT EXISTING CIRCUIT UTILIZING #12, #10R, 120V. MAKE ALL CONNECTIONS.
- 8 CONTRACTOR SHALL UTILIZE 2P/2C, #12S, 120V AND MAKE CONNECTION TO EXISTING 277V EGRESS LIGHTING CIRCUIT.

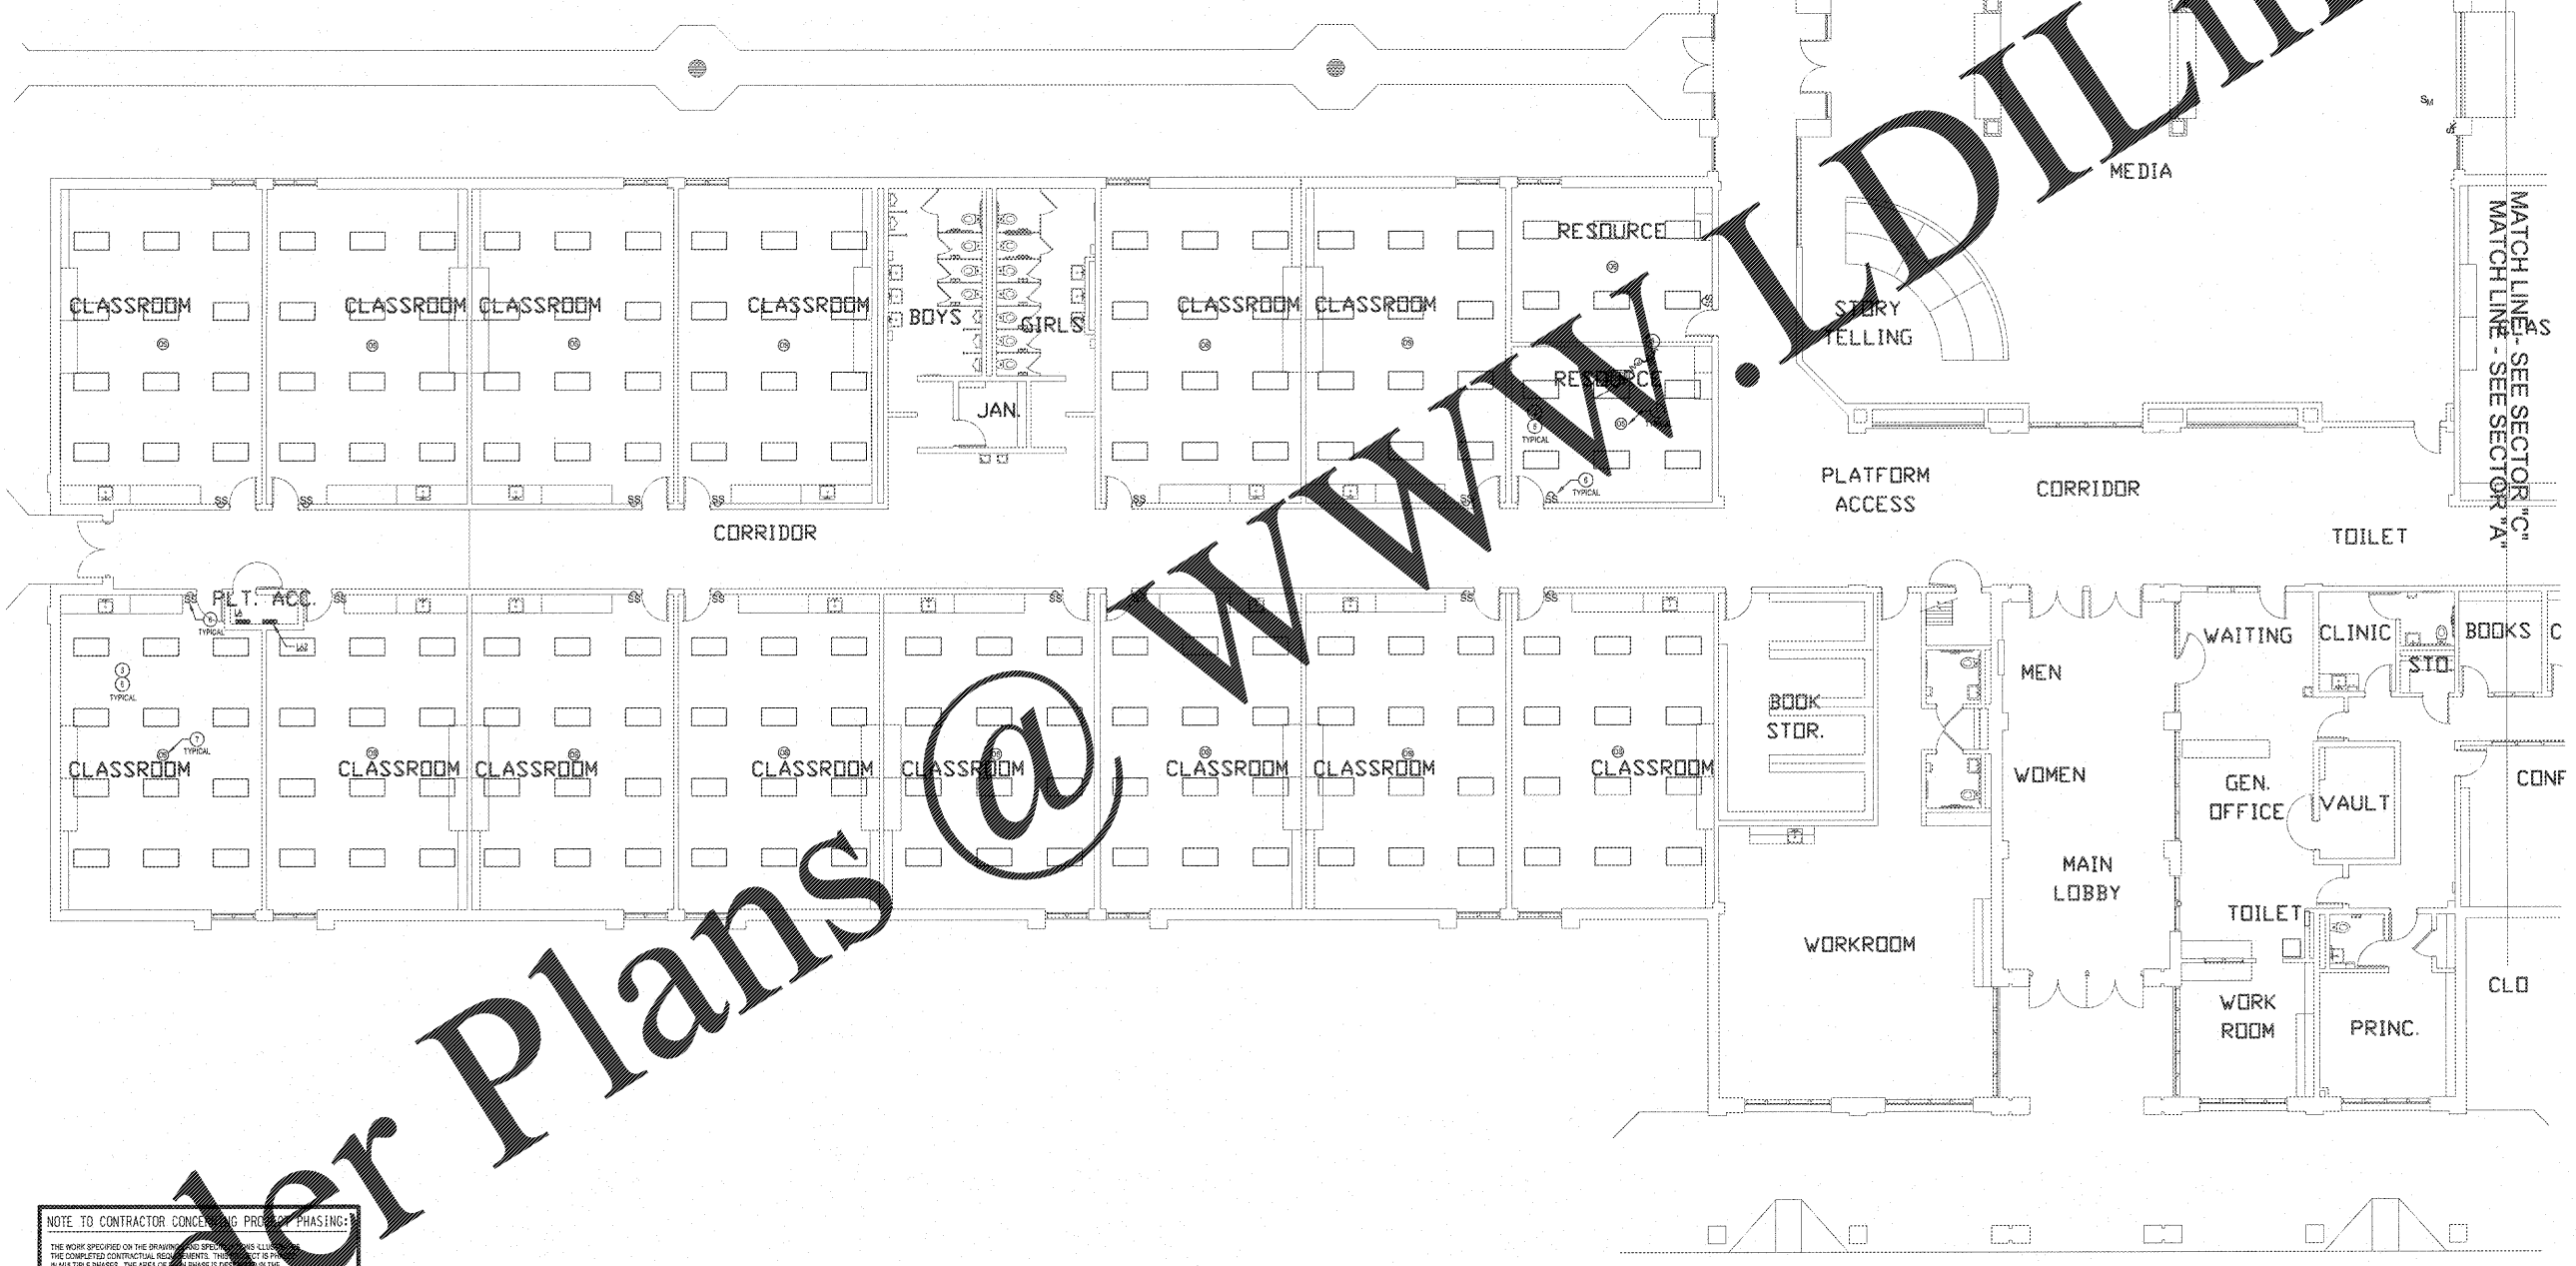

REVISIONS/ISSUANCES		
NO.	DATE	DESCRIPTION

KEYPLAN

N

AH&P CONSULTING ENGINEERS
ANDREWS, HAMMOCK & POWELL, INC.
250 Charter Lane
Suite 107
Macon, Georgia 31210
Macon (478) 405-8201
FAX (478) 405-8210
WWW.AHPENR.COM

STATE OF GEORGIA REGISTERED ARCHITECT

Manley Spangler Smith Architects
A Professional Corporation

525 East Taylor St.
P.O. Box 888
Coffey, Georgia 30224
Office 770.227.5473
Fax 770.228.3442

PROJECT: RENOVATIONS, MODIFICATIONS, & ADDITIONS TO HENRY COUNTY SCHOOLS - GROUP 10 WOODLAND ELEMENTARY SCHOOL (ITEM A)

CLIENT: HENRY COUNTY BOARD OF EDUCATION

SHEET TITLE: ELECTRICAL NEW WORK LIGHTING PLAN - SECTOR 'A'

DATE: 06.07.18

SCALE: 1/8"=1'-0"

DRAWN BY: AIS
CHECKED BY: MKD

SHEET NO.: E101

NOTE TO CONTRACTOR CONCERNING PHASING:

THE WORK SPECIFIED ON THE DRAWINGS IS TO BE COMPLETED IN PHASES AS SHOWN. THE CONTRACTOR SHALL BE RESPONSIBLE FOR THE PHASING OF THE WORK AND SHALL MAINTAIN ACCESS TO ALL EXISTING UTILITIES AND SERVICES AT ALL TIMES. THE CONTRACTOR SHALL BE RESPONSIBLE FOR THE PROTECTION AND REPAIR OF ALL EXISTING UTILITIES AND SERVICES. THE CONTRACTOR SHALL BE RESPONSIBLE FOR THE PROTECTION AND REPAIR OF ALL EXISTING UTILITIES AND SERVICES. THE CONTRACTOR SHALL BE RESPONSIBLE FOR THE PROTECTION AND REPAIR OF ALL EXISTING UTILITIES AND SERVICES.

GENERAL LIGHTING NOTE

EXISTING LIGHTING CIRCUITS WITHIN BUILDINGS SHALL BE Labeled TO POWER NEW LIGHTING. SOME EXISTING CIRCUITS MAY BE SHARED WITH OTHERS. THE CONTRACTOR SHALL BE RESPONSIBLE FOR IDENTIFYING EXISTING CIRCUITS, UNDER THIS PROJECT OCCUPANCY SENSORS AND DEDICATED LIGHTING CONTROL PANELS SHALL BE INSTALLED. THE EXISTING CIRCUITS AND LIGHTING CIRCUITS SHALL BE INTERCEPTED WITHIN ELECTRICAL ROOM AND RECONNECTED VIA NEW DEDICATED LIGHTING CONTROL PANEL. EXISTING CIRCUIT AND WIRING MAY BE UTILIZED WHERE IT MEETS THIS SPECIFICATION.

ELECTRICAL NEW WORK LIGHTING PLAN - SECTOR 'A'

SCALE: 1/8"=1'-0"