NOTES: (POWER PLAN ONLY)

1. PROVIDE OUTLETS IN METAL CEILING PANEL ENCLOSURE AS SPECIFIED WITH PROJECTOR MOUNT. COORDINATE EXACT LOCATION WITH ARCHITECTURAL REFLECTED CEILING PLANS, LIGHT FIXTURES, ELECTRICAL CEILING MOUNTED DEVICES AND WHITE BOARD.
2. PROVIDE AUDIO VISUAL CONNECTIVITY, PROJECTOR, AND MOUNTING HARDWARE AS SPECIFIED AND SHOWN IN THE DETAIL.
3. CONTRACTOR SHALL ROUTE 3#12, #12G IN 1/2" C TO DESIGNATED PANEL. PROVIDE 20A/1P BREAKER FOR EACH HOMERUN IN PANEL AND MAKE CONNECTIONS.
4. EXISTING SIEMENS, TYPE P1, 120/208v, 3PH, 4W, PANELBOARD
5. COORDINATE EXACT LOCATION AND MOUNTING HEIGHT OF HAND DRYER J-BOX WITH ARCHITECTURAL PLANS.
6. CONTRACTOR SHALL ROUTE 3#10, #10G IN 3/4" C TO DESIGNATED PANEL. PROVIDE 20A/1P BREAKER FOR EACH HOMERUN IN PANEL AND MAKE CONNECTIONS.

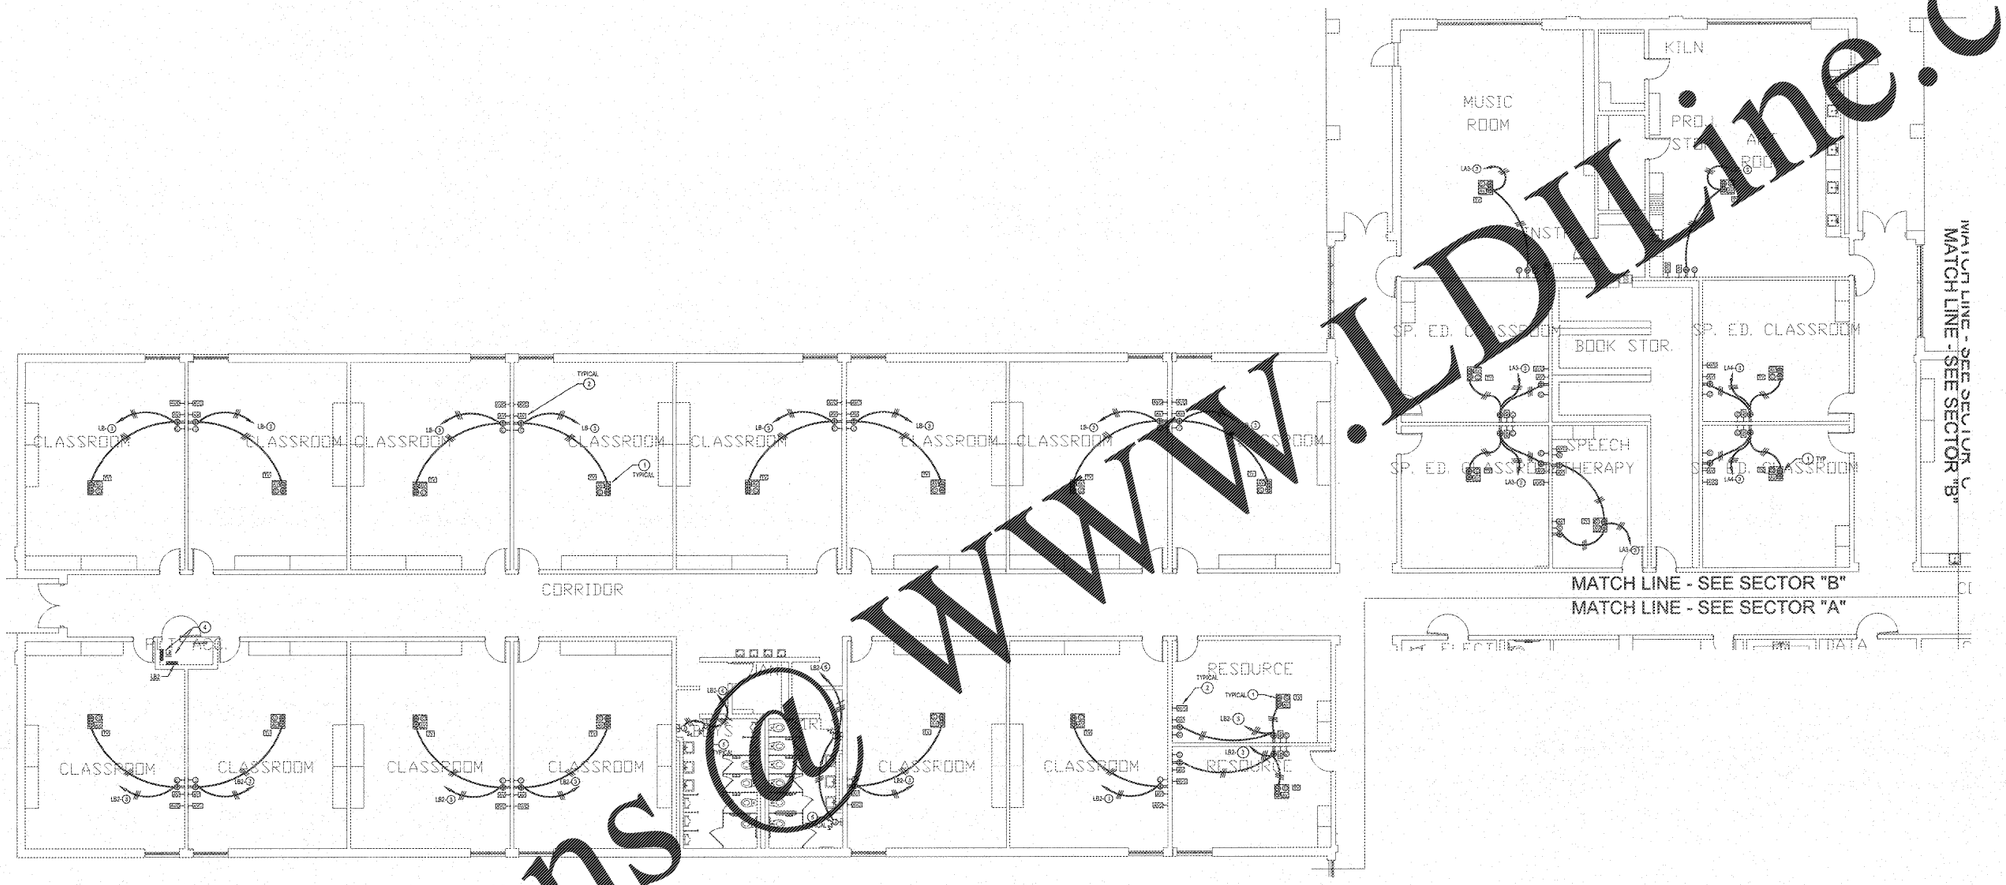

NOTE TO CONTRACTOR CONCERNING PROJECT PHASING:

THE WORK SPECIFIED ON THE DRAWINGS AND SPECIFICATIONS ILLUSTRATES THE COMPLETED CONTRACTUAL REQUIREMENTS. THIS PROJECT IS PHASED IN MULTIPLE PHASES. THE AREA OF EACH PHASE IS DESCRIBED IN THE ARCHITECTURAL DOCUMENTS AND THE CONTRACTOR SHALL REVIEW THESE PHASING REQUIREMENTS. CONTRACTOR SHALL INCLUDE IN HIS BID ALL COSTS REQUIRED TO ACCOMPLISH THE CONTRACT IN PHASES. THE CONTRACT DOCUMENTS DO NOT DESCRIBE THE SPECIFIC WORK REQUIRED BY THE CONTRACTOR TO PERFORM THE PROJECT IN PHASES, BUT CONTRACTOR SHALL PREPARE PHASING PLAN AND [illegible] ARCHITECT/ENGINEER AND HENRY COUNTY MAINTENANCE DEPARTMENT PRIOR TO BEGINNING WORK.

GENERAL NOTES

1. [illegible] DRAWN (WITHOUT [illegible]) AND [illegible] TO REMAIN. CONTRACTOR SHALL PROVIDE NEW [illegible] PLATES AS SPECIFIED. [illegible] CONNECTIONS TO EXISTING CIRCUITS [illegible] CONDITIONS, EXTEND EXISTING [illegible] AS NECESSARY.
2. [illegible] CIRCUITS [illegible] AND UTILIZING CONDUIT SYSTEM FOR GROUNDING PATH, THE CONTRACTOR [illegible] AND VERIFY CONTINUITY OF THE GROUNDING PATH. IF THE EXISTING [illegible] GROUNDING PATH IS DETERMINED TO BE NON-CONTINUOUS, THE CONTRACTOR SHALL REMEDY THAT BY PROVIDING #12 GROUNDING CONDUCTOR IN EXISTING CONDUIT BACK TO PANEL.
3. ELECTRICAL INSTALLATIONS ON EXISTING WALLS SHALL HAVE CIRCUITS INSTALLED CONCEALED WITHIN MASONRY. CONTRACTOR SHALL NOT, UNDER ANY CIRCUMSTANCE, [illegible] SURFACE METAL RACEWAY TO INSTALL NEW DEVICES (LINE VOLTAGE OR LOW VOLTAGE). BOXES SHALL BE CUT INTO EXISTING MASONRY WITH FLEX CONDUIT FISHED IN EXISTING WALL FROM ABOVE ACCESSIBLE CEILING.
4. LOW VOLTAGE SYSTEMS OUTLETS SHOWN FOR INSTALLATION COORDINATION PURPOSES ONLY. SEE APPLICABLE LOW VOLTAGE PLAN OR PLAN FOR OTHER REQUIREMENTS

ELECTRICAL NEW WORK POWER PLAN - SECTOR 'B'

SCALE: 1/8"=1'-0"

Order Plans @ WWW.LDILine.com

REVISIONS/ISSUANCES

NO.	DATE	DESCRIPTION

KEYPLAN



AH&P CONSULTING ENGINEERS
ANDREVIS, HAMMOCK & POWELL, INC.
250 Chester Lane
Suite 100
MACON, GEORGIA 31210
MACON (478) 405-8201
FAX (478) 405-8210
WWW.AHPENGR.COM

Manley Spangler Smith Architects
A Professional Corporation

525 East Taylor St.
P.O. Box 880
Griffin, Georgia 30224

Office 770.227.5473
Fax 770.228.3442

PROJECT:
RENOVATIONS, MODIFICATIONS, & ADDITIONS TO HENRY COUNTY SCHOOLS - GROUP 10
WOODLAND ELEMENTARY SCHOOL (ITEM A)

CLIENT:
HENRY COUNTY BOARD OF EDUCATION

SHEET TITLE:
ELECTRICAL NEW WORK POWER PLAN - SECTOR 'B'

I.U. : .55
F.T.E. : .875
FACILITY CODE: 678-0108

© 2018 Manley Spangler Smith Architects, PC

PROJECT NUMBER:	201731A
DATE:	06.07.18
SCALE:	1/8"=1'-0"
DRAWN BY:	AJS
CHECKED BY:	NHD

SHEET NO.:
E202