



REVISIONS / ISSUANCES		
NO.	DATE	DESCRIPTION



AH&P
CONSULTING ENGINEERS
ANDREWS, HAMMOCK & POWELL, INC.
282 Charter Lane
Suite 100
Macon, Georgia 31210
Macon (478) 465-8301
FAX (478) 465-8210
WWW.AHPENG.COM



Manley Spangler Smith Architects
A Professional Corporation

525 East Taylor St.
P.O. Box 880
Griffin, Georgia 30224
Office 770.227.5473
Fax 770.228.3442


PROJECT:
RENOVATIONS,
MODIFICATIONS, &
ADDITIONS TO HENRY
COUNTY SCHOOLS -
GROUP 10
WOODLAND HIGH SCHOOL -
GROUP C

CLIENT:
HENRY COUNTY
BOARD OF EDUCATION

SHEET TITLE:
ELECTRICAL NEW WORK
LIGHTING PLAN -
SECTOR "H"

1.1.1: 88
P.T.E.: 1.887
FACILITY CODE: 475-0428
© 2019 Manley Spangler Smith Architects, PC
PROJECT NUMBER: 2017310
DATE: 06.07.19
SCALE: 1/8"=1'-0"
DRAWN BY: AJS
CHECKED BY: MJD

SHEET NO.:
E111

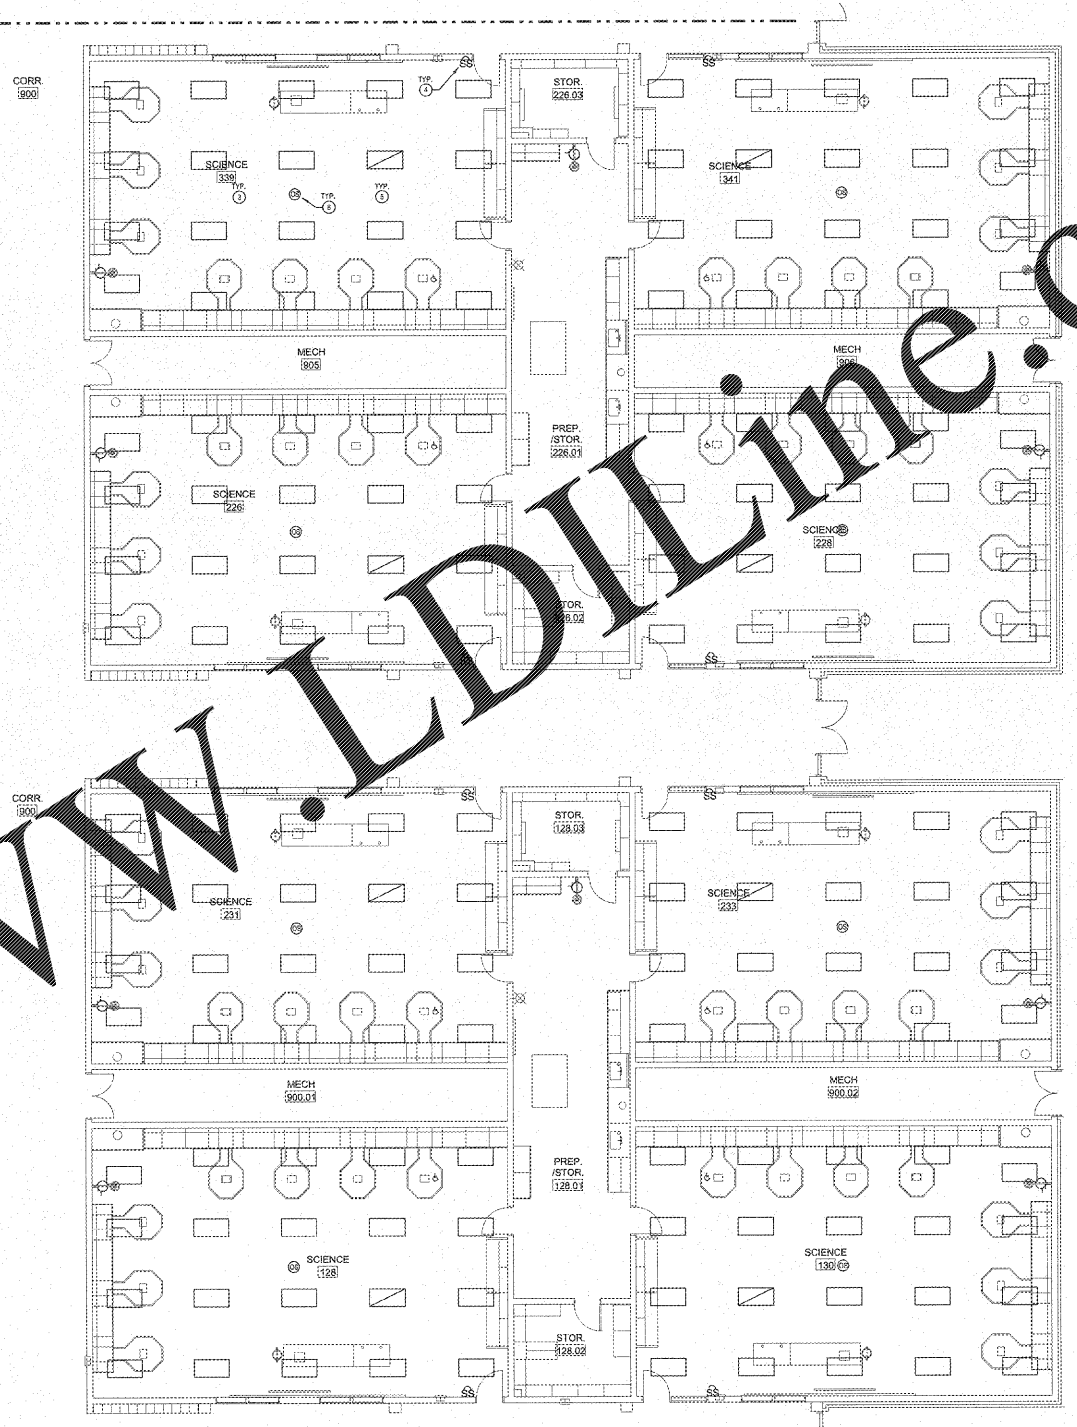

ELECTRICAL NEW WORK LIGHTING PLAN - SECTOR "H"
SCALE: 1/8"=1'-0"

GENERAL LIGHTING NOTE
UNDER THIS PROJECT OCCUPANCY SENSORS SHALL BE INSTALLED. EXISTING 277V LIGHTING CIRCUITS WITHIN BUILDING SHALL BE UTILIZED TO POWER EXISTING LIGHTING. SOME AREAS REQUIRING EXISTING LIGHTING CIRCUIT WITHIN SPACES WHERE OTHERS MAY CONNECT DIRECTLY TO EXISTING EXTERIOR CIRCUITS. EXISTING CONDUIT AND WIRING MAY BE UTILIZED WHERE IT MEETS THE SPECIFICATION.

NOTE TO CONTRACTOR CONCERNING PROJECT PHASING:
THE WORK SPECIFIED ON THE DRAWINGS AND SPECIFICATIONS ILLUSTRATED IN THIS PROJECT IS PHASED. THE AREA OF EACH PHASE IS DESCRIBED IN THE ARCHITECTURAL DOCUMENTS AND THE CONTRACTOR SHALL REVIEW THESE PHASING REQUIREMENTS. CONTRACTOR SHALL INCLUDE IN HIS BID ALL COSTS REQUIRED TO ACCOMPLISH THE PHASING. THE CONTRACT DOCUMENTS DO NOT DESCRIBE THE SPECIFIC WORK REQUIRED BY THE CONTRACTOR TO PHASE THE PROJECT IN PHASES, BUT CONTRACTOR SHALL PREPARE PHASING PLAN AND SUBMIT TO ARCHITECT/ENGINEER AND HENRY COUNTY MAINTENANCE DEPARTMENT PRIOR TO BEGINNING WORK.

- NOTES: (THIS SHEET ONLY)**
- GENERAL: ALL EMERGENCY EXISTING LIGHT FIXTURES, BLUO NORMAL POWER BEARING CIRCUIT, AND EXIT SIGNS SHALL BE RELOCATED.
 - GENERAL: CLASSROOM LIGHTS SHALL SWITCH FRONT TWO ROWS OF LIGHTS, CLOSEST TO MARKER BOARD AND INTERACTIVE PROJECTOR, ON ONE SWITCH AND BACK ROW OF LIGHTS ON OTHER FOR CLASSROOM AND NOCE LIGHTING. EXISTING LIGHTING FIXTURES ARE AS SHOWN IN CLASSROOMS.
 - INTERCEPT EXISTING LIGHTING CIRCUITS IN ABOVE CEILING LIGHTING JUNCTION BOXES TO PROVIDE ROW SWITCHING AS NOTED. UTILIZE 3/4" x 1/2" PVC, 1/2" TO 3/4" EXISTING AND MAKE CONNECTION TO EXISTING 277V LIGHTING CIRCUIT.
 - PROVIDE NEW SWITCHES IN EXISTING RECESSED SWITCH LOCATION. CUT, PATCH AND PAINT WALLS TO INSTALL NEW MULTI-GANG SWITCH BOX FOR ADDITIONAL SWITCH IN EXISTING WALLS. UTILIZE EXISTING IN-WALL RACEWAY SYSTEM TO ROUTE NEW CONDUCTORS FOR ROW SWITCHING.
 - PROVIDE NEW LIGHT SWITCH CONDUCTOR IN EXISTING 1" RACEWAY FOR ROW SWITCHING AS NOTED. THE NEW CONDUCTOR SHALL BE INSTALLED WITH THE EXISTING CONDUCTORS TO REMAIN IN PLACE. PROTECT EXISTING CONDUCTORS DURING INSTALLATION.
 - PROVIDE LINE VOLTAGE OCCUPANCY SENSOR AS SHOWN. INTERCEPT EXISTING CIRCUIT UTILIZING #12, #10, 1/2". MAKE ALL CONNECTIONS.

Order Plans @ www.wldline.com