


REVISIONS/ISSUANCES		
NO.	DATE	DESCRIPTION

KEYPLAN

**AH&P**  
CONSULTING ENGINEERS  
ANDREWS, HAMMOCK & POWELL, INC.  
250 Charter Lane  
Suite 100  
Macon, Georgia 31210  
Macon (478) 455-8301  
FAX (478) 455-8210  
WWW.AHPENR.COM



**Manley Spangler Smith Architects**  
A Professional Corporation

525 East Taylor St.  
P.O. Box 800  
Gresham, Georgia 30224  
Office 770.227.5473  
Fax 770.225.3442

PROJECT:  
RENOVATIONS,  
MODIFICATIONS, &  
ADDITIONS TO HENRY  
COUNTY SCHOOLS -  
GROUP 10  
WOODLAND HIGH SCHOOL  
(ITEM C)


CLIENT:  
HENRY COUNTY  
BOARD OF EDUCATION

SHEET TITLE:  
NEW WORK POWER  
PLAN - SECTOR "B"

LL: 88  
P.T.E.: 1,897  
FACILITY CODE: 075-6408  
© 2019 Manley Spangler Smith Architects, P.C.  
PROJECT NUMBER: 201731/C  
DATE: 08.07.18  
SCALE: 1/8"=1'-0"  
DRAWN BY: AJG  
CHECKED BY: RHO  
SHEET NO.: E204

**NOTES: (POWER PLAN ONLY)**

- PROVIDE OUTLETS IN METAL CEILING PANEL ENCLOSURE AS SPECIFIED WITH PROJECTOR MOUNT. COORDINATE EXACT LOCATION WITH ARCHITECTURAL REFLECTED CEILING PANEL LIGHT FIXTURES, ELECTRICAL CEILING MOUNTED DEVICES AND WHITE BOARD.
- PROVIDE AUDIO VISUAL CONNECTIVITY, PROJECTOR, AND MOUNTING HARDWARE AS SPECIFIED AND SHOWN IN THE DETAIL.
- CONTRACTOR SHALL ROUTE 3PH, 4WYE IN 1/2" C TO DESIGNATED PANEL. PROVIDE 250HP BREAKER FOR EACH NUMBER IN PANEL AND MAKE CONNECTIONS.
- ROUTE 120V, 120V, 120V AND MAKE POWER CONNECTION TO EXISTING TEACHERS COMPUTER CIRCUIT ABOVE CEILING.
- SMOKE DAMPER INTERFACES SHALL BE SUBMITTED WITH FIRE ALARM SYSTEM. MAKE CONNECTIONS TO AND THROUGH RELAY AS REQUIRED.
- CONTRACTOR SHALL ROUTE 3PH, 4WYE IN 1/2" C TO DESIGNATED PANEL. PROVIDE 250HP BREAKER FOR EACH NUMBER IN PANEL AND MAKE CONNECTIONS.
- EXISTING 66, TYPE 12F, 120/208V, 3PH, 4W, PANELBOARD.
- EXISTING 30, TYPE 12F, 120/208V, 3PH, 4W, PANELBOARD.

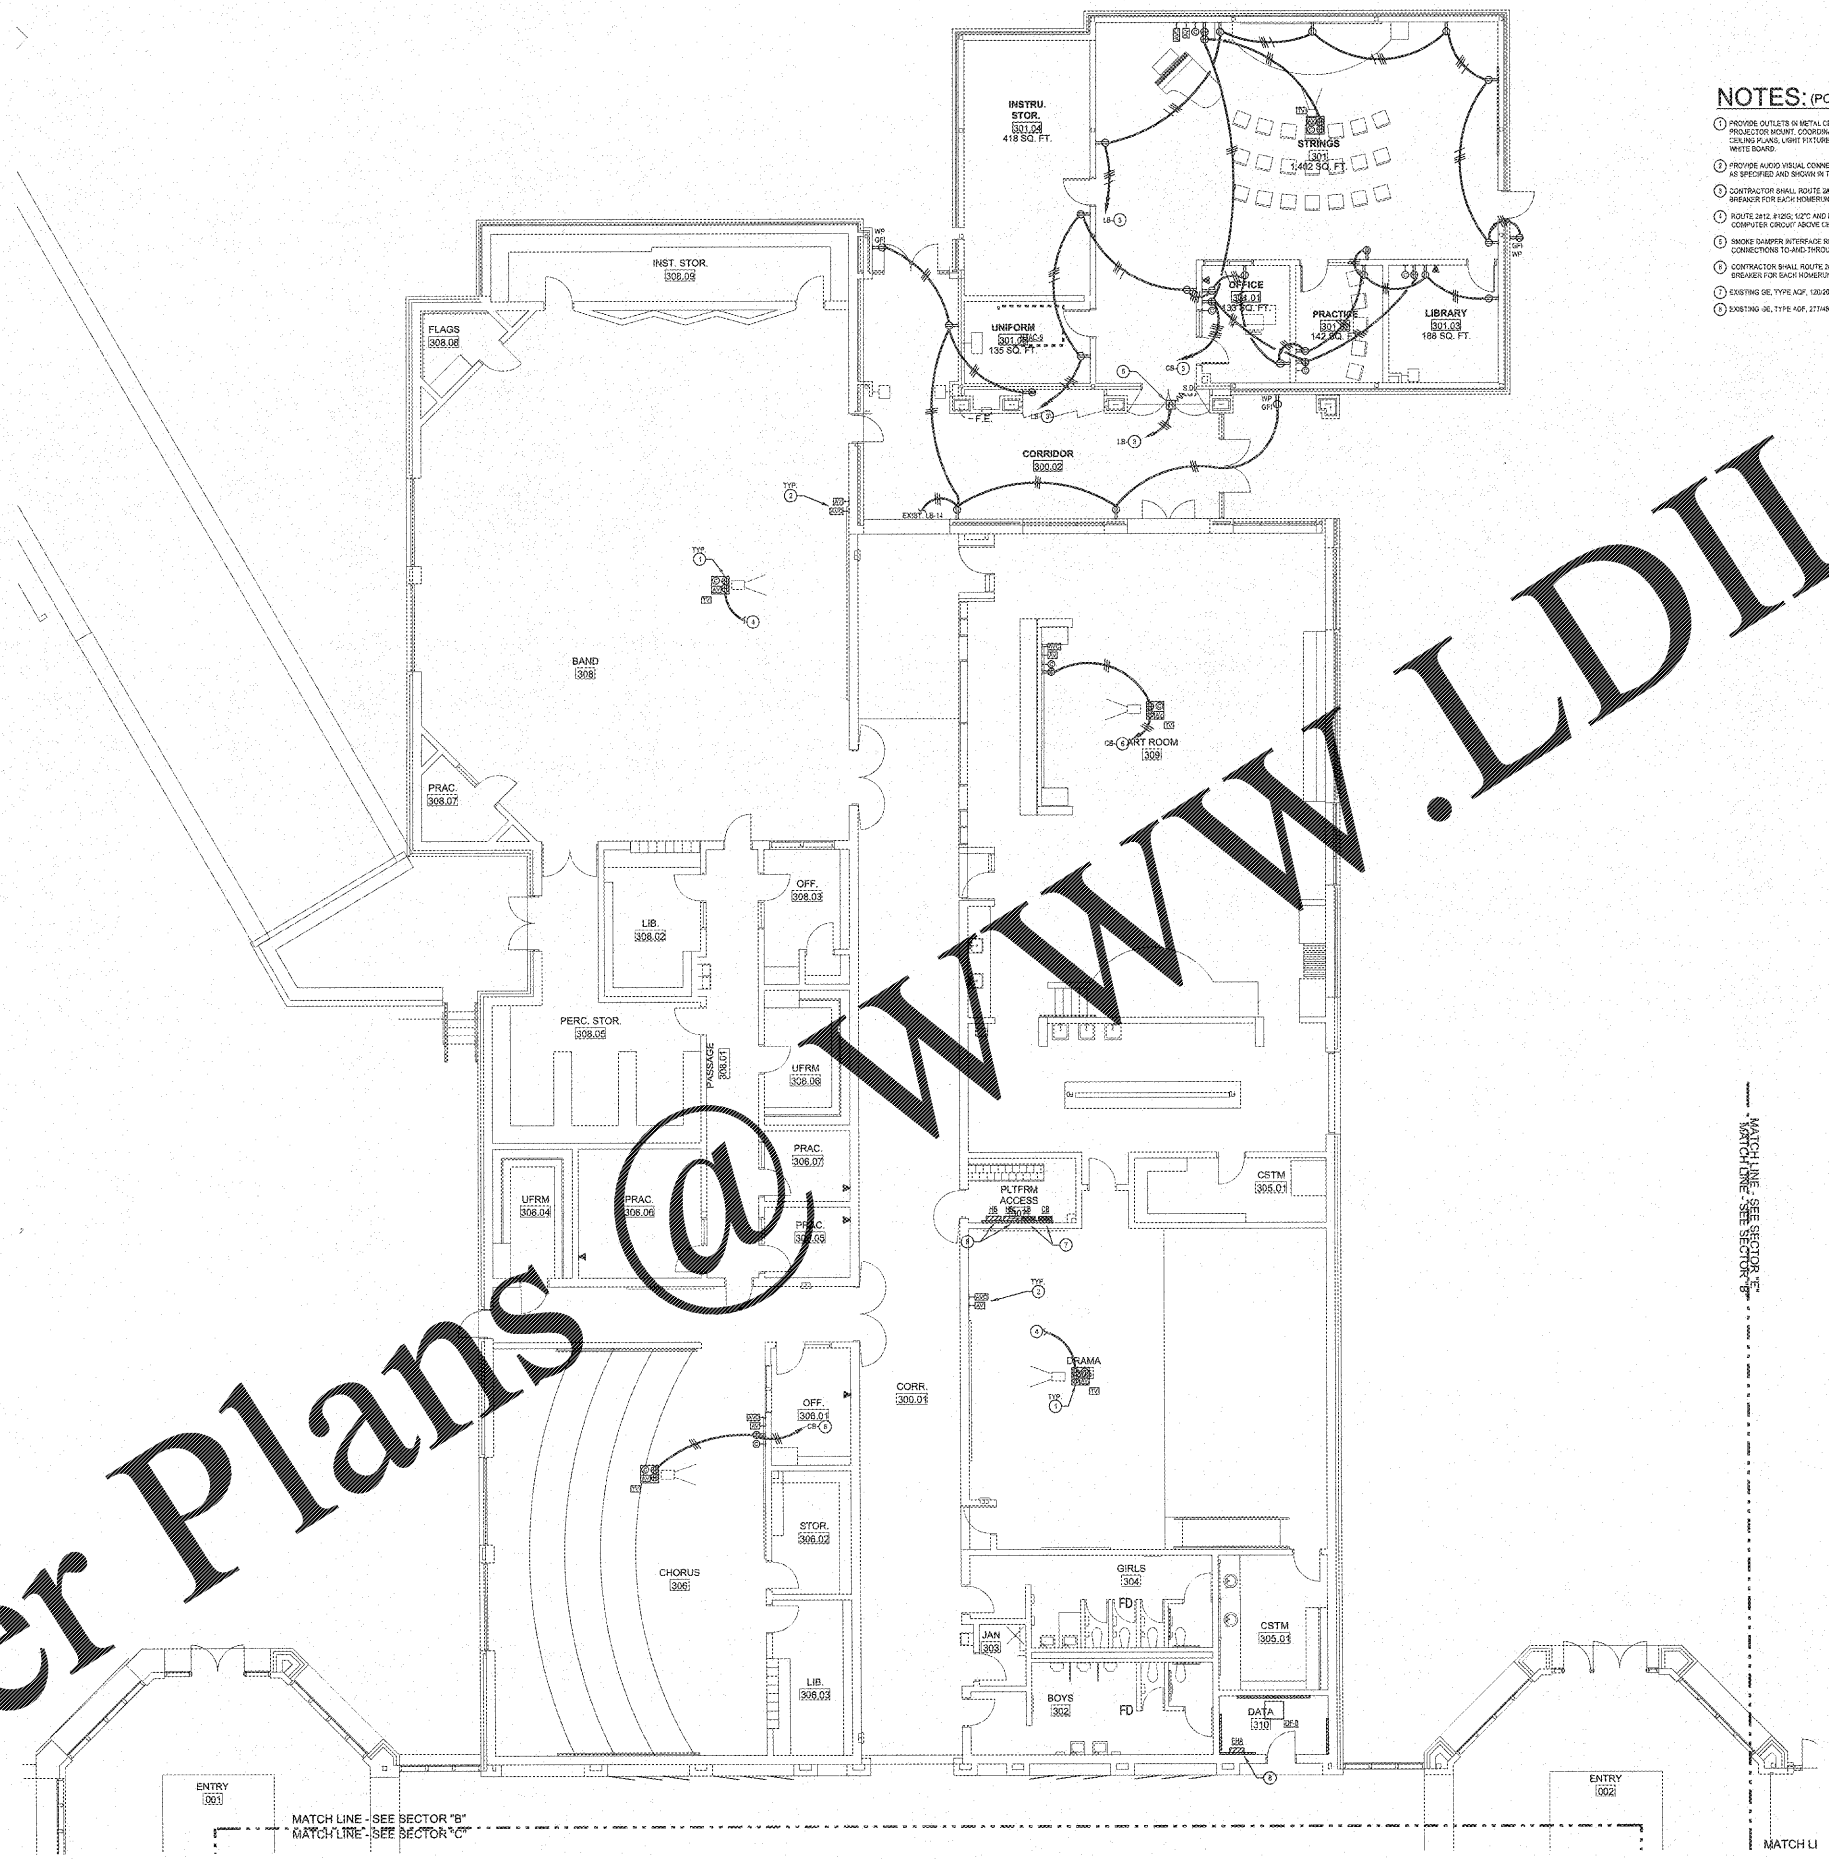

**GENERAL NOTES**

- WHERE CIRCUITS ARE FOUND UTILIZING DOWNDROP SYSTEM FOR ORCHARDING PATH, THE CONTRACTOR SHALL TEST AND VERIFY CONTINUITY OF THE GROUNDING PATH. IF THE EXISTING GROUNDING PATH IS DETERMINED TO BE NON-COMPLIANT, THE CONTRACTOR SHALL REMEDY THAT BY PROVIDING #12 GROUNDING CONDUCTOR IN EXISTING CONDUIT BACK TO PANEL.
- ELECTRICAL INSTALLATIONS ON EXISTING WALLS SHALL HAVE CIRCUITS INSTALLED CONCEALED WITHIN BASING. CONTRACTOR SHALL NOT UNDER ANY CIRCUMSTANCE, UTILIZE REMOVED METAL HANDWAY TO INSTALL NEW DEVICES. SURE VOLTAGE OF LOW VOLTAGE. BUSES SHALL BE CUT INTO EXISTING HANDWAY WITH FLEX CONDUIT FINISH IN EXISTING WALL FROM ABOVE ACCESSIBLE CEILING.
- LOW VOLTAGE SYSTEMS OUTLETS SHOWN FOR INSTALLATION. COORDINATION PURPOSES ONLY. SEE APPLICABLE LOW VOLTAGE FLOOR PLAN FOR OTHER REQUIREMENTS.

**NOTE TO CONTRACTOR CONCERNING PROJECT PHASING:**

THE WORK SPECIFIED ON THE DRAWINGS AND SPECIFICATIONS ILLUSTRATES THE COMPLETED CONTRACTUAL REQUIREMENTS. THIS PROJECT IS PHASED IN MULTIPLE PHASES. THE AREA OF THIS PHASE IS DESCRIBED IN THE ARCHITECTURAL DOCUMENTS AND THE CONTRACTOR SHALL REVIEW THESE PHASING REQUIREMENTS. CONTRACTOR SHALL INCLUDE IN HIS BID ALL COSTS REQUIRED TO ACCOMPLISH THE CONTRACT IN PHASES. THE CONTRACT DOCUMENTS DO NOT REQUIRE THE SPECIFIC WORK REQUIRED BY THE CONTRACTOR TO BE DONE IN PHASES. IN PHASES, BUT CONTRACTOR SHALL PREPARE PHASING PLAN AND SUBMIT TO ARCHITECT/ENGINEER AND HENRY COUNTY MAINTENANCE DEPARTMENT PRIOR TO BEGGING WORK.

**ELECTRICAL NEW WORK POWER PLAN - SECTOR "B"**  
SCALE: 1/8"=1'-0"

*Order Plans @*

*WWW.LDILine.com*