KEYED NOTES

D1	RELOCATE EXISTING EQUIPMENT/DEVICE INDICATED TO NEW LOCATION SHOWN ON NEW POWER PLAN.
D14	PULL ELECTRICAL WIRING BACK TO NEAREST JUNCTION BOX. RETAIN EXISTING CIRCUIT AND DEMOLISH EXISTING EQUIPMENT TO BE REPLACED WITH NEW. REFER TO NEW ELECTRICAL POWER PLANS FOR ADDITIONAL INFORMATION.
D15	DISCONNECT EXISTING CIRCUIT SERVING COIL, (COIL REMOVAL BY OTHERS) AND PULL BACK TO NEAREST JUNCTION BOX FOR USE IN NEW WORK SCOPE.

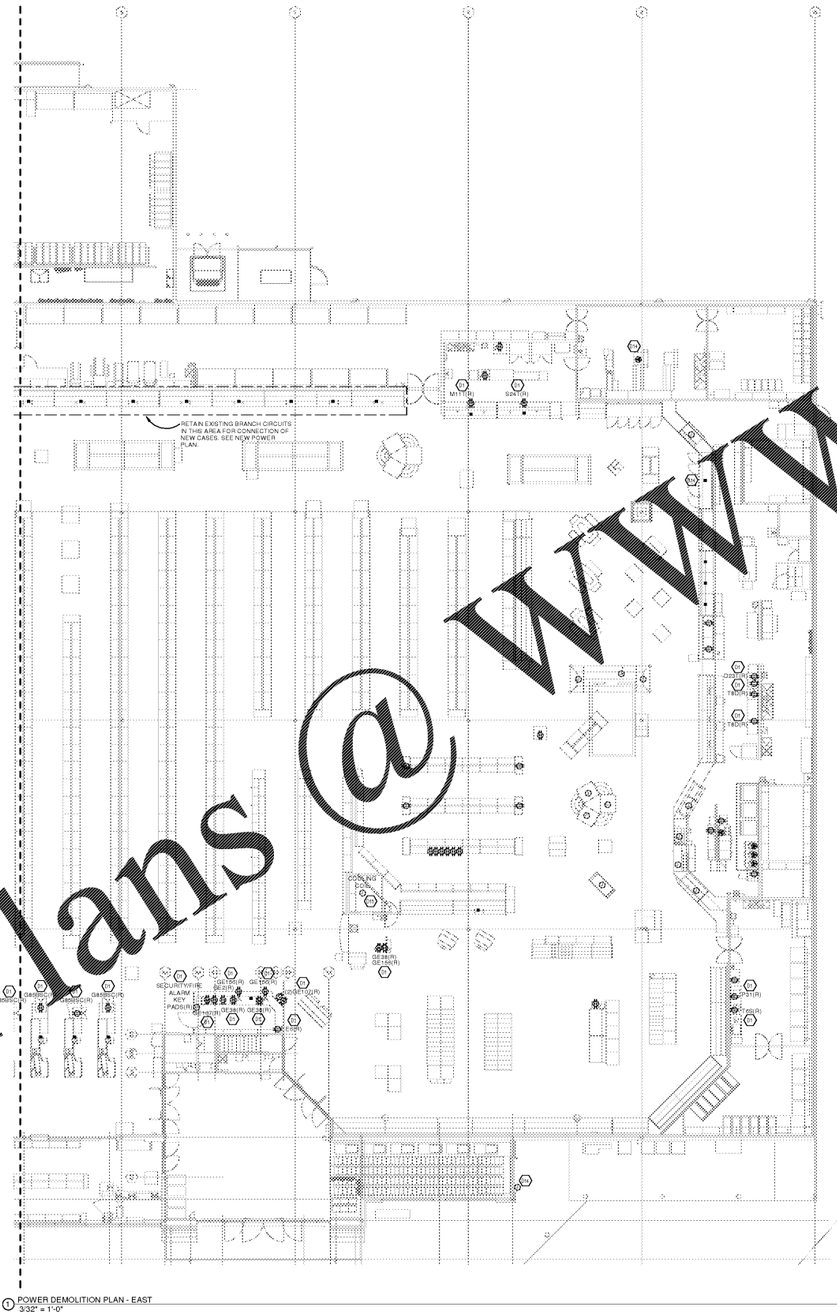
RETAIN EXISTING BRANCH CIRCUITS IN THIS AREA FOR CONNECTION OF NEW CASES. SEE NEW POWER PLAN.
SECURITY/FIRE ALARM KEY PADS(R)
GE(R)
GE(R)
GE