

- GENERAL DIMENSION NOTES**
- A. REFER TO EQUIPMENT SCHEDULES ON SHEET ES-SERIES FOR MOUNTING HEIGHTS AND ADDITIONAL INFORMATION. ALSO SEE DETAILS ON SHEET ES-SERIES DRAWINGS WHERE APPLICABLE.
  - B. METAL ELECTRICAL OUTLETS FOR REFRIGERATION ISLAND CASES IN A STRAIGHT LINE ALIGNED WITH THE HUB DRAWING. COORDINATE WIRING DIMENSIONS SHOWN.
  - C. ALL DIMENSIONS INDICATED ON PLANS THAT ARE FROM INTERIOR PARTITIONS WHERE THE RETURN AIR SHAFT IS INDICATED ARE TAKEN FROM THE SALES AREA SIDE OF THE ROOF DECK HIGH PARTITION. NOT THE RETURN AIR SHAFT PARTITION.
  - D. FIELD COORDINATE UNDERBAY CONDUIT AND RACEWAY LAYOUTS WITH ALL AFFECTED PARTS PRIOR TO SLAB PLACEMENT.
  - E. FLUSH MOUNT ALL WALL OUTLETS IN FOOD PREP AREAS. OUTLETS LOCATED ABOVE STAINLESS STEEL TABLES SHALL BE A MINIMUM OF 42" AFF. MOUNT ALL WALL OUTLETS IN ALL PREP AREAS HORIZONTALLY.
  - F. PROVIDE THREE (3) FEET OF SEAL-TIGHT FLEXIBLE CONDUIT FOR REFRIGERATED CASES SERVED FROM WALL JUNCTION BOXES AND 6 FEET FROM FLOOR MOUNTED PLASTIC JUNCTION BOXES FOR ISLAND REFRIGERATED CASES FOR CONNECTION TO CASES BY THE PHASE II EQUIPMENT CONTRACTOR.
  - G. ALL WALL MOUNTED OUTLETS SERVING REFRIGERATED CASES WITH RETURN AIR PLENUM ABOVE SHALL BE ACCESSIBLE (WITH ALL WIRING DIMENSIONAL WORK INDICATED SHALL BE SCHEMATICALLY TYPICAL FOR ALL RELATED WORK INCLUDING CORRESPONDING WORK SHOWN ON EMB PLANS).
  - H. ALL ELECTRICAL AND COMMUNICATION JUNCTION/OUTLET BOXES SHOWN AGAINST THE WALL SHALL BE MOUNTED IN THE WALL. REFER TO THE ELECTRICAL EQUIPMENT SCHEDULE FOR MOUNTING INFORMATION.
  - I. IN GENERAL, RECEPTACLES SHOWN WITHOUT EQUIPMENT MARKING OR OTHER CALLOUT ARE CONVENIENCE OUTLETS THAT SHALL BE MOUNTED AT 48" AFF.
  - J. ALL DIMENSIONS SHOWN ON DIMENSION DRAWINGS ARE SHOWN AS A CONVENIENCE REFERENCE FOR THE ELECTRICAL CONTRACTOR. THE ELECTRICAL CONTRACTOR SHALL COORDINATE AND FIELD VERIFY ALL DIMENSIONAL WORK WITH RESPECTIVE COLUMN LOCATIONS WITH ALL AFFECTED PARTS PRIOR TO ROUGH-IN.
  - K. SEE DETAIL "F" ON ES-SERIES DRAWINGS FOR CONDUIT MOUNTING AND DIMENSIONING REQUIREMENTS THAT APPLY TO REFRIGERATED CASE EQUIPMENT.
  - L.



CONSULTANTS

MEDICAL/ELECTRICAL CONTRACTORS  
WWW.KIENGINEERS.COM

1500 OMBY STATION COURT  
LOUISVILLE, KENTUCKY 40223  
PH: 502.496.8368 FAX: 502.496.8369  
WWW.KIENGINEERS.COM

KROGER L758

234 EAST BROCKE PKWY.  
MT. WASHINGTON, KY

CLIENT



KROGER COMPANY

1600 Ombly Station Court  
Louisville, Kentucky 40223

**ELECTRICAL POWER DIMENSION PLAN - WEST**


No.	Description	Date

BID ISSUE

IF YOU DO NOT RECEIVE THIS DRAWING FROM THE PROJECT MANAGER, PLEASE CONTACT THE PROJECT MANAGER FOR MORE INFORMATION.

E1.5.2.1

Project number 20168  
Date 06/17/2016

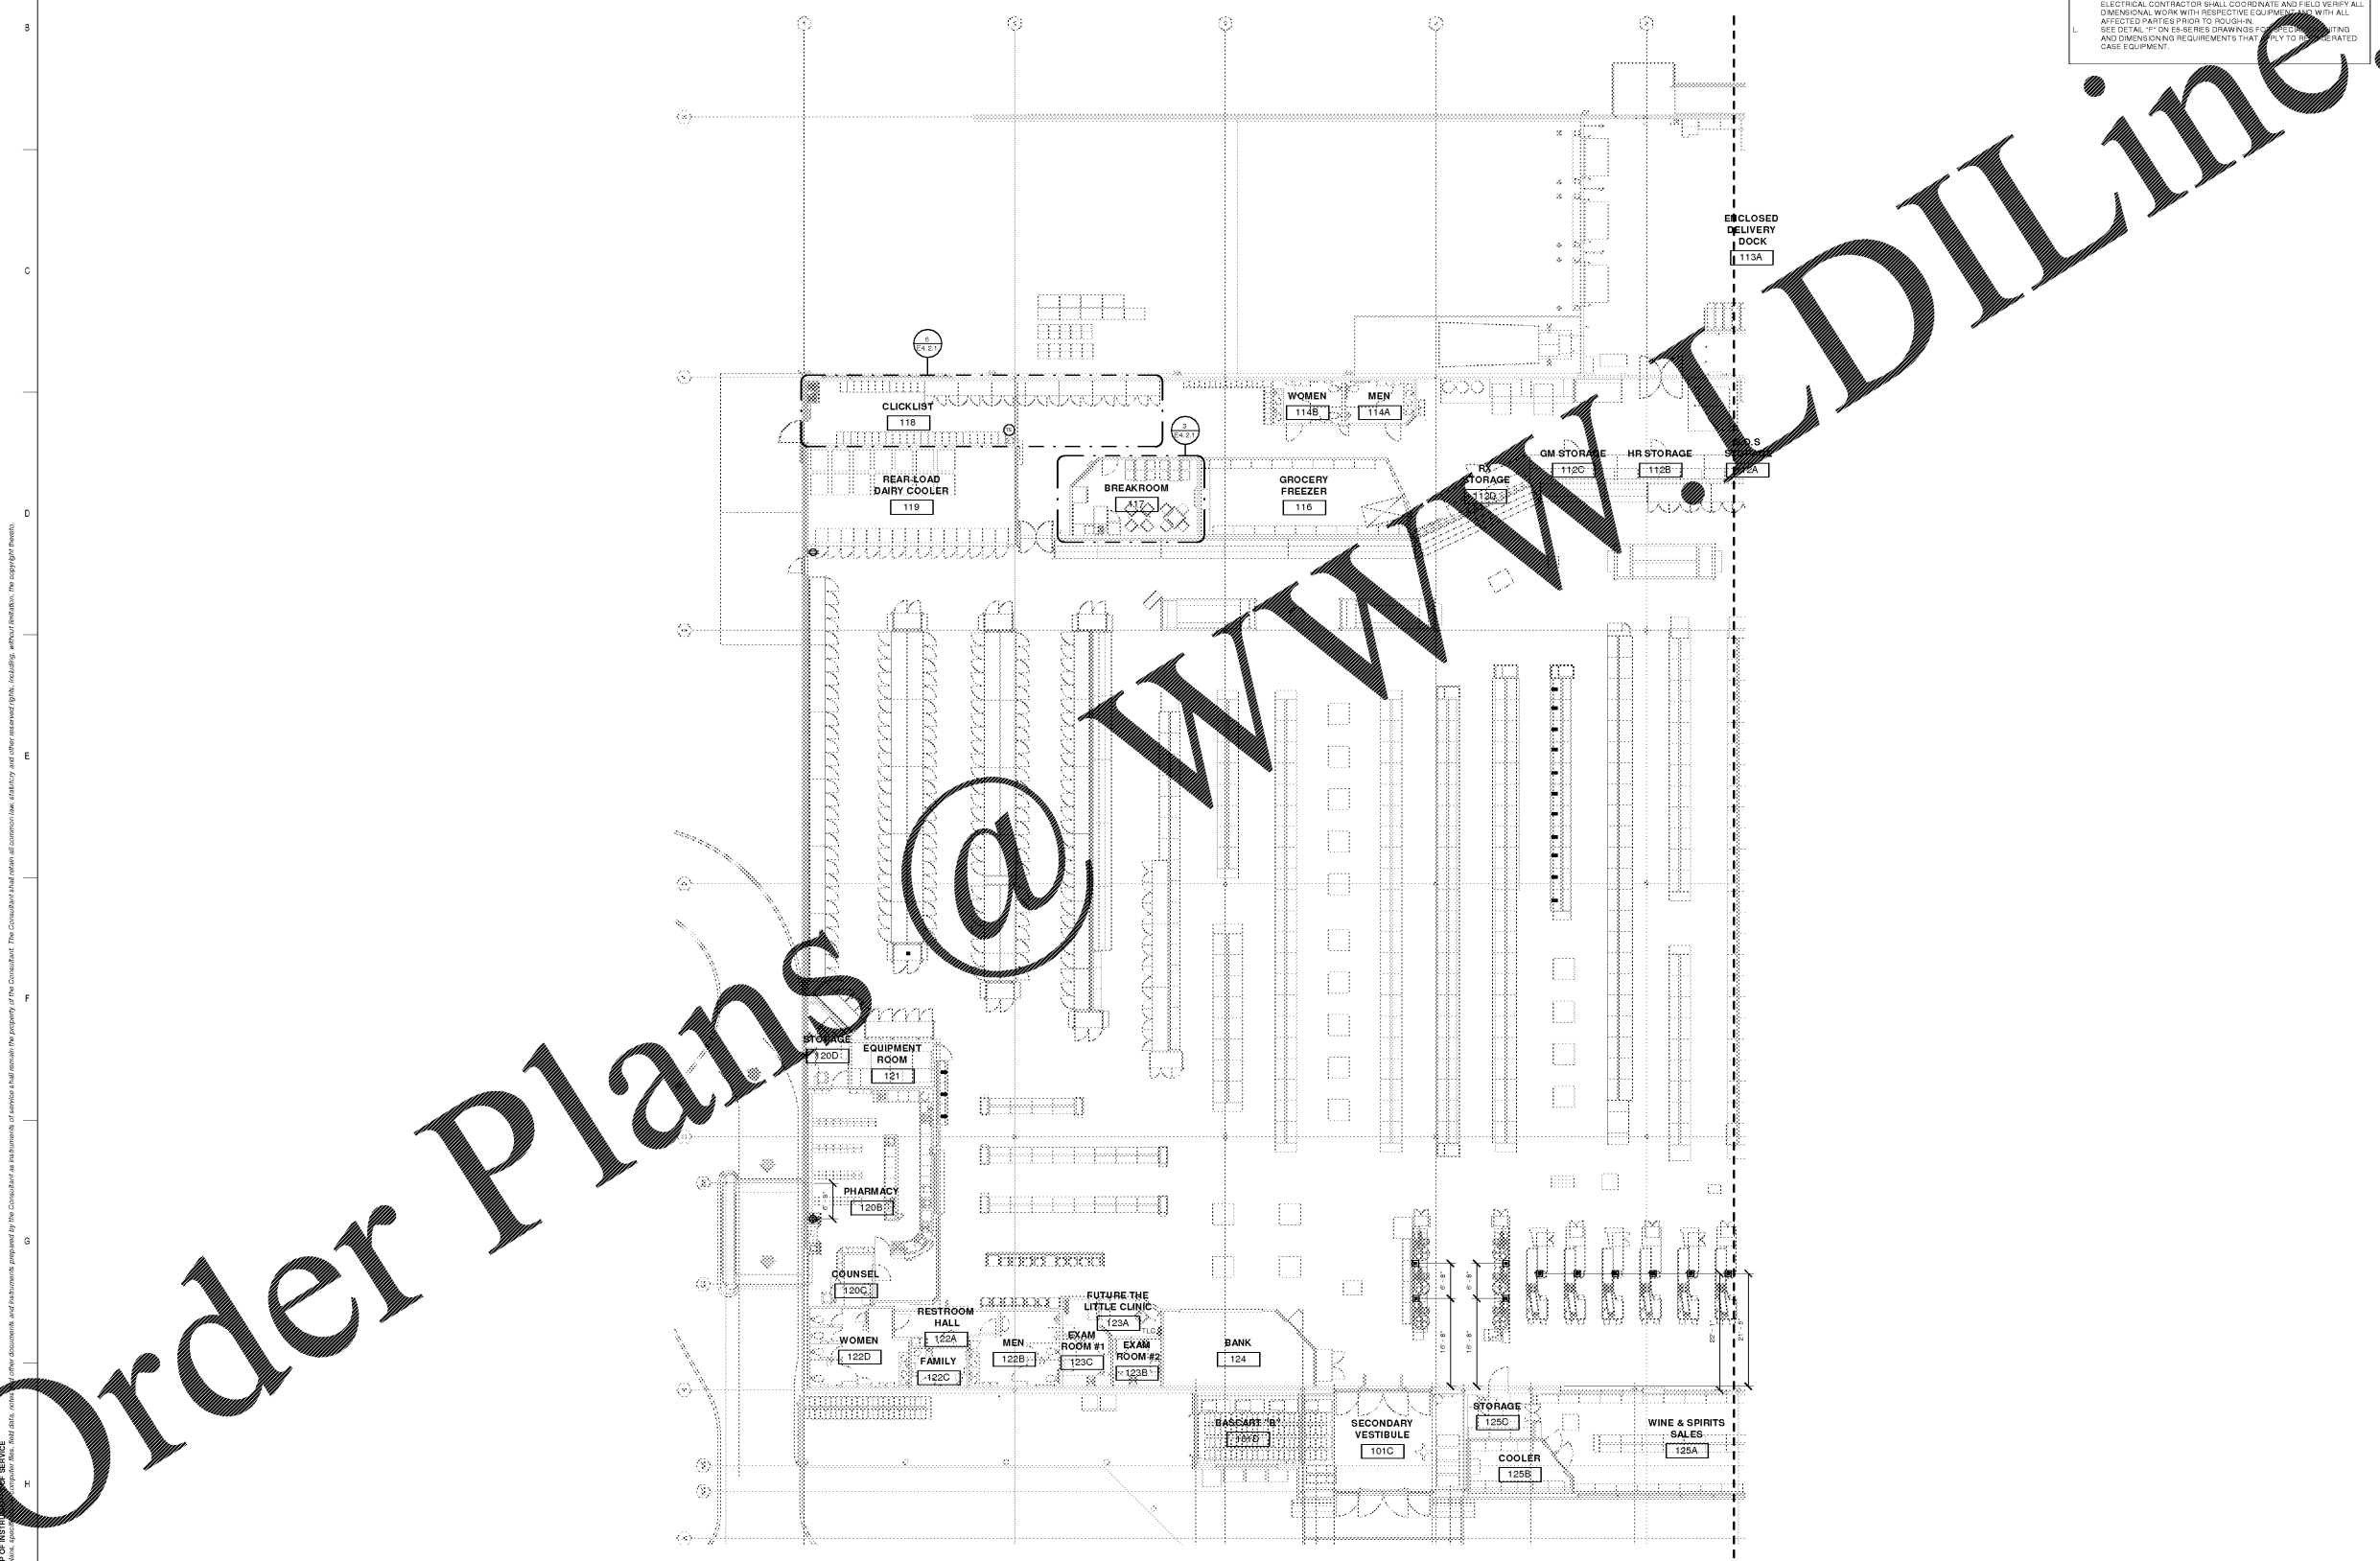

① ELECTRICAL POWER DIMENSION PLAN - WEST  
3/32" = 1'-0"

10 JAD JAT

SERVICE: ...  
 OWNERSHIP OF INSTRUMENTS: ...  
 REVISIONS: ...