


- GENERAL NOTES**
- A. REFER TO EM SERIES SHEETS FOR ALL RELATED SCHEDULES, DETAILS, ETC. RELATING TO THIS PLAN.
  - B. PROVIDE A MINIMUM OF (2) 1" CONDUITS FOR EACH REFRIGERATION CIRCUIT, CONSISTING OF (1) CONDUIT FOR LOW VOLTAGE AND (1) FOR LINE VOLTAGE.
  - C. FURNISH AND INSTALL ALL WIRES AND CABLES. PROVIDE FINAL TERMINATIONS FOR ALL LINE VOLTAGE WIRES. REFRIGERATION CONTRACTOR SHALL MAKE FINAL TERMINATIONS AT BOTH ENDS OF LOW VOLTAGE WIRE/CABLES AND DEFROST WIRING. PROVIDE SUFFICIENT SLACK AT BOTH ENDS TO ALLOW FOR SERVICE LOOPS AND TO FACILITATE PROPER TERMINATIONS ELSEWHERE, INCLUDING RELATED POWER WIRING SHOWN ON OTHER DRAWING SHEETS. PROVIDE ALL REQUIRED TERMINATIONS.
  - D. IF A DISCREPANCY EXISTS BETWEEN THIS DRAWING AND THE SPECIFICATIONS, REFER TO KROGER PROJECT ENGINEERS FOR RESOLUTION.
  - E. WHERE APPLICABLE FOR ISLAND TYPE CASE LOCATIONS, INSTALL CONDUIT BELOW SLAB AND PROVIDE OUTLET BOXES SURFACE MOUNTED JUST ABOVE FLOOR SLAB.
  - F. REFER TO EQUIPMENT SCHEDULES ON EX-1 DRAWING FOR MOUNTING HEIGHTS AND ADDITIONAL INFORMATION. ALSO SEE DETAILS ON SHEET EX-SERIES DRAWINGS WHERE APPLICABLE.
  - G. INSTALL ELECTRICAL OUTLETS FOR REFRIGERATION ISLAND CASES IN A STRAIGHT LINE ALIGNED WITH THE HUB DRAWING. COORDINATE WITH PLUMBING DIMENSIONS SHOWN IN PLAN.
  - H. ALL DIMENSIONS INDICATED ON PLANS THAT ARE FROM INTERIOR PARTITIONS WHERE THE RETURN AIR SHAF-IT BE INDICATED ARE TAKEN FROM THE SALES AREA SIDE OF THE ROOF DECK HIGH PARTITION. NOT THE RETURN AIR SHAF-IT PARTITION.
  - I. COORDINATE THE UNDER-SLAB CONDUIT AND RACEWAY LAYOUT WITH ALL AFFECTED PARTIES PRIOR TO SLAB PLACEMENT.
  - J. PROVIDE 10 FEET OF FLEXIBLE CONDUIT FOR REFRIGERATED CASES SERVED FROM WALL JUNCTION BOXES AND 6 FEET FOR ISLAND REFRIGERATED CASES FOR CONNECTION TO CASES BY THE PHASE 6 EQUIPMENT CONTRACTOR.
  - K. ALL WALL MOUNTED OUTLETS SERVING REFRIGERATED CASES WITH RETURN AIR PLENUM ABOVE SHALL BE ACCESSIBLE (WITH ALL WIRING PLENUM RATED AS IF APPLICABLE).
  - L. REFER TO ELECTRICAL DIMENSION PLANS FOR DIMENSIONAL INFORMATION THAT SHALL APPLY TO ALL CORRESPONDING SYSTEMS WORK.
  - M. IF DEFROST SYMBOL IS SHOWN ON THE PLAN, THE EQUIPMENT IS NOT LISTED IN THE DEFROST WIRING SCHEDULE. WHEN POLYMER IN THE CONDUIT AND OUTLET SHALL BE SPECIFIED FOR FUTURE TERMINATION.
  - N. REFER TO RSD-11 FOR CONDUIT SCHEDULES, LOCATIONS, HEIGHTS, ETC. REGARDING REFRIGERATION AND ALL OTHER EQUIPMENT.



ENERGY MANAGEMENT PLAN AND DETAILS - WEST  
3/32" = 1'-0"

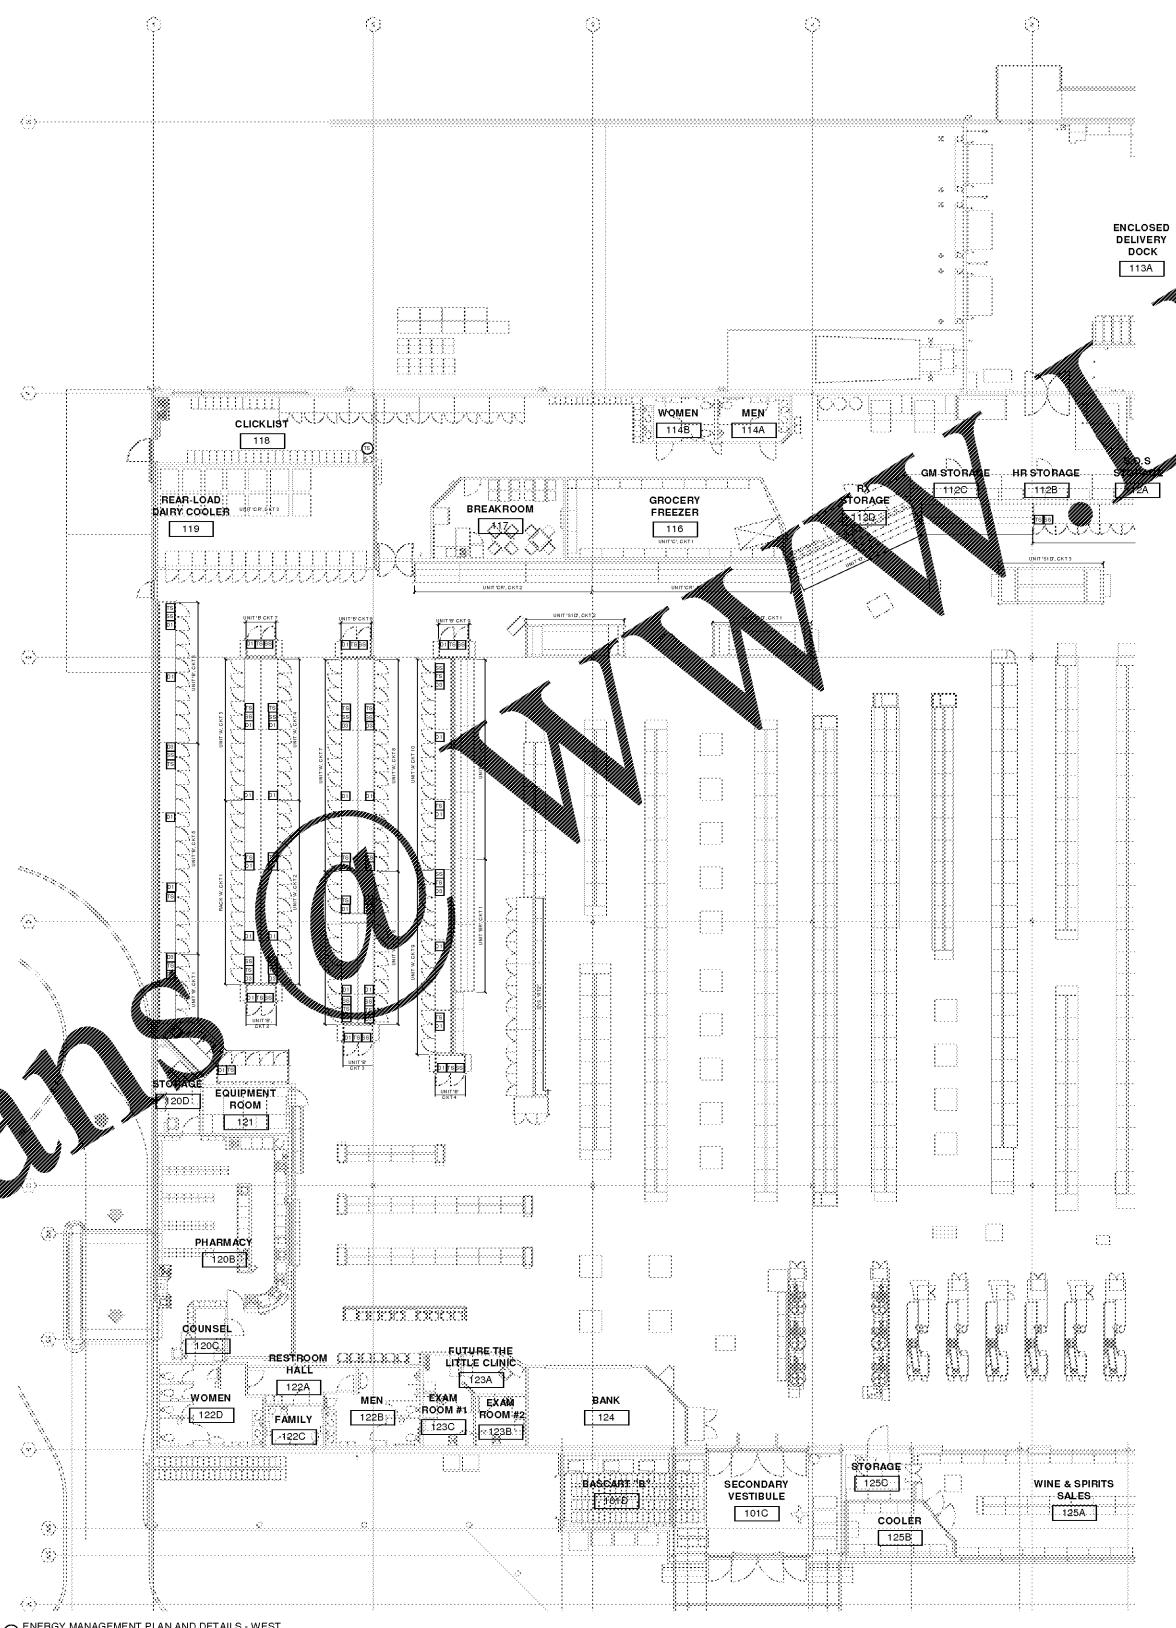

1877 BROADWAY  
LOUISVILLE, KY 40203  
TEL: 502.581.1111  
WWW.STUDIOAARCHITECTS.COM

CONSULTANTS

MECHANICAL ELECTRICAL PLUMBING  
WWW.KIHLHENGINEERS.COM  
LEWISBURG, KENTUCKY  
COLUMBIANA, OHIO  
NEW YORK, NEW YORK

1700 ALEXANDRIA PKWY, SUITE 111  
LEWISBURG, KY 40361  
800-398-8788 / 606-896-8920  
www.kihlh.com

KROGER L758

234 EAST BROCKE PKWY.  
MT WASHINGTON, KY

CLIENT



KROGER COMPANY

1600 Orendy Station Court  
Louisville, Kentucky 40223

ENERGY MANAGEMENT PLAN AND DETAILS  
- WEST

No.	Description	Date

BID ISSUE

© 2016 KROGER COMPANY. ALL RIGHTS RESERVED. THIS DOCUMENT IS THE PROPERTY OF KROGER COMPANY. IT IS TO BE USED ONLY FOR THE PROJECT AND SITE SPECIFICALLY IDENTIFIED HEREIN. NO PART OF THIS DOCUMENT IS TO BE REPRODUCED OR TRANSMITTED IN ANY FORM OR BY ANY MEANS, ELECTRONIC OR MECHANICAL, INCLUDING PHOTOCOPYING, RECORDING, OR BY ANY INFORMATION STORAGE AND RETRIEVAL SYSTEM, WITHOUT PERMISSION IN WRITING FROM KROGER COMPANY.

EM1.1.1

Project number: 20168  
Date: 06/17/2016

2" REFERENCE LINE  
JAD JAT

SERVICE: COMPUTER AIDED DESIGN, ARCHITECTURAL RENDERING, 3D MODELING, BIDDING DOCUMENTS, PERMITS, AND CONSTRUCTION ADMINISTRATION. THE CONSULTANT SHALL NOT BE RESPONSIBLE FOR THE ACCURACY OF ANY INFORMATION, INCLUDING, WITHOUT LIMITATION, THE COPYRIGHTED INFORMATION, OR THE CONTENTS OF ANY OTHER DOCUMENTS, PERMITS, AND CONSTRUCTION ADMINISTRATION. THE CONSULTANT SHALL NOT BE RESPONSIBLE FOR THE ACCURACY OF ANY INFORMATION, INCLUDING, WITHOUT LIMITATION, THE COPYRIGHTED INFORMATION, OR THE CONTENTS OF ANY OTHER DOCUMENTS, PERMITS, AND CONSTRUCTION ADMINISTRATION. THE CONSULTANT SHALL NOT BE RESPONSIBLE FOR THE ACCURACY OF ANY INFORMATION, INCLUDING, WITHOUT LIMITATION, THE COPYRIGHTED INFORMATION, OR THE CONTENTS OF ANY OTHER DOCUMENTS, PERMITS, AND CONSTRUCTION ADMINISTRATION.