

T1 - TORK #7200Z - ASTRONOMIC TIMECLOCK CONTROL:
PROGRAM TO TURN ON AT 4:50 AM & OFF AT 1:00 AM
(COORDINATE TIMES WITH STARBUCKS) & WITH
ASTRONOMIC CONTROL TO TURN SIGNAGE OFF DURING
DAYLIGHT AND ON AT DUSK.

(DIMMER SWITCHBANK)
LUTRON MODEL
#NT-600 DIMMER

(g) SEATING DL	(f) PENDANT
(e) CAFE NEON	(g) CAFE ACCENT


SWITCHBANK

(a) BOH 2X2	(b) BOH 2X2
(c) BAR TRACK	

3 LIGHTING CONTROL DETAILS
N.T.S.

LIGHTING SCHEDULE							
MARK	Manufacturer	Model	DESCRIPTION	Lamp	Voltage	Apparent Load	Typical Comments
A	NEL	NEL-PTRP-0071	PENDANT - SMALL KNOTTED ROPE - NATURAL ROPE	INTEGRAL LED	120 V	6 VA	
E	NEL	NEL-6-8W-3000K-WW	6" RECESSED CAN FIXTURE - White	INTEGRAL LED	120 V	8 VA	
E-B	NEL	NEL-6-8W-3000K-WW	Can - Recessed - 6in 150mm - Black	INTEGRAL LED	120 V	8 VA	
EM-W	NEL	EXL-700W-1	EMERGENCY FIXTURE WITH INTEGRAL 90 MIN. RATED BATTERY - WHITE	INTEGRAL LED	120 V	8 VA	
EX-W	NEL	CB-810D-HORC-W-1	EXIT SIGN w/ EMERGENCY LIGHTS AND INTEGRAL 90 MIN. RATED BATTERY - WHITE	INTEGRAL LED	120 V	5 VA	
F	NEL	NTE-845.30X15-BLACK	TRACK MOUNTED LED FIXTURE, BLACK FINISH	LED	120 V	6 VA	
F-TRACK	NEL	NT-302B	TRACK - RAIL SURFACE MOUNTED - BLACK	NA	120 V	0 VA	
G	NEL	NEL-SP-G25	PENDANT - CORD LIGHT - WHITE	INTEGRAL LED	120 V	6 VA	
H	NEL	NEL-CPTP-0070	PENDANT - SMALL METAL PERFORATED CYLINDER	6W LED	120 V	0 VA	
H-1	NEL	NEL-SP-TP-0072	PENDANT - PUNCHED TIN - 12" SHADE	6W LED	120 V	0 VA	
I	NEL	ELFP22-LED-40-UE	RECESSED LED 2x2 LED TROFFER w/ FLAT DIFFUSER LENS	INTEGRAL LED	120 V	45 VA	
I-EM	NEL	ELFP22-LED-40-UE	RECESSED LED 2x2 LED TROFFER w/ FLAT DIFFUSER LENS AND EMERGENCY BATTERY BACKUP	INTEGRAL LED	120 V	45 VA	
K	NEL	C23MV	1'x4' FLUORESCENT STRIP LIGHT FIXTURE	1'x4' FLUORESCENT	120 V	17 VA	PROVIDED WITH COOLER FIXTURE PROVIDED BY AND INSTALLED BY LANDLORD
LL-1	NEL		EXIT - SECURITY LIGHT WALL MOUNTED	LED	120 V	67 VA	

NOTE: REFER TO ARCHITECTURAL ELEVATIONS FOR FIXTURE MOUNTING

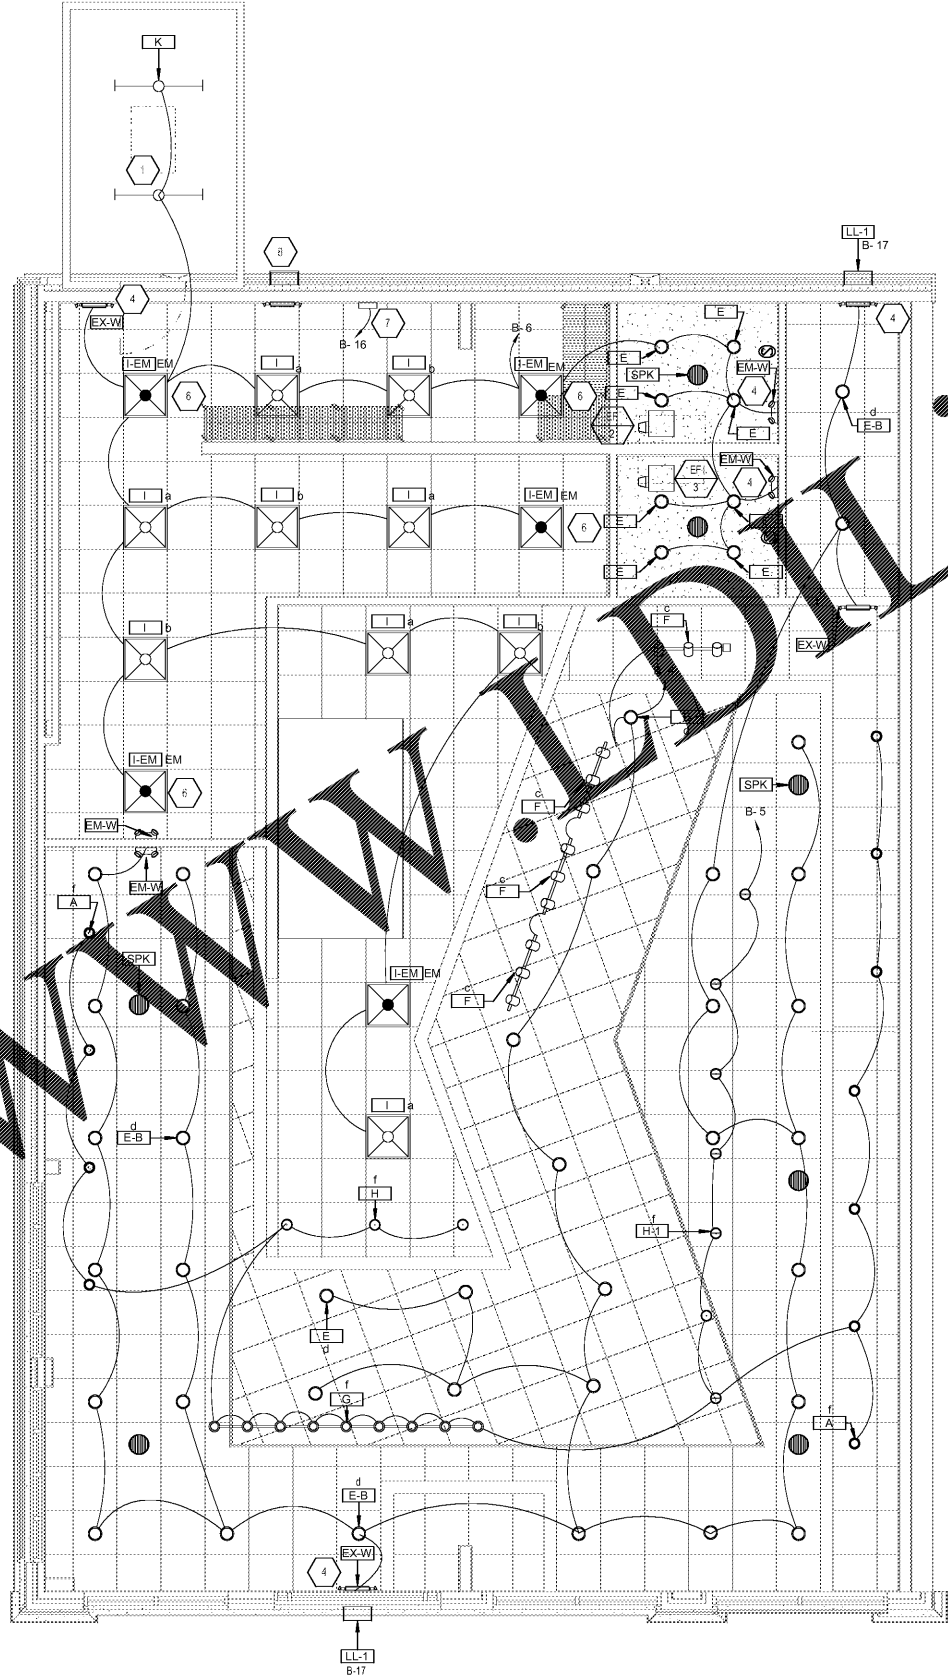


1 ELECTRICAL LIGHTING PLAN
1/4" = 1'-0"

POWER PLAN KEY NOTES

- WALK-IN COOLER LIGHT FIXTURES, SURFACE MOUNTED. COORDINATE WITH MANUFACTURER SPECIFICATION.
- EXTERIOR WALL MOUNTED LIGHT FIXTURES. E.C. SHALL COORDINATE MOUNTING HEIGHT WITH ARCHITECTURAL DRAWINGS PRIOR TO ROUGH IN. CIRCUIT TO BE ROUTED VIA TIMECLOCK. SEE DETAIL THIS SHEET.
- SWITCHBANK. SEE LIGHTING DETAIL THIS SHEET. COORDINATE WITH OWNER FOR LOCATION.
- E.C. SHALL WIRE AHEAD OF ALL LOCAL SWITCHING.
- LED TAPE FIXTURE. E.C. TO ROUGH IN CIRCUIT VIA TIMECLOCK. SEE THIS SHEET.
- NIGHT LIGHT. E.C. SHALL WIRE AHEAD OF LOCAL SWITCHING.
- ASTRONOMIC TIME CLOCK. SEE DETAIL THIS PAGE FOR MORE INFORMATION.
- EXISTING FIXTURE TO REMAIN.

GENERAL NOTES

- ALL FIXTURES IN WORK ROOM, BACK AND FRONT LINE, TO BE PROVIDED WITH SHATTERPROOF LAMPS IF THE FIXTURE IS NOT LISTED BY ARCHITECT OF RECORD TO INCLUDE APPROPRIATE LAMPS / FIXTURES ON DRAWINGS AND SCHEDULES, AND COMPLY WITH ANY ADDITIONAL JURISDICTIONAL LIGHTING REQUIREMENT.
- PROVIDE GROMMET AT ALL CEILING PENETRATIONS FOR FIXTURES/SUPPORTS.
- CENTER EMERGENCY EXIT LIGHTS ABOVE DOORS, UNLESS OTHERWISE NOTED.



REV. NO.	DATE	ISSUED FOR PERMIT	DESCRIPTION
	07/27/18		

DRAFT

MOE'S SOUTHWEST GRILL
3732 US HWY 280
PHOENIX CITY, AL 36867
ELECTRICAL LIGHTING PLAN

DATE:	
BRAND REVIEW	07/27/2018
PERMIT	07/27/2018
BID	--/------
CONSTRUCTION	--/------
RECORDED	--/------

PROJECT MANAGER	DESIGNER
JB	JW

JOB NO.
2018375.13

E-150

Order Plans

WWW.Online.com