



7/27/2018 10:27:01 PM  
 C:\2018\201837513\18 Moes Phoenix City (Ferris)\04\_Consolidated\Revit (2017)\MEP1 - MEP Model

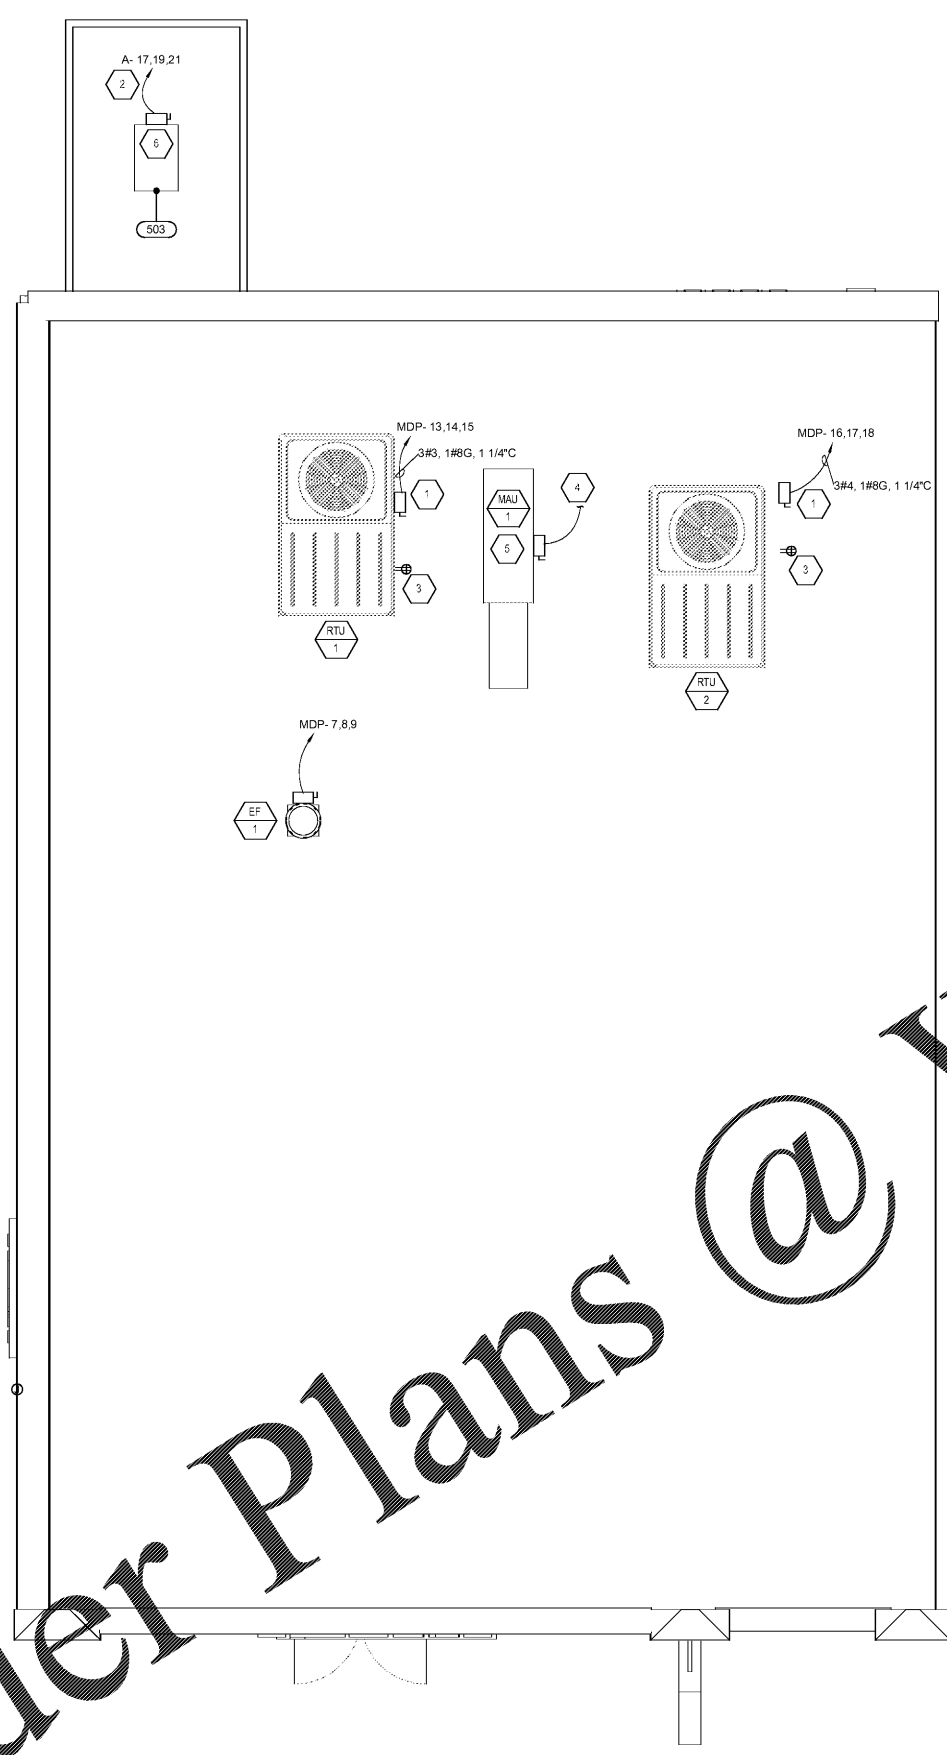

**ROOF PLAN KEY NOTES**

1. RTU IS FURNISHED W/ FACTORY INSTALLED NON-FUSED DISCONNECT, VERIFY W/ M.C.
2. 30 AMP, 3-POLE, 208 VOLT NON-FUSED DISCONNECT SWITCH IN NEMA 3R ENCLOSURE WITH SOLID NEUTRAL AND GROUNDING KIT. COORDINATE EXACT METHOD AND LOCATION OF MOUNTING.
3. FACTORY FURNISHED GFCI W/ DUPLEX OUTLET, WIRED BY E.C., VERIFY W/ M.C.
4. DOWN TO KITCHEN HOOD CONTROL PANEL.
5. EXHAUST FANS ARE FURNISHED W/ FACTORY INSTALLED SLUIC, VERIFY W/ CAPTIVE AIR.
6. WALK-IN COOLER CONDENSER, PROVIDE CONTROL W/ WIRE TO UNITS AS REQUIRED.



REV. NO.	DATE	ISSUED FOR PERMIT	DESCRIPTION
	07/27/18		

**DRAFT**

**MOE'S SOUTHWEST GRILL**  
 3732 US HWY 280  
 PHOENIX CITY, AL 36867

**ELECTRICAL ROOF PLAN**

DATE:	
BRAND REVIEW	07/27/2018
PERMIT	07/27/2018
BID	-/-/-
CONSTRUCTION	-/-/-
RECORDED	-/-/-
PROJECT MANAGER	DESIGNER
JB	JW

JOB NO.  
**2018375.13**

**E-200**

**1** ELECTRICAL ROOF PLAN  
 1/4" = 1'-0"

Order Plans @ [www.LDILine.com](http://www.LDILine.com)