

2 TYPICAL TRUSS PROFILE
SCALE: 3/4" = 1'-0"

BRICK VENEER LINTEL SCHEDULE

OPENING	SIZE	REMARKS
4'-0"	L4"x4"x3/8" HD. GALV.	LOOSE LINTEL w/ 4" BEARING EACH END
4'-0"	L6"x4"x3/8" (L.L.V.) HD. GALV.	FASTEN LINTEL w/ (2) 1/4"x4-1/2" SIMPSON SD8 SCREWS EA. STUD (16" O.C. MAX.)

NOTES:
1. ALL STEEL LINTELS TO BE HOT-DIPPED GALVANIZED.
2. REFER TO 5/84.2 FOR TYPICAL BRICK VENEER LINTEL DETAIL ABOVE OPENING.
3. REFER TO 6/84.2 FOR CONTINUOUS BRICK LINTEL.

WOOD HEADER SCHEDULE (H)

MARK	DEPTH	CONNECTION TO JAMB	TRUSS	NOTES
H1	2x8	(1) LSTA 18 (TYP.) UNO.	1	
H2	2x10	(2) LSTA 18 (TYP.) UNO.	1, 2	
H3	2x12	(2) LSTA 18 (TYP.) UNO.	1, 2, 3	
H4	1-3/4"x11-1/4"	(2) LSTA 18 (TYP.) UNO.	1, 2, 3	
H5	1-3/4"x16"	(3) LSTA 18 (TYP.) UNO.	1, 2, 3	
H6	1-3/4"x18"	(3) LSTA 18 (TYP.) UNO.	3	

REMARKS:
1. FOR 2x4 WALLS HEADERS TO BE (2)-PLY. FOR 2x6 WALLS HEADERS TO BE (3)-PLY. FOR 2x8 WALLS HEADERS TO BE (4)-PLY.
2. INSTALL FULL DEPTH PLYWOOD FILLER AS REQUIRED TO MATCH WALL WIDTHS.
3. ALL 2x HEADERS TO BE SOUTHERN PINE NO. 2 OR BETTER. ALL 1-3/4" x HEADERS TO BE 20E LVL OR BETTER.
4. REFER TO STRUCTURAL NOTES (SHEET 811) FOR SOUTHERN PINE AND LVL REQUIREMENTS.

UPLIFT CONNECTOR SCHEDULE

PRODUCT CODE	UPLIFT CAP.	LATERAL CAPACITY (TO TRUSS)	PAR (TO TRUSS)	REMARKS	STATE OF FLORIDA APPROVAL NUMBER
H10A	1340*	590*	785*	TYP. TRUSS/FRAME WALL CONN.	FL# 10446 FL# 10456
H10B	1020*	660*	215*	ALT. TRUSS/FRAME WALL CONN.	FL# 10446
H3	455*	125*	160*		FL# 10456
HTS20	1450*	--	--		FL# 10456 FL# 13812
HD12	13335*	--	--		FL# 11496
HD19	16135*	--	--		FL# 11496
HTT4 (16d NAILS)	4235*	--	--		FL# 11496 FL# 13812

NOTES:
1. CONNECTOR SUBSTITUTIONS TO MEET OR EXCEED UPLIFT AND LATERAL CAPACITIES OF SPECIFIED CONNECTORS.
2. FASTEN ALL CONNECTORS w/ MAXIMUM NAILING SPECIFIED BY MFR UNO.
3. REFER TO PLANS AND DETAILS FOR CONNECTOR LOCATIONS.
4. ALL SIMPSON CONNECTION HARDWARE IN CONTACT WITH ACQ PRESURE-TREATED LUMBER IS TO BE ONE OF THE FOLLOWING:
a. ZMAX GALVANIZED (G185) PER ASTM A653 (125 OZ. PER SQUARE FOOT)
b. HDG HOT-DIP GALVANIZED PER ASTM A123 (120 OZ. PER SQUARE FOOT)
c. 55T300 TYPE 304 OR 316 STAINLESS STEEL.
ZMAX AND HDG GALVANIZED CONNECTORS ARE TO BE USED WITH HOT-DIP GALVANIZED FASTENERS PER ASTM A153. 55T300 STAINLESS STEEL CONNECTORS ARE TO BE USED WITH STAINLESS STEEL FASTENERS, WHICH ARE AVAILABLE FROM SIMPSON.

GENERAL NOTES:


- PROVIDE CORNER BARS AT ALL CORNERS AND INTERSECTIONS OF CONTINUOUS FOOTINGS AND THICKENED SLAB EDGES. REFER TO 2/84.1 FOR ADDITIONAL INFORMATION.
- REFER TO SHEET 821 AND 822 FOR TYPICAL PLAN NOTES.
- REFER TO SHEET 821 AND 822 FOR SCHEDULES AND LEGENDS.
- REFER TO SHEET 821 FOR TYPICAL DIMENSION ELEVATION NOTES.
- REFER TO ARCHITECTURAL DRAWINGS FOR ALL OPENINGS. CONTRACTOR TO VERIFY ALL DIMENSIONS WITH MANUFACTURER'S REQUIREMENTS AND NOTIFY ARCHITECT/ENGINEER OF ANY DISCREPANCIES.
- REFER TO ARCHITECTURAL PLUMBING DRAWINGS FOR FIXTURE DRAIN LOCATIONS AND REQUIREMENTS. REFER TO 2/81.2 FOR TYPICAL CONDUIT PIPE DETAILS NOTIFY ARCHITECT/ENGINEER OF ANY DISCREPANCIES.
- CONTRACTOR TO COORDINATE ALL SLOPES, DEPRESSIONS, AND SLAB OPENINGS w/ ARCHITECTURAL/MECHANICAL DRAWINGS PRIOR TO CONSTRUCTION. REFER TO 1/81.2 FOR TYPICAL SLAB STEPS.
- INDICATES TOP OF BEAM.
- INDICATES BOTTOM OF BEAM.
- INDICATES BEARING ELEVATION.
- REFER TO 1/81.2 FOR WIND DESIGN CRITERIA.

ROOF FRAMING PLAN NOTES:

- WOOD TRUSSES
- ROOF FRAMING TO BE PRE-ENGINEERED WOOD TRUSSES AT 24" O.C. MAX. (TYP.) UNO.
 - REFER TO ARCH. SECTIONS FOR WOOD TRUSS CONFIGURATIONS.
 - CONTRACTOR/ERECTOR IS RESPONSIBLE FOR ALL TEMPORARY BRACING.
 - ROOF SHEATHING TO BE 19/32" APA RATED, EXTERIOR BOND CLASSIFICATION, PLYWOOD SHEATHING WITH 8d RING SHANK NAILS AT 4" O.C. AT PANEL JOINTS AND 6" O.C. FIELD UNO. REFER TO 1/84.5, REFER TO PLAN FOR FASTENING AT PANEL EDGES AT BLOCKED ROOF DIAPHRAGM (TYP.)
 - ROOF SLOPE = 1/4 : 12 UNO.
TRUSS BRG. ELEV. = 12'-4" UNO.
COORDINATE ROOF SLOPE AND TRUSS BRG. ELEVATION w/ THE ARCHITECTURAL DRAWINGS.
 - CONNECT TRUSS TO FRAME WALL w/ (H10A) (TYP.) UNO. REFER TO 1/84.4, 2/84.4, 3/84.4, AND 4/84.4 FOR ADDITIONAL INFORMATION.
 - CONNECT GIRDER TO FRAME WALL w/ (2) HTS20 (TYP.) UNO. REFER TO 1/84.4, 2/84.4, 3/84.4, AND 4/84.4 FOR ADDITIONAL INFORMATION.
 - INDICATES MODEL NUMBER OF STEEL CONNECTION HARDWARE BY SIMPSON STRONG-TIE CO. OR EQUIVALENT UNO. ALL CONNECTIONS TO BE FULLY NAILED. CONTRACTOR TO VERIFY NET WIND UPLIFT REACTIONS FROM TRUSS MFR WITH SPECIFIED CONNECTORS AND REPORT ANY DISCREPANCIES TO ARCHITECT/ENGINEER. REFER TO UPLIFT CONNECTOR SCHEDULE ON SHEET 822 FOR ADDITIONAL INFORMATION.

TRUSS MANUFACTURER NOTES:

- WOOD TRUSSES
- TRUSS TOP/BOTTOM CHORDS TO BE 2x6 MINIMUM.
 - ALL TRUSS-TO-TRUSS CONNECTIONS TO BE DESIGNED/SUPPLIED BY TRUSS MFR. SUBMIT CUT SHEETS OF CONNECTION HARDWARE FOR STRUCTURAL REVIEW.
 - REFER TO ARCHITECTURAL REFLECTED CEILING PLAN FOR EXTENT OF SUSPENDED CEILING BELOW TRUSS BOTTOM CHORDS TYPICAL (NO RIGID CEILING AT TRUSS BOTTOM CHORDS). TRUSS MANUFACTURER TO SPECIFY BOTTOM CHORD TRUSS BRACING MEMBERS, LOCATIONS, AND CONNECTIONS AS REQUIRED AT UNBRACED BOTTOM TRUSS CHORD.
 - REFER TO 2/84.5, 3/84.5, AND 4/84.5 FOR MINIMUM TRUSS BRACING.
 - ALL TRUSS ENGINEERING, PLACEMENT, DIMENSIONS, SIZE OF MEMBERS AND CONNECTIONS TO BE VERIFIED BY TRUSS MANUFACTURER.
 - IF TRUSS LAYOUT DIFFERS FROM THAT REPRESENTED ABOVE, PROVIDE ARCHITECT WITH REVISED LAYOUT FOR SUPERSTRUCTURE REDESIGN.
 - REFER TO BC91-CURRENT EDITION FOR MINIMUM TRUSS BRACING REQUIREMENTS AND ADDITIONAL INFORMATION.

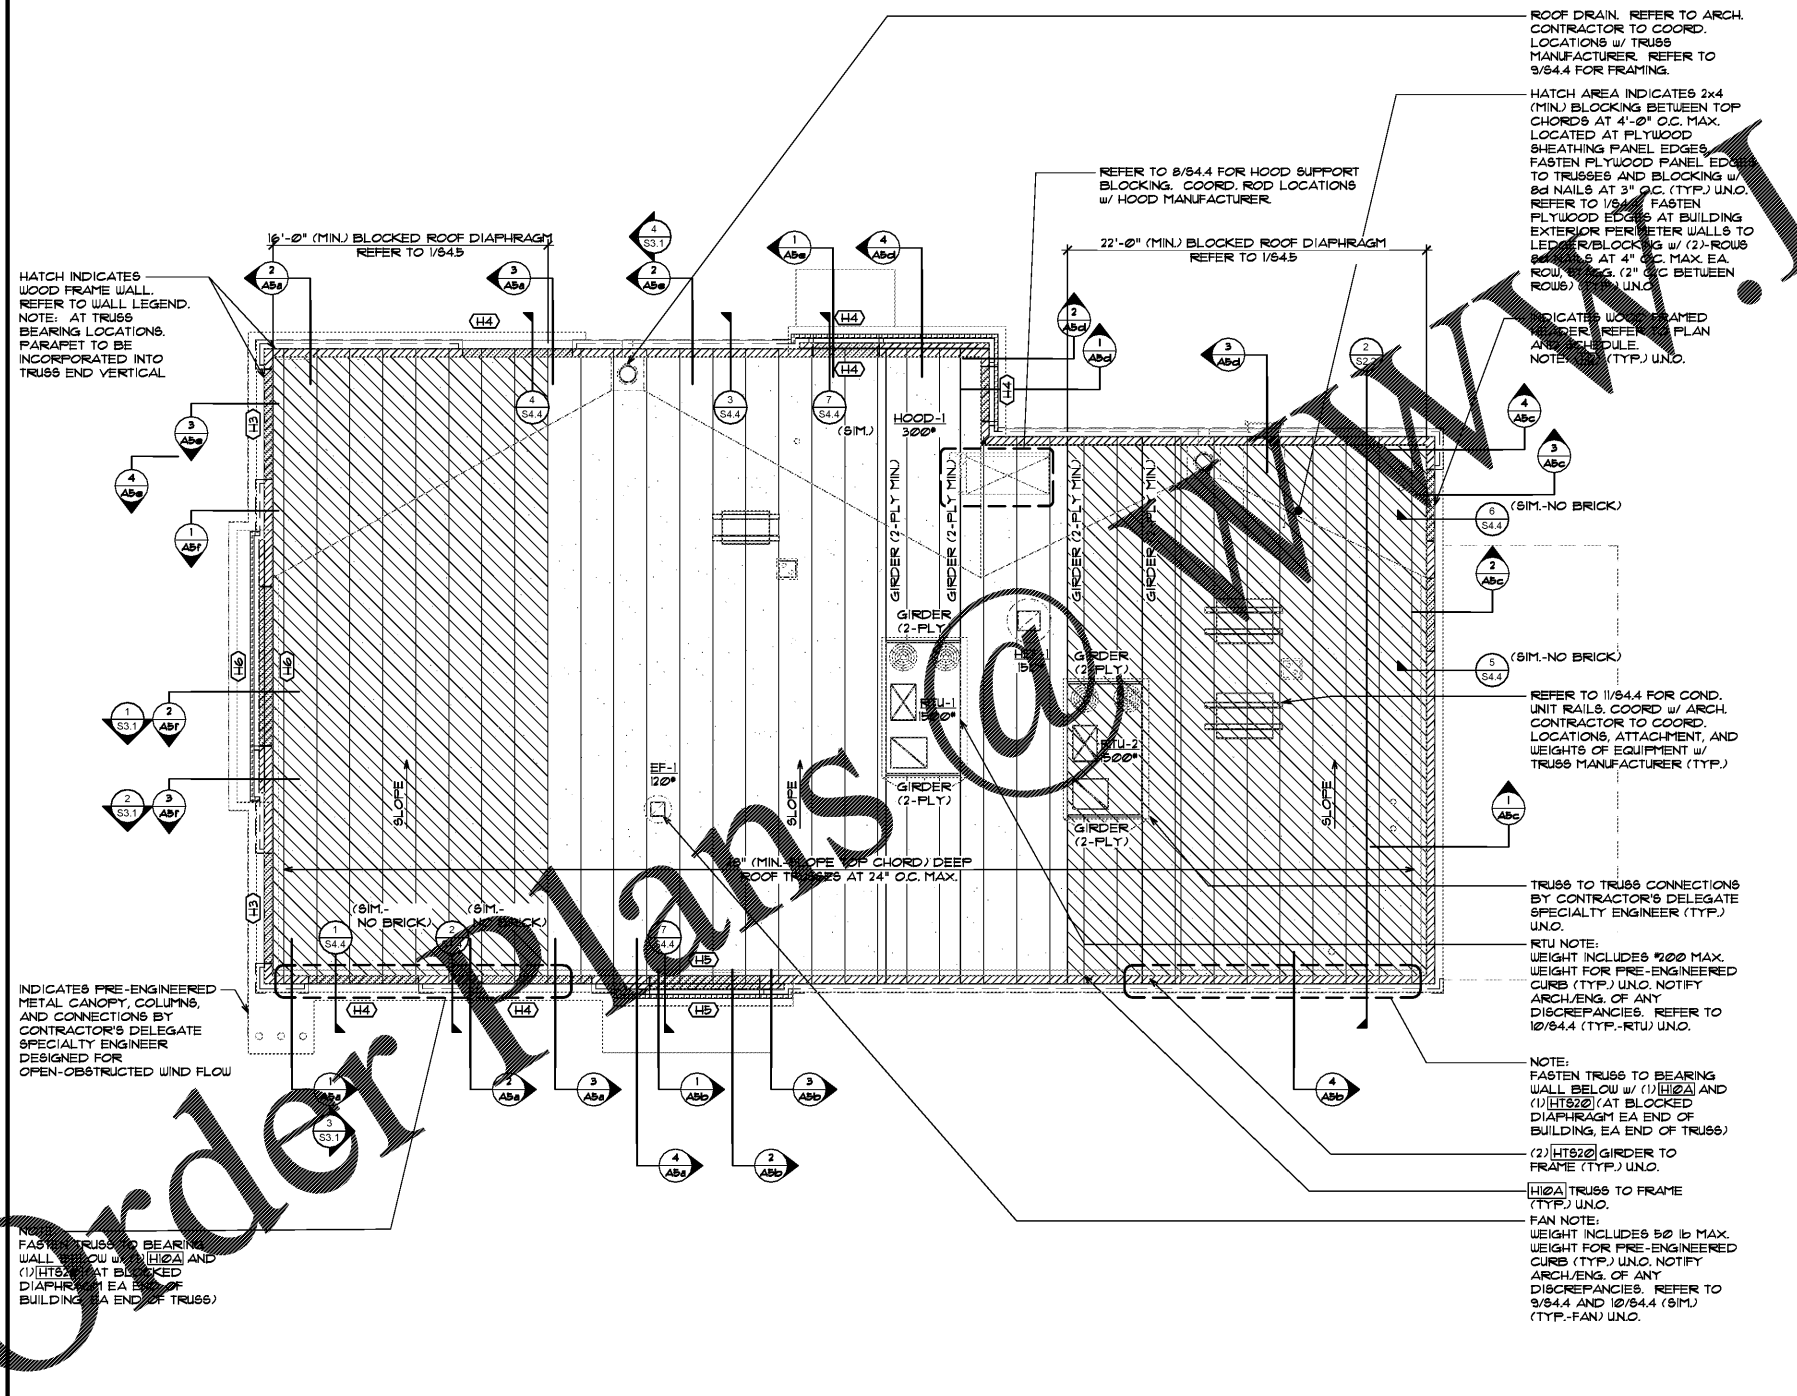

1 ROOF FRAMING PLAN
SCALE: 3/16" = 1'-0"

REVISIONS	BY

Member of the American Institute of Architects
 3500 South Orange Avenue, Suite 100
 Port Orange, Florida 32127
 Phone: 321.781.7028 • Fax: 321.781.7029
 www.oliveriarchitects.com

OLIVERI ARCHITECTS
 AIA 002021

© 2016 OLIVERI ARCHITECTS
 ALL RIGHTS RESERVED.

FLORIDA PROFESSIONAL ENGINEERING
 LICENSE
 No. 38888
 STATE OF FLORIDA

MOHAN ENGINEERING, INC.
 1058 Dunlawton Ave.
 Port Orange, Florida 32127
 Phone: 321.781.7028 • Fax: 321.781.7029

Case No. 18-000002
 New Building for
ARBY'S
 Store #8149
 1058 Dunlawton Ave.
 Port Orange, Florida

Date: 08.17.18
 Scale: AS NOTED
 Project Mgr: GEM
 Drawn: RS
 Job: 18-082
 Sheet
S2.2