




ELECTRICAL PACKAGES - Job#2891281

NO.	TAG	PACKAGE #	LOCATION	SWITCHES		OPTION	FANS CONTROLLED					
				LOCATION	QUANTITY		FAN TAG	TYPE	T	HP.	VOLTS	FLA
1		EC-11010FF	Wall Mount in 56 Box	03 - Utility Cabinet Left	1 Light 1 Fan	Smart Control's Thermostatic Control	EF-1	Exhaust	1	0.500	120	8.4

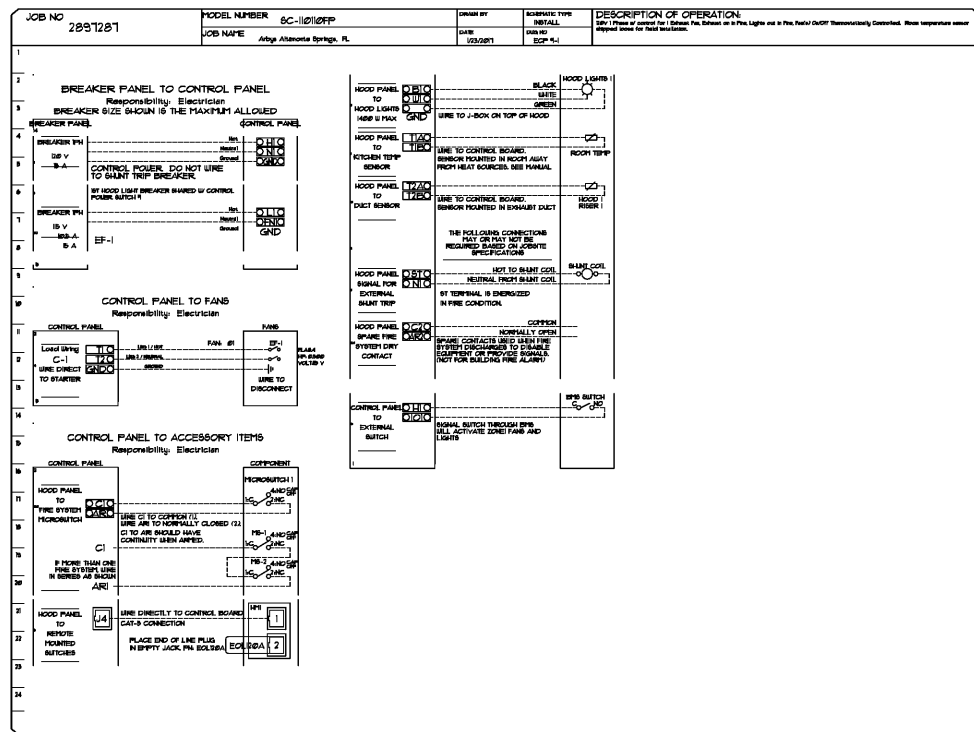

TEMPERATURE SENSOR INTERLOCK

The Temperature Sensor Interlock option complies with IMC 2006 507.2.1.1 and NFPA 96 11.1.1 by interlocking with cooking appliances through means of a heat sensor to automatically activate exhaust fans during cooking operations.

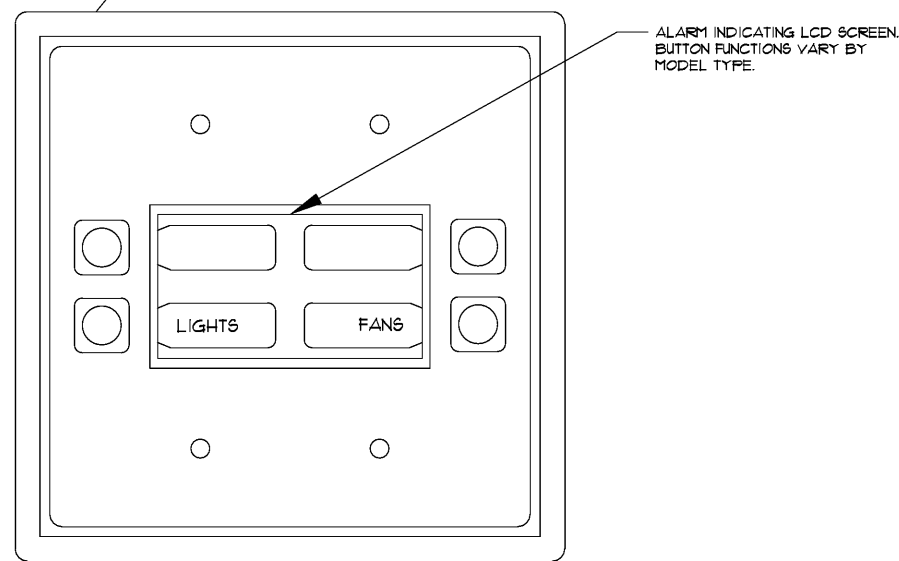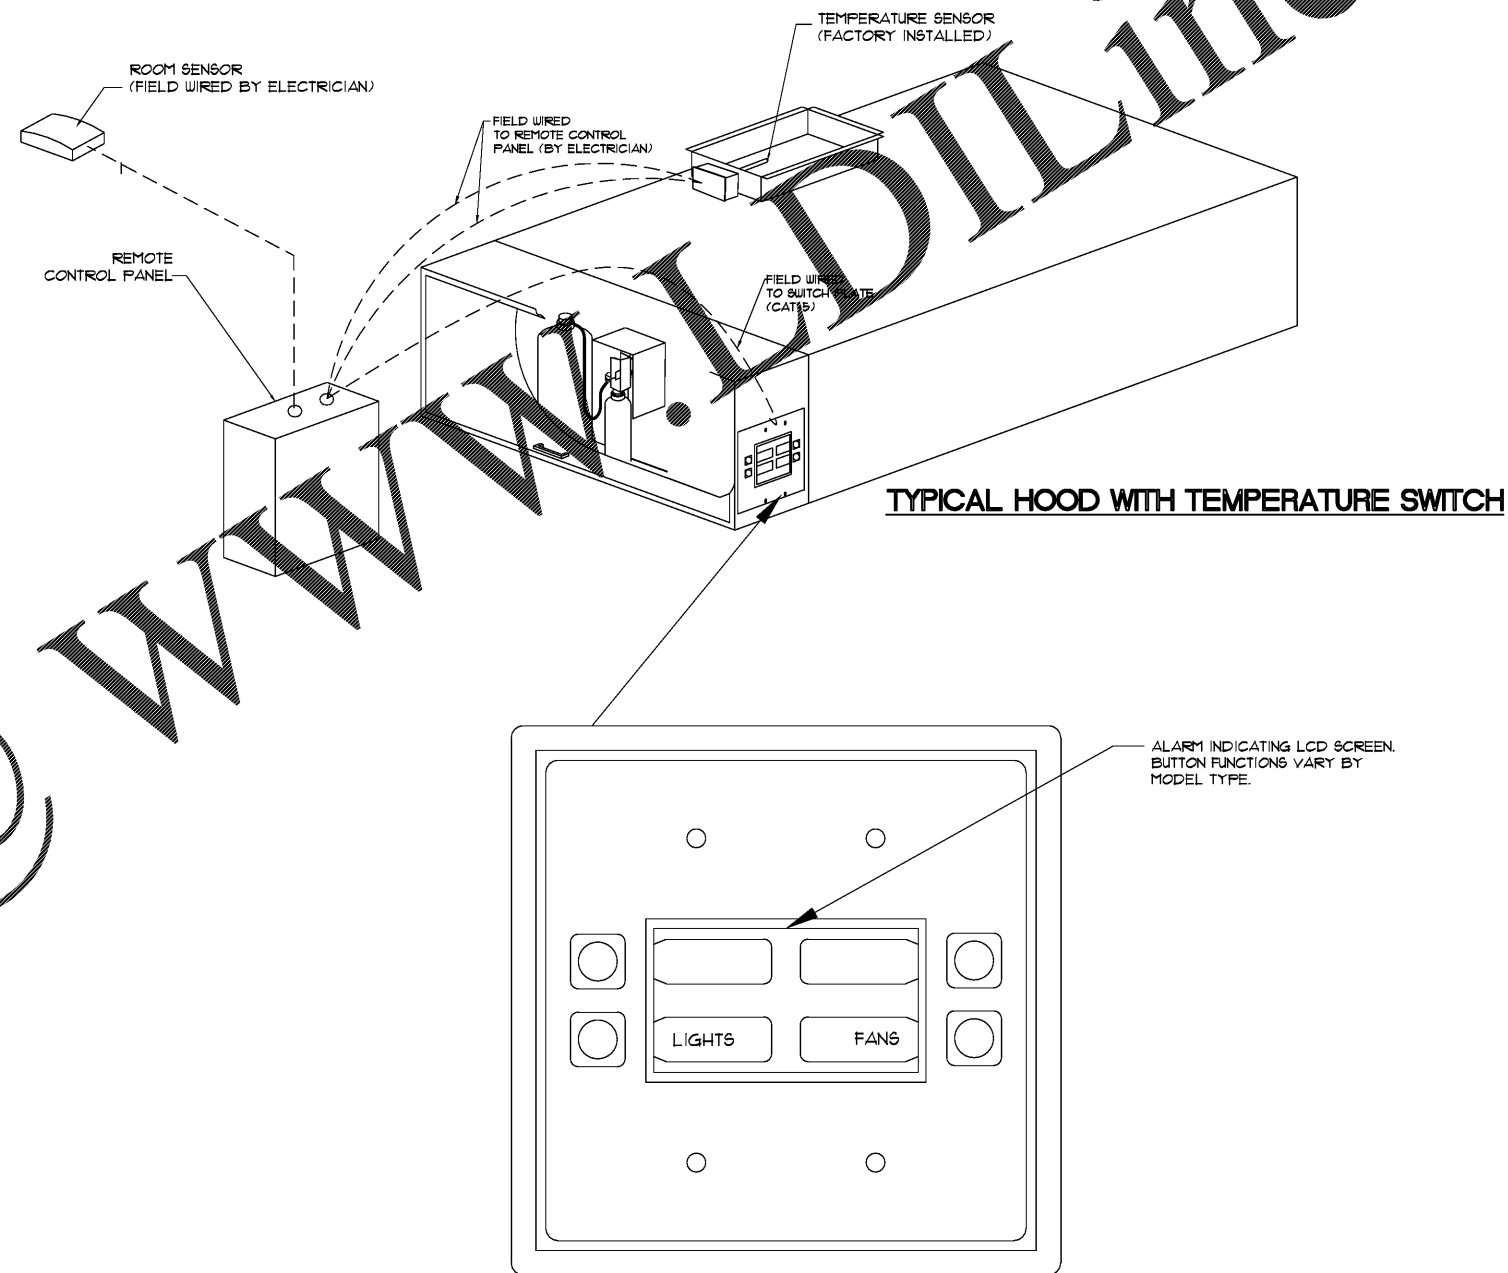

Order Plans @

REVISIONS	BY

**OLIVERI ARCHITECTS**

Member of the American Institute of Architects  
 32707 US Hwy. 19 • Palm Harbor, FL 34684  
 Phone 727.781.7525 • Fax 727.781.6923  
 www.oliveriarchitects.com

**MDCI FLORIDA, INC.**  
 Safety Harbor, Florida 34655  
 Engineering Business No. 9204  
 © Copyright, 2018 • Project No. 18014

Case No. 18-000002  
 New Building for  
**ARBY'S**  
 Store #8149  
 1058 Dunlawton Ave.  
 Port Orange, Florida

Date: 08.24.18  
 Project Mgr: DM  
 Drawn: BMD  
 Job: 18-082  
 Sheet