

**Enclosed Safety Switches
General Duty Safety Switches**

Table 9: Fusible Safety Switch Short Circuit Current Rating

Fuse Class	UL Listed Short Circuit Rating
Plug	10 kA
H, K	10 kA
J 1, R	100 kA
T 2	100 kA

1 Only applicable to 200-600 A except D325NTR, D325NTR, D326NTR and D326NTR.
2 Only applicable to D325NTR, D325NTR, D326NTR, D326NTR, T327N and T327NTR.

Table 10: Non-Fusible Safety Switch Short Circuit Current Rating

Fuse Class or Circuit Breaker Type 1	UL Listed Short Circuit Rating
Any Brand Circuit Breaker	10 kA
H or J PowerPact Circuit Breaker	Up to 65 kA ²
H, K	10 kA
J, R	100 kA ³
T	100 kA ⁴

1 Ampere rating of fuse or circuit breaker not to exceed switch ampere ratings.
2 Only applicable to DU324 and DU324NFB. HD, JD = 25 kA maximum.
3 SCCR = 50 kA, applicable to DU222RFB, DU322 and DU322RFB.
4 Only applicable to DU323, DU323RFB, DU325 and DU325.

Standards

General duty safety switches are manufactured in accordance with these standards:

- UL 98, Standard for Enclosed and Dead Front Switches. UL Listed File E2875
- NEMA Standards Publication KS1, Enclosed Switches
- Federal Specifications WS-855c for Type NDS (Type 1) and Type LD (Type 3R)

Table 11: Terminal Lug Data 1

Ampere Rating	Conductors Per Phase	Wire Range Wire Bending Space Per NEC Table 312.6 AWG/kcmil	Lug Wire Range AWG/kcmil
30 ²	1	12-8 (Al) or 14-6 (Cu)	12-8 (Al) or 14-6 (Cu)
30	1	12-6 (Al) or 14-6 (Cu)	12-6 (Al) or 14-6 (Cu)
60	1	12-3 (Al) or 14-3 (Cu)	12-2 (Al) or 14-2 (Cu)
100	1	12-1 (Al) or 14-1 (Cu)	12-1/2 (Al) or 14-1/2 (Cu)
200	1	6-250 (Al/Cu)	6-300 (Al/Cu)
400 Type 1	1 or 2	1/0-600 (Al/Cu) or 1/0-300 (Al/Cu)	(1) 1/0-750 (Al/Cu) or (2) 1/0-300 (Al/Cu)
400 Type 3R	2	1/0-250 (Al/Cu)	(1) 1/0-600 (Al/Cu) or (2) 1/0-250 (Al/Cu)
600	2	4-500 (Al/Cu)	4-600 (Al/Cu)
800	3	3/0-500 (Al/Cu)	3/0-500 (Al/Cu)

1 30-100 A switches suitable for 60°C (140 °F) or 75°C (167 °F) conductors. 200-800 A switches suitable for 75°C (167 °F) conductors.
2 Light duty switches only.

**Heavy Duty
Enclosed Safety Switches
General Information**




Table 44: Terminal Lug Data 1

Rating (A)	Wires Per Phase and Neutral	Wire Range Wire Bending Space Per NEC Table 312.6 AWG/kcmil	Lug Wire Range AWG/kcmil	Optional 2 Versa-Crimp™ Compression Lug Field-Installed	Optional Copper Only Compression Lug Field-Installed 2,3
30	1	12-8 (Al) or 14-6 (Cu)	12-2 (Al) or 14-2 (Cu)	—	EC-14
	2	14-10 (Cu)	—	—	EC-14
60 ¹	1	12-3 (Al) or 14-3 (Cu)	12-2 (Al) or 14-2 (Cu)	—	EC-14
	2	12-2 (Al) or 14-1/2 (Cu)	—	—	EC-14
100 ¹	1	12-1 (Al) or 14-1 (Cu)	12-1/2 (Al) or 14-1/2 (Cu)	VCCEL0211481	VCCEL0211481
	2	6-250 (Al/Cu)	6-300 (Al/Cu)	VCCEL0205181H	VCCEL0205181H
400 ¹	1	1/0-750 (Al/Cu)	1/0-750 (Al/Cu)	VCCEL02124H	VCCEL02124H
	2	1/0-300 (Al/Cu)	1/0-300 (Al/Cu)	VCCEL0205181H 4 and VCCEL0205122H	VCCEL0205181H 10 and VCCEL0205122H
600	2	3/0-500 (Al/Cu)	3/0-500 (Al/Cu)	VCCEL02124H	VCCEL0205122H
	3	3/0-500 (Al/Cu)	3/0-500 (Al/Cu)	HLKEX 11	HLKEX 11
1200	4	3/0-500 (Al/Cu)	3/0-500 (Al/Cu)	HSLKEX 11	HSLKEX 11

1 30-100 A switches suitable for 60°C (140 °F) or 75°C (167 °F) conductors. 200-1200 A switches suitable for 75°C (167 °F) conductors.
2 Maximum wire bending space allows for (1) 1000 kcmil or (2) 300 kcmil Al/Cu on Type 4N/2 stainless steel and Type 12 switches.
3 For Type 1 and 20 only, Type 4N/2 stainless steel and Type 12/3R, 12K use VCCEL0205181H (Al/Cu) or VCCEL0205122H (Cu only). Order two PWS180N mounting brackets with terminal lugs. Only one kit is required on two-pole switches. PWS180N consists of four 5/16-18 (7 mm) Nuts.
4 Type 4N/2 stainless steel and Type 12/3R, 12K use VCCEL0205181H (Al/Cu) or VCCEL0205122H (Cu only). Order two PWS180N mounting brackets with terminal lugs. Only one kit is required on two-pole switches. PWS180N consists of four 5/16-18 (7 mm) Nuts.
5 For Type 1 and 20 only, Type 4N/2 stainless steel and Type 12/3R, 12K use VCCEL0205181H (Al/Cu) or VCCEL0205122H (Cu only). Order two PWS180N mounting brackets with terminal lugs. Only one kit is required on two-pole switches. PWS180N consists of four 5/16-18 (7 mm) Nuts.

GENERAL ELECTRICAL NOTES

- DRAWINGS ARE DIAGRAMMATIC & ARE NOT TO BE SCALED. SEE THE ARCHITECTURAL PLANS & FIELD VERIFY CONDITIONS FOR DIMENSIONS.
- ALL ELECTRICAL WORK SHALL COMPLY WITH THE EDITION OF NFPA 70-NATIONAL ELECTRIC CODE (NEC) AS NOTED ON THE CODE SUMMARY SHEET.
- ALL WIRING SHALL BE IN CONDUIT EXCEPT THAT MC-CABLE MAY BE SUBSTITUTED ONLY AS FOLLOWS:
 - MC-CABLE (MAXIMUM CABLE LENGTH OF 10'-0") MAY BE INSTALLED ONLY FOR BRANCH CIRCUIT WIRING TO LIGHT FIXTURES.
 - MC-CABLE (MAXIMUM CABLE LENGTHS SHOWN ON DETAIL 1/E2) MAY BE INSTALLED ONLY ABOVE SLAB AND INSIDE OF THE FRONT CHECKOUT COUNTERS.
- FEEDER CONDUIT SHALL BE IMC OR RGS ABOVE GRADE & PVC BELOW GRADE WITH IMC OR RGS ELS & RISERS. INTERIOR BRANCH CIRCUIT CONDUIT SHALL BE ELECTRICAL METALLIC TUBING. EXTERIOR BRANCH CIRCUIT CONDUIT SHALL BE PVC BELOW GRADE WITH IMC OR RIGID GALVANIZED STEEL CONDUIT CONTINUING ABOVE GRADE. (SPEC 26 05 33)
- COORDINATE ALL WORK WITH OTHER TRADES TO AVOID CONFLICTS. COORDINATION DOES NOT MEAN "I WAS HERE FIRST."
- ALL WIRING IN FINISHED SPACES SHALL BE CONCEALED, UNLESS NOTED OTHERWISE.
- THE CONTRACTOR SHALL BE RESPONSIBLE FOR INSTALLING A COMPLETE & FUNCTIONAL SYSTEM IN ACCORDANCE WITH THE INTENT OF THE PLANS, WHETHER OR NOT EVERY ELEMENT THEREOF IS SPECIFICALLY CALLED OUT.
- COORDINATE ALL EQUIPMENT ROUGH-IN CONNECTION REQUIREMENTS.
- ALL OUTLET BOXES SHALL BE METALLIC. (SPEC 26 05 34)
- ALL CAULKING ON BUILDING PENETRATIONS SHALL BE ELASTOMERIC POLYURETHANE (NO EXCEPTIONS), EQUAL TO "VULKEM" 116. ANY CONTRACTOR WHO USES SILICONE OR ANY OTHER CAULKING WILL BE REQUIRED TO REMOVE & REPLACE WITH ELASTOMERIC POLYURETHANE.
- RECEPTACLES INSTALLED IN RESTROOMS SHALL BE GFCI TYPE OR SHALL BE PROTECTED BY A GFI DEVICE.
- ALL DEVICES SHALL BE IVORY & SHALL BE EQUAL TO THE FOLLOWING:
 - SINGLE POLE SWITCHES ---
 - THREE-WAY SWITCHES ---
 - DUPLEX RECEPTACLE --- (SPEC 26 27 26)
 - GFCI DUPLEX RECEPTACLE ---
 - ISO. GRD. RECEPTACLES ---
- USE DEVICE PLATES MANUFACTURED BY THE DEVICE MANUFACTURER. (SPEC 26 27 26)
- FEEDER & BRANCH CIRCUIT CONDUCTORS SHALL BE COPPER, STRANDED, 600V THHN/THWN INSULATION. EXCEPTION: WIRE SIZES #10 AWG & SMALLER SHALL BE SOLID. (SPEC 26 05 19)
- CONTRACTOR SHALL PROVIDE A TYPED CIRCUIT DIRECTORY FOR ALL PANELS. (SPEC 26 05 53)
- CONTRACTOR SHALL PROVIDE A ONE(1) YEAR WARRANTY ON ALL WORK PERFORMED.
- CONTRACTOR SHALL PROVIDE NEW WORKING LAMPS IN ALL LIGHT FIXTURES AT JOB COMPLETION.
- CONTRACTOR SHALL COORDINATE WITH & SHALL INCLUDE ALL FEES FOR THE SERVING "ELECTRIC UTILITY CO." TO PROVIDE ELECTRIC SERVICE AS SHOWN. CONTRACTOR SHALL ALSO INCLUDE ALL FEES FOR THE "SERVING PHONE COMPANY" TO INSTALL NO LESS THAN 10 PAIR CABLE TO BUILDING.
- CONTRACTOR SHALL ARRANGE FOR & INCLUDE ALL PERMITS & FEES FOR HIS SCOPE OF WORK.
- CONTROL WIRING BY HVAC CONTRACTOR. FINAL CONNECTIONS BY HVAC CONTRACTOR. SEE SHEET M1.
- APPROVED MANUFACTURERS:
 - A. PANELBOARDS & SAFETY DEVICES:
 - SQUARE D
 - SIEMENS
 - CUTLER-HAMMER
 - (SPEC 26 24 00)
 - B. DEVICES:
 - 'HUBBELL'
 - 'LEVITON'
 - 'PASS & SEYMOUR'
 - 'STEEL CITY'
 - 'APPLETON'
 - 'HUBBELL'
 - (SPEC 26 27 26)
 - C. FLOOR BOXES:
 - 'STEEL CITY'
 - 'APPLETON'
 - 'HUBBELL'
 - (SPEC 26 05 34)
- MULTI-WIRE BRANCH CIRCUITS WITH A "SHARED NEUTRAL" ARE NOT ALLOWED FOR SINGLE PHASE CIRCUITS.

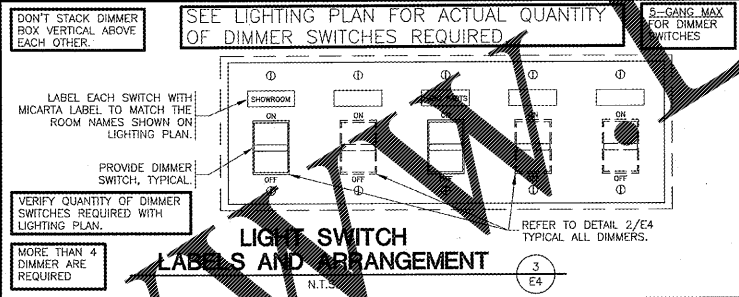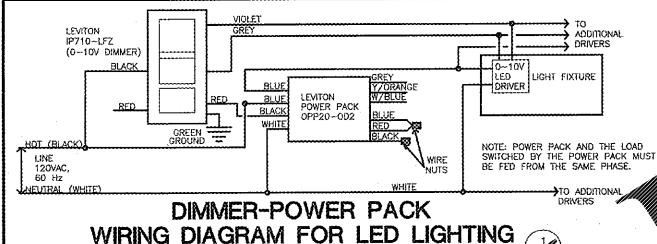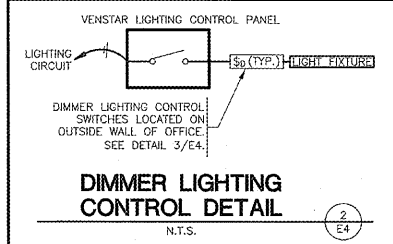

ELECTRICAL SYMBOL LEGEND & ABBREVIATIONS

- \$ SINGLE POLE SWITCH
- \$2 TWO POLE SWITCH
- \$3 THREE-WAY SWITCH
- \$4 MOTOR STARTING SWITCH WITH PILOT LIGHT
- \$5 CLASS 1, DIVISION 1 HAZARDOUS LOCATION RATED SWITCH ASSEMBLY
- \$6 WALL MOUNTED OCCUPANCY SENSOR EQUAL TO "LEVITON, OSD10-ID"
- \$7 WALL MOUNTED OCCUPANCY SENSOR EQUAL TO "LEVITON, OSSMD-MD"
- \$8 FAN SPEED SWITCH (SUPPLIED BY HVAC CONTRACTOR / INSTALLED BY ELECTRICAL CONTRACTOR)
- \$9 0-10V LED DIMMER SWITCH, EQUAL TO "LEVITON, IP710-LFZ". SEE DETAILS THIS SHEET. (5-GANG MAX)
- \$10 LEVITON POWER PACK OPP20-002
- \$11 SINGLE RECEPTACLE
- \$12 DUPLEX RECEPTACLE
- \$13 ISOLATED GROUND DUPLEX RECEPTACLE (ORANGE IN COLOR). SEE DETAIL 1/E3
- \$14 QUADPLEX RECEPTACLE (TWO DUPLEX RECEPTACLES IN ONE 2-GANG BOX UNDER A SINGLE COVERPLATE)
- \$15 EXISTING UNPOWERED DUPLEX RECEPTACLE
- \$16 ISOLATED GROUND QUADPLEX RECEPTACLE (ORANGE IN COLOR). SEE DETAIL 1/E2
- \$17 QUADPLEX RECEPTACLE (CIRCUIT TO BE WIRED WITH OCCUPANCY SENSOR) INSTALL A PERMANENT LABEL ON EACH OUTLET STATING "SENSOR CONTROLLED OUTLET". SEE DETAIL ON SHEET 2
- \$18 ABOVE COUNTER GFCI (GROUND FAULT CIRCUIT INTERRUPTING) DUPLEX RECEPTACLE
- \$19 WEATHER PROOF GFCI (GROUND FAULT CIRCUIT INTERRUPTING) DUPLEX RECEPTACLE. SEE DETAIL ON SHEET 2
- \$20 TELEPHONE POLE
- \$21 JUNCTION BOX
- \$22 REMOTE PHOTO CONTROL
- \$23 COMPUTER DATA OUTLET BOX.
- \$24 SQUARE STEEL BOX MOUNTED FLUSH ON FLOOR W/QUADPLEX RECEPTACLE (SEE ABOVE RECEPTACLE DESCRIPTION). SEE DETAIL 4/E2 FOR INSTALLATION OF BOX.
- \$25 4" SQUARE STEEL BOX MOUNTED FLUSH ON FLOOR W/QUADPLEX ISOLATED GROUND RECEPTACLE (SEE ABOVE ISOLATED GROUND RECEPTACLE DESCRIPTION). SEE DETAIL 4/E2 FOR INSTALLATION OF BOX.
- \$26 4" SQUARE STEEL BOX MOUNTED FLUSH ON FLOOR W/QUADPLEX ISOLATED GROUND RECEPTACLE (SEE ABOVE ISOLATED GROUND RECEPTACLE DESCRIPTION). SEE DETAIL 4/E2 FOR INSTALLATION OF BOX. OUTLET COVER SHALL BE RED IN COLOR
- \$27 2" x 4" RECTANGULAR STEEL BOX MOUNTED FLUSH ON FLOOR W/DUPLEX RECEPTACLE (SEE ABOVE RECEPTACLE DESCRIPTION). SEE DETAIL 4/E2 FOR INSTALLATION OF BOX.
- \$28 NEMA L5-30R - SPECIAL RECEPTACLE
- \$29 MOTOR
- \$30 FUSED DISCONNECT (SAFETY) SWITCH W/ SWITCH AMPACITY / FUSE AMPACITY AS INDICATED
- \$31 NON-FUSED DISCONNECT (SAFETY) SWITCH
- \$32 POWER OR LIGHTING PANEL W/PANEL DESIGNATION SHOWN ON PLAN (SIZES & MOUNTING INDICATED ON PLANS)
- \$33 24 HOUR EGRESS & SECURITY LIGHT, WIRE DIRECT TO ELECTRIC PANEL AHEAD OF ANY LOCAL SWITCHES AND LIGHTING CONTROL PANEL
- \$34 WALL/CEILING MOUNTED COMBINATION "EXIT/EMERGENCY" SIGN W/SHADING INDICATING FACES
- \$35 EMERGENCY LIGHTING FIXTURE WITH BATTERY
- \$36 FEEDING PANEL AND CIRCUIT NUMBER(S)
- \$37 NOTE: EQUIPMENT GROUND CONDUCTOR NOT SHOWN
- \$38 CIRCUIT CONDUCTORS
- \$39 GROUNDED CIRCUIT CONDUCTOR (OR NEUTRAL)
- \$40 MOTION DETECTOR - BY VENSTAR. SEE VS SHEETS FOR MORE INFORMATION
- \$41 OCCUPANCY SENSOR EQUAL TO "LEVITON, OSC20-MAW" WITH POWER PACK

- AC LOCATED ABOVE COUNTER
- AFV ABOVE FINISHED FLOOR
- BCU BLOWER COIL UNIT
- CDU CONDENSING UNIT
- EP EXHAUST FAN
- EFU ELECTRIC FURNACE
- FURN GAS FURNACE
- AHU AIR HANDLER
- HP HEAT PUMP UNIT
- PP POWER PACK
- RTU PACKAGED ROOFTOP UNIT
- IMC INTERMEDIATE METALLIC TUBING
- LC LIGHTING CONTRACTOR
- M MOTOR STARTING
- R RED IN COLOR COVERPLATE
- HP MOTOR STARTING W/PILOT LIGHT
- NL NIGHT LIGHT
- PEC PHOTOELECTRIC CONTROL
- RGS RIGID GALVANIZED STEEL
- UPO UN-POWERED OUTLET
- TS TIME SWITCH
- W WALL OUTLET (48" AFF SEE MOUNTING HEIGHTS)
- WP WEATHERPROOF (ENCLOSURE)
- X EXPLOSION PROOF ASSEMBLY
- GFCI GRD./FAULT CIRCUIT INTERRUPT
- EMT ELECTRICAL METALLIC TUBING
- CM CEILING MOUNTED

SQUARE D
Modifications For Factory Assembled Panelboards
Class 1540, 1670, 2110, 4820, 6550 / Refer to 2110CT9701, 1640CT9701, 4820CT9701, 6550CT9701

SHORROCK
Main Circuit Breaker Without Overload Trip (Automatic Moulded Case Switch)
(Not UL Listed)

SPECIAL FEATURES
For information on the following special features, please see the Supplemental and Modification Information:

- PowerCrimp™ mounting
- Custom equipment bases (NEMA and NEMA)
- Increased box depth
- Increased panel height
- Non-standard panel height
- Weatherproof enclosure (1)
- Type 1 enclosure
- Type 2 enclosure
- Type 3R enclosure
- 304/405/12 stainless steel enclosure (1)
- Type 1 stainless enclosure (1)
- Stainless enclosure (1)
- Paslockable (1)
- Special locks (Corbin, Yale, Best) (1)
- Equal height bases (1)
- Common frets to cover two equal height bases (1)
- Panelboard skid—stainless steel feeding a panelboard (1)
- Panelboard wiring—for terminating conduit in wiring ductwork (1)
- Keyed mechanical interlocking of two or more circuit breakers (I-Line and GMS) (1)
- Motor operators (I-Line only)
- Panelboard interiors and special fronts to fit existing boxes
- A standard panelboard front has one brass endwall and one with knockouts. Blank endwalls or knockouts in both endwalls are also available (1)

Table 9.145: NQ Standard Aluminum Mechanical Lugs—Main Lugs

Rating (A)	Wires Per Phase and Neutral	Wire Range Wire Bending Space Per NEC Table 312.6 AWG/kcmil	Lug Wire Range AWG/kcmil
30	1	12-8 (Al) or 14-6 (Cu)	12-2 (Al) or 14-2 (Cu)
	2	14-10 (Cu)	—

Table 9.146: NQ Standard Aluminum Mechanical Lugs—Main Circuit Breaker

Rating (A)	Wires Per Phase and Neutral	Wire Range Wire Bending Space Per NEC Table 312.6 AWG/kcmil	Lug Wire Range AWG/kcmil
30	1	12-8 (Al) or 14-6 (Cu)	12-2 (Al) or 14-2 (Cu)
	2	14-10 (Cu)	—

Table 9.147: NF Standard Mechanical Lugs—Main Lugs

Rating (A)	Wires Per Phase and Neutral	Wire Range Wire Bending Space Per NEC Table 312.6 AWG/kcmil	Lug Wire Range AWG/kcmil
30	1	12-8 (Al) or 14-6 (Cu)	12-2 (Al) or 14-2 (Cu)
	2	14-10 (Cu)	—

Table 9.148: NF Standard Mechanical Lugs—Main Circuit Breaker

Rating (A)	Wires Per Phase and Neutral	Wire Range Wire Bending Space Per NEC Table 312.6 AWG/kcmil	Lug Wire Range AWG/kcmil
30	1	12-8 (Al) or 14-6 (Cu)	12-2 (Al) or 14-2 (Cu)
	2	14-10 (Cu)	—



CRAG A. SCHNEIDER, AIA
ARCHITECT
1756 East Sunshine, Suite 417
Springfield, Missouri 65804
417.862.0558
417.862.9265
e-mail: architect@ceafy.com

PROJECT:
NEW O'REILLY AUTO PARTS STORE
PRICEVILLE, AL
HWY 67
ELECTRICAL NOTES

O'Reilly AUTO PARTS
CORPORATE OFFICES
233 SOUTH PATTERSON
SPRINGFIELD, MISSOURI 65802
(417) 865-2674 TELEPHONE

COMM # 4160
DATE: 04-06-18
REVISION
DATE:

