DocuSign Envelope ID: E7AF9EAA-AD1A-4C09-8FFA-B5B8E1B2F1EA
26C2661680C71

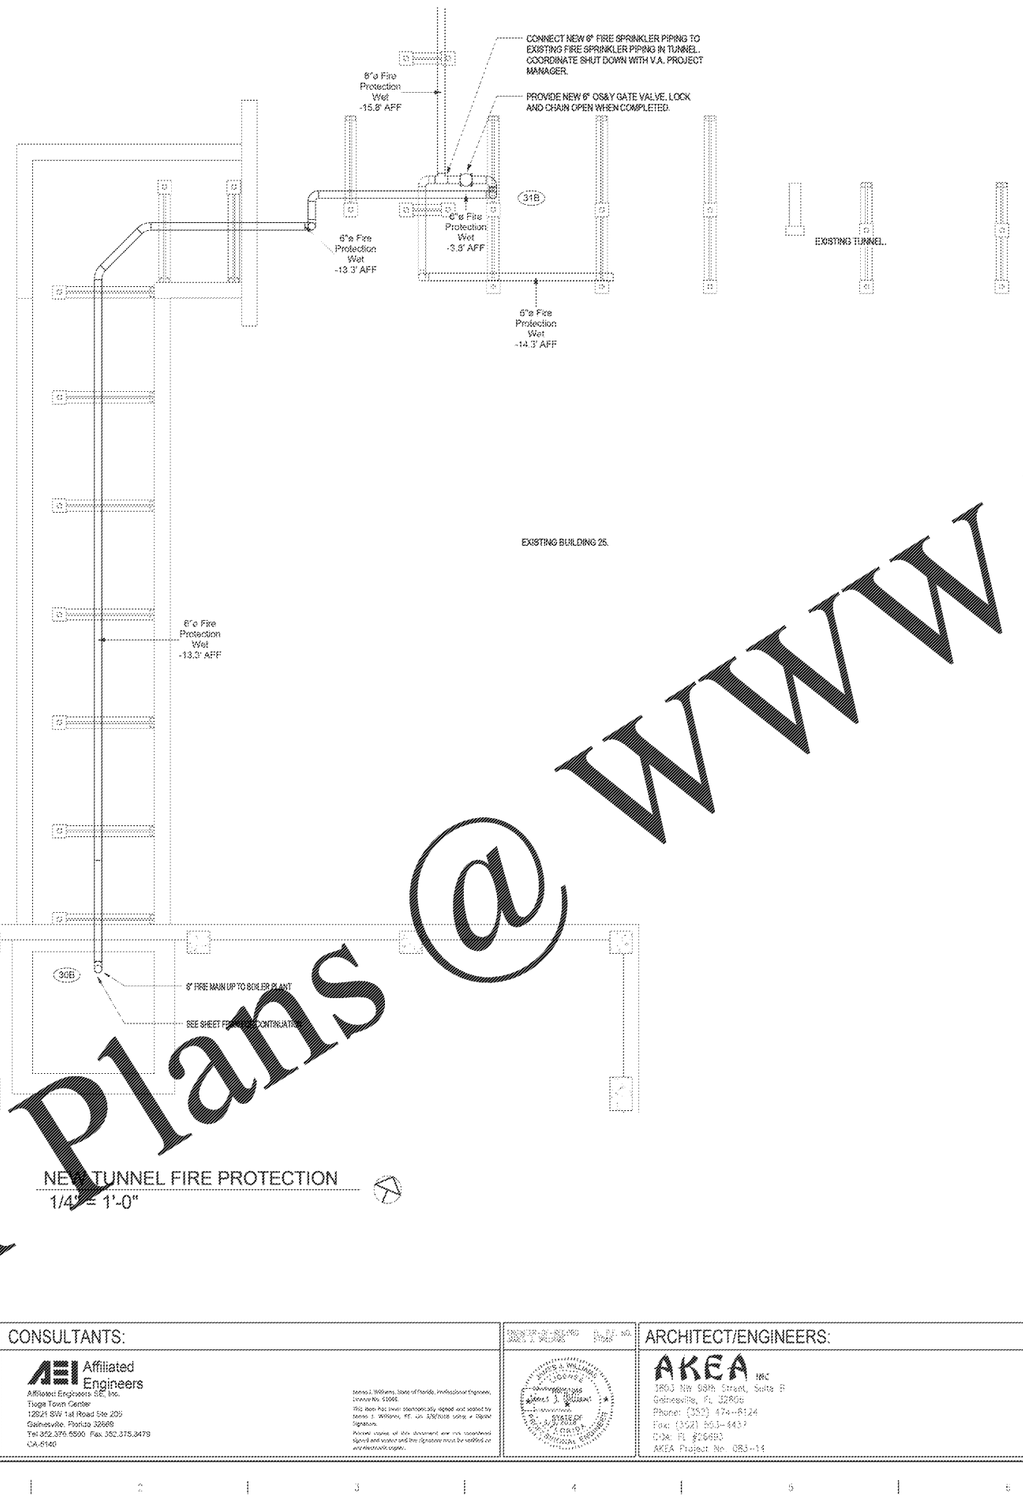

NEW TUNNEL FIRE PROTECTION
1/4" = 1'-0"

Order Plans @ WWW.LDILine.com

FINAL DESIGN
APPROVED FOR CONSTRUCTION

Revisions:	Date

CONSULTANTS:

Affiliated Engineers
Affiliated Engineers SE, Inc.
Tioga Town Center
12821 SW 1st Road Ste 205
Gainesville, Florida 32608
Tel 352.376.6690 Fax 352.375.9478
CA 6140

James J. Williams, State of Florida, Professional Engineer, License No. 51666.
This item has been electronically signed and sealed by James J. Williams, PE on 3/9/18 using a Digital Signature.
Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

ARCHITECT/ENGINEERS:

AKEA INC
1803 NW 59th Street, Suite B
Gainesville, FL 32606
Phone: (352) 474-8124
Fax: (352) 563-8437
CGA: FL #26690
AKEA Project No. 083-14

Drawing Title	NEW TUNNEL FIRE PROTECTION
Approved: Project Director	
Project Title	REPLACE BOILERS - FCA D, ENERGY AT THE MALCOM RANDALL VAMC
Location	GAINESVILLE, FLORIDA
Date	MARCH 9, 2018
Checked	JSN
Drawn	RWD
Project Number	573-14-600
Building Number	
Drawing Number	FP201
	52 OF 127

Office of Construction and Facilities Management
Department of Veterans Affairs

VA FORM 08-6231