


**GENERAL NOTES**

- SOME WORK MAY BE REQUIRED TO BE PERFORMED AFTER HOURS OR WEEKENDS. WORK SHALL BE SCHEDULED TO MINIMIZE INTERFERENCE WITH BUILDING OPERATIONS. COORDINATE ALL SYSTEMS SHUTDOWNS WITH VARIOUS...
- DO NOT REMOVE MATERIAL FROM ALL TRAYS TO ENSURE SUFFICIENT ACCESS IS PROVIDED TO ALL TRAYS AND FOR SAFETY. NOT ALL TRAYS ARE IDENTIFIED ON THIS DRAWING.

- SHEET KEYNOTES**
- ROUTE FUEL OIL PIPING BELOW GRADE TO NEW BOILER BUILDING. TOP OF PIPE TO BE A MINIMUM OF 36" BELOW GRADE.
  - REFER TO NEW BOILER BUILDING PLANS FOR CONTINUATION.
  - WATER TIGHT SUMP FOR ACCESS TO LEAK DETECTION SENSORS. MAXIMUM SPACING 100 FT. REFER TO SPEC SECTION 281000.
  - 3" FIBER AND 2" FIBER.
  - SPILL CONTAINMENT MAN HOLE (FUEL OIL FILL).
  - CONCRETE PAD ON GRADE WITH MANHOLE COVER.
  - DOUBLE WALL CONTAINMENT.

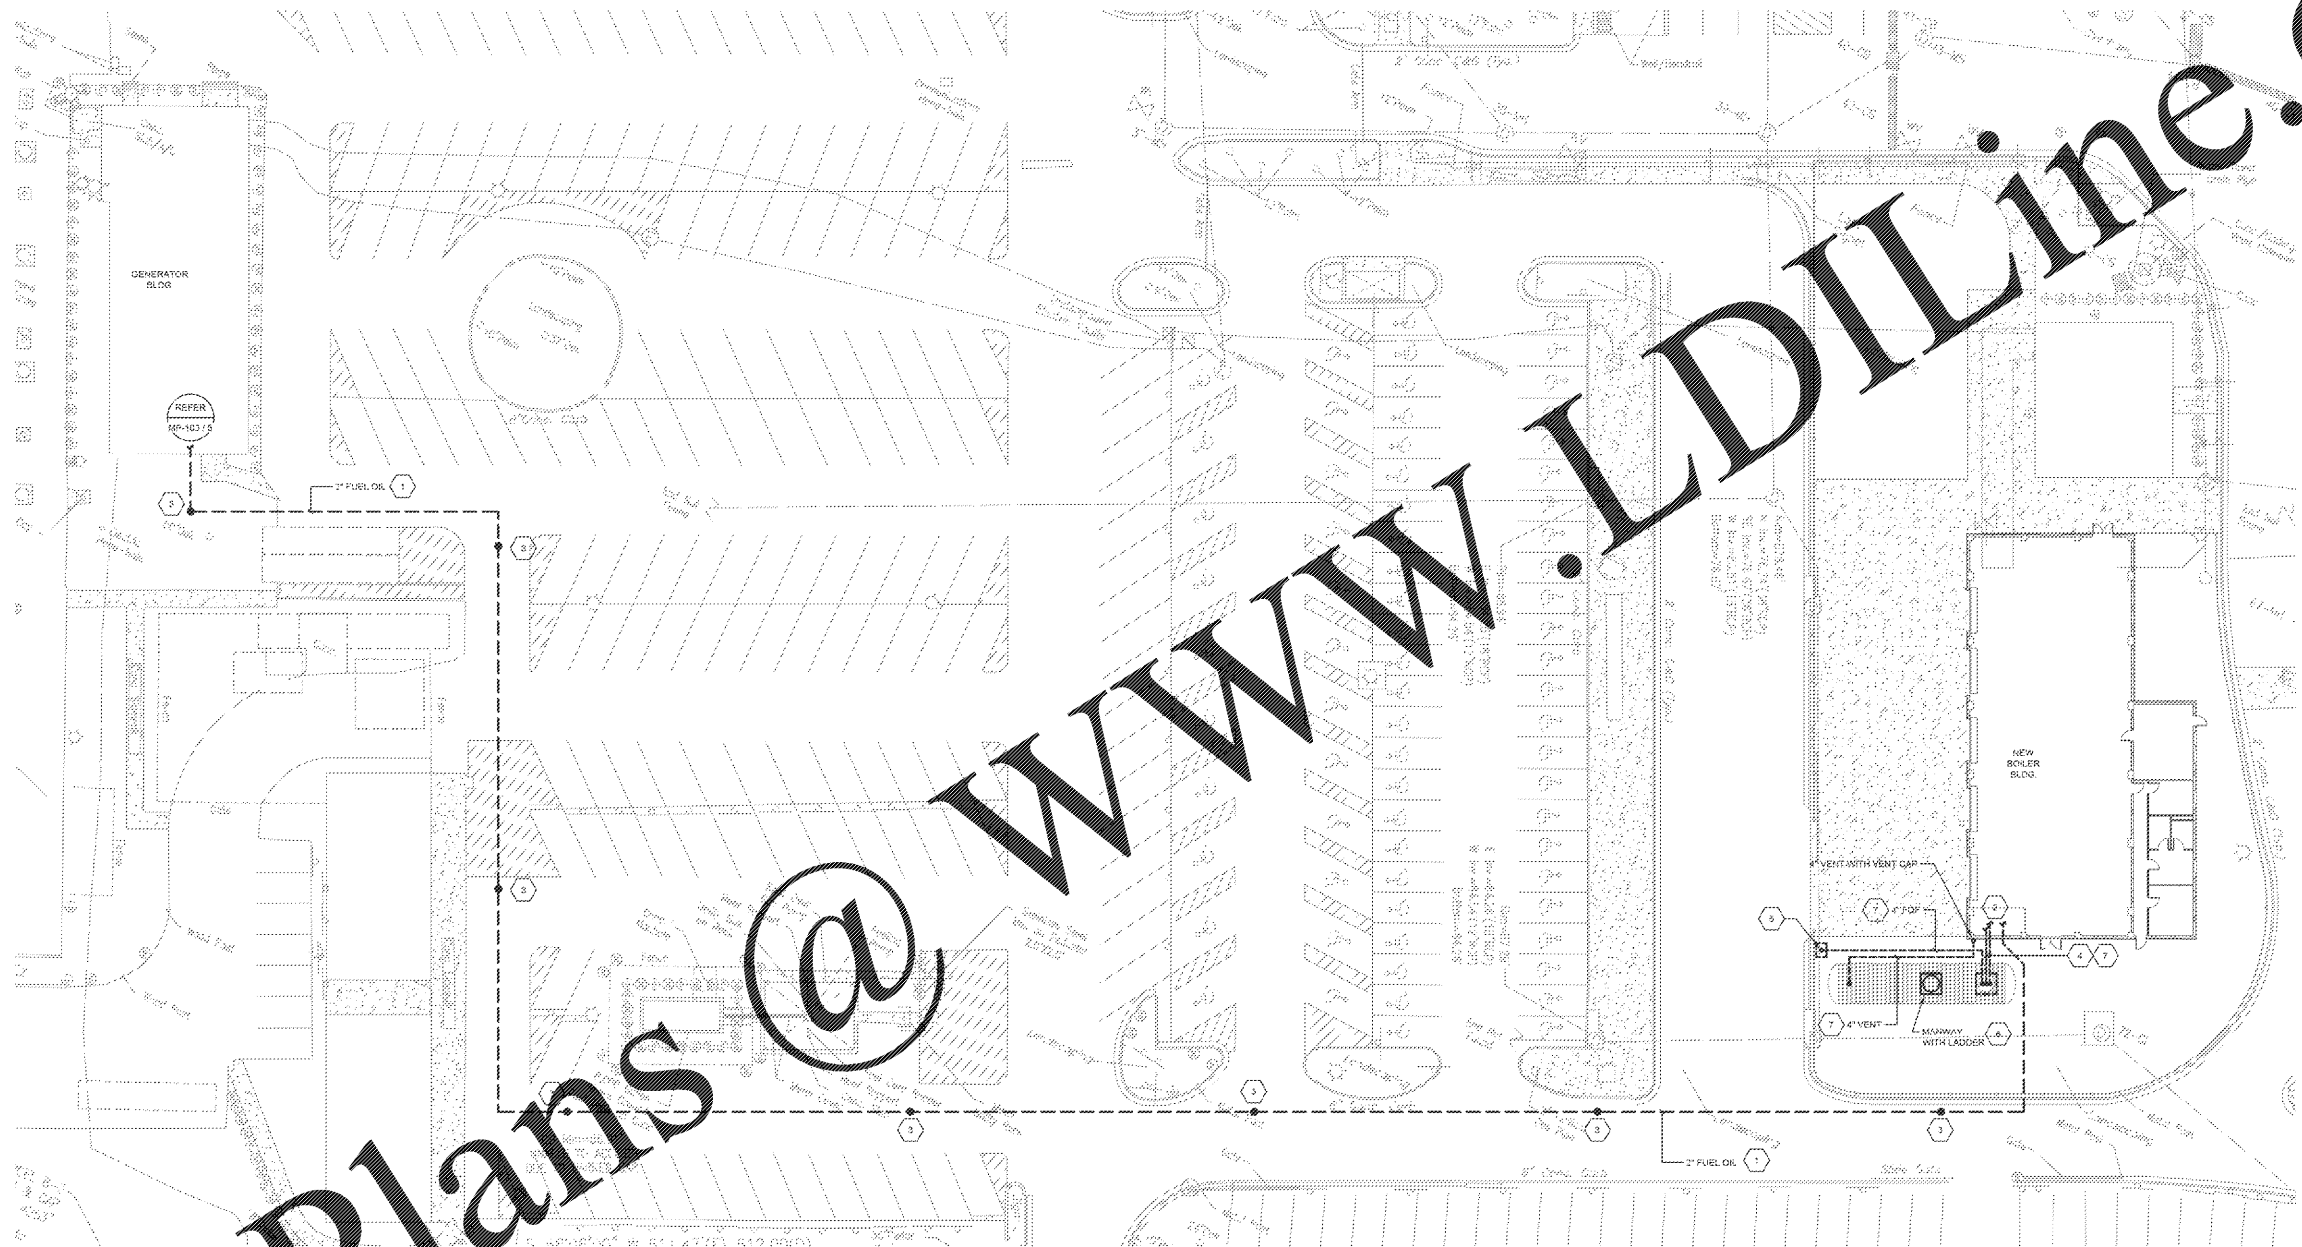

1 FUEL OIL SITE PLAN PLAN  
SCALE: 1" = 50'-0"

FINAL DESIGN  
APPROVED FOR CONSTRUCTION

<p><b>CONSULTANTS:</b></p> <p><b>Affiliated Engineers</b></p> <p>Affiliated Engineers SE, Inc. Tioga Town Center 12921 SW 1st Road, Ste 205 Gainesville, Florida 32609 Tel: 352.376.5500 Fax: 352.376.3479 CA 6140 AEI Project No. 140285-02</p>	<p><b>ENGINEER-OF-RECORD</b> FL P.E. NO. 42678</p> <p>JACK STERNHEIM NEALE</p>	<p><b>ARCHITECT/ENGINEERS:</b></p> <p><b>AKEA INC.</b></p> <p>3803 NW 95th Street, Suite B Gainesville, FL 32608 Phone: (352) 474-6124 Fax: (352) 474-6324 ODA: FL #26693 AKEA Project No. 083-14</p>	<p>Drawing Title</p> <p>FUEL OIL SITE PLAN</p>	<p>Project Title</p> <p>REPLACE BOILERS - FCA D. ENERGY AT THE MALCOM RANDALL VAMC</p>	<p>Project Number</p> <p>573-14-600</p>	<p>Office of Construction and Facilities Management</p> <p>Department of Veterans Affairs</p>
			<p>Approved Project Director</p>	<p>Location</p> <p>GAINESVILLE, FLORIDA</p>	<p>Drawing Number</p> <p>MP101</p>	

Vertical scale bar on the left side of the drawing, showing increments of one foot from 0 to 75 feet.

Order Plans @ WWW.LDILine.com