DocuSign Envelope ID: E7AF9E4A-AD45-4C09-8FF4-B5BBE2B2F1EA
26C2661660C7A

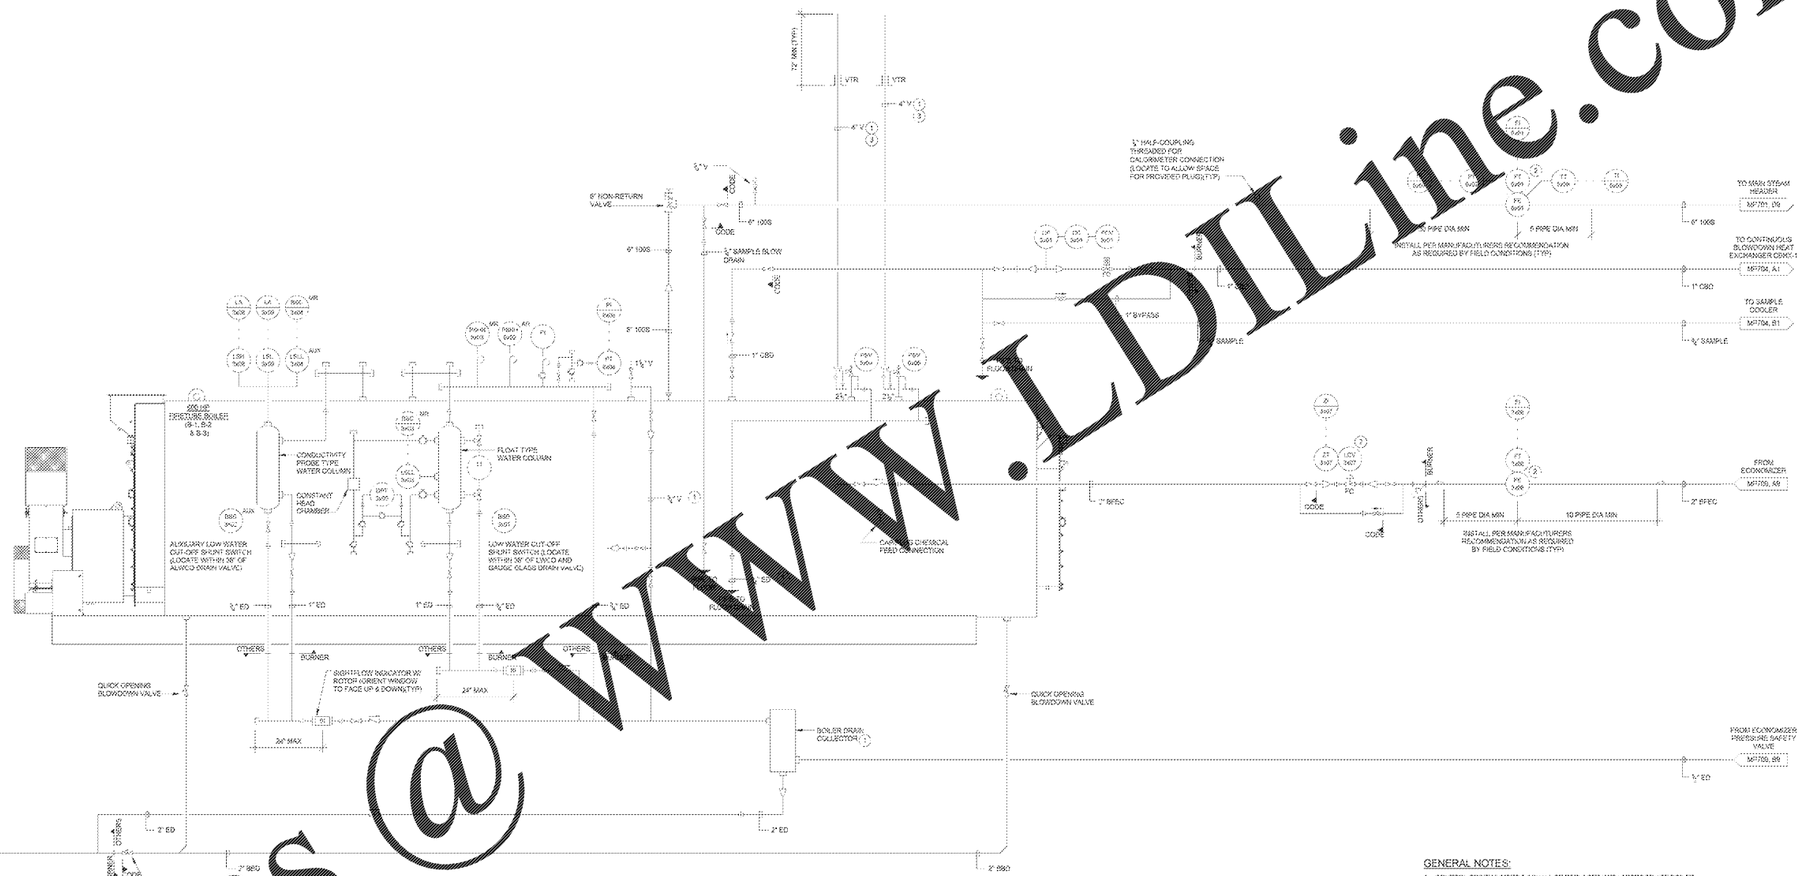

TYPICAL 600BHP FIRE TUBE BOILER TRIM SCHEMATIC

GENERAL NOTES:

1. CONTROL POINT NUMBER "X" SHALL BE REPLACED WITH APPROPRIATE BOILER NUMBER

BOILER NO. 1 - =Xbx
BOILER NO. 2 - =Xcx
BOILER NO. 3 - =Xdx

DRAWING NOTES:

(1) TO BE FURNISHED AND INSTALLED BY THE CONTRACTOR.

(2) TO BE FURNISHED BY THE BOILER/BURNER MANUFACTURER AND INSTALLED BY THE CONTRACTOR.

(3) VENT SHALL BE A MINIMUM OF ONE PIPE SIZE LARGER THAN SAFETY VALVE OUTLET. FINAL VALVE QUANTITY AND SIZE SHALL BE BY THE MANUFACTURER. CONTRACTOR SHALL FURNISH AND INSTALL DRIP PAN ELBOWS.

FINAL DESIGN
APPROVED FOR CONSTRUCTION

Revisions:	Date

CONSULTANTS:

Affiliated Engineers

Affiliated Engineers SE, Inc.
Tioga Town Center
12821 SW 1st Road Ste 205
Gainesville, Florida 32608
Tel 352.376.6690 Fax 352.375.9478
CA-8140

Seal & Signature

Seal S. Wells, State of Florida, Professional Engineer, License No. 93909.

This item has been electronically signed and sealed by Seal S Wells PE on 1/8/2018 using a Digital Signature.

Printed copies of this document are not considered signed and sealed and the signature must be verified on any electronic copies.

ARCHITECT/ENGINEERS:

AKEA INC
3803 NW 98th Street, Suite B
Gainesville, FL 32606
Phone: (352) 474-8124
Fax: (352) 563-8437
CoA: FL #26690
AKEA Project No. 083-14

Drawing Title	TYPICAL 600BHP FIRE TUBE BOILER TRIM SCHEMATIC
Approved: Project Director	
Project Title	REPLACE BOILERS - FCA D, ENERGY AT THE MALCOM RANDALL VAMC
Location	GAINESVILLE, FLORIDA
Date	MARCH 9, 2018
Checked	JSN
Drawn	RWD
Project Number	573-14-600
Building Number	
Drawing Number	MP708
	90 OF 127

Office of Construction and Facilities Management

VA FORM 08-6231

Order Plans @ WWW.LDILine.com