36C24618D0271

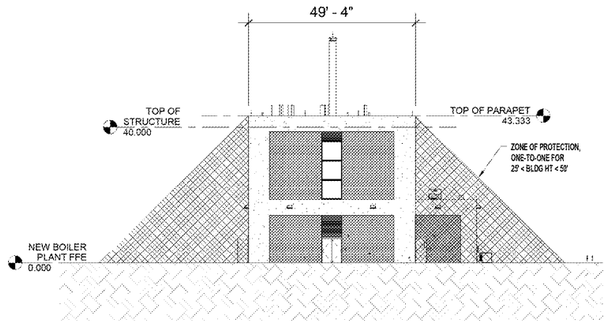

2 LIGHTNING PROTECTION - ZONES OF PROTECTION
1/16" = 1'-0"

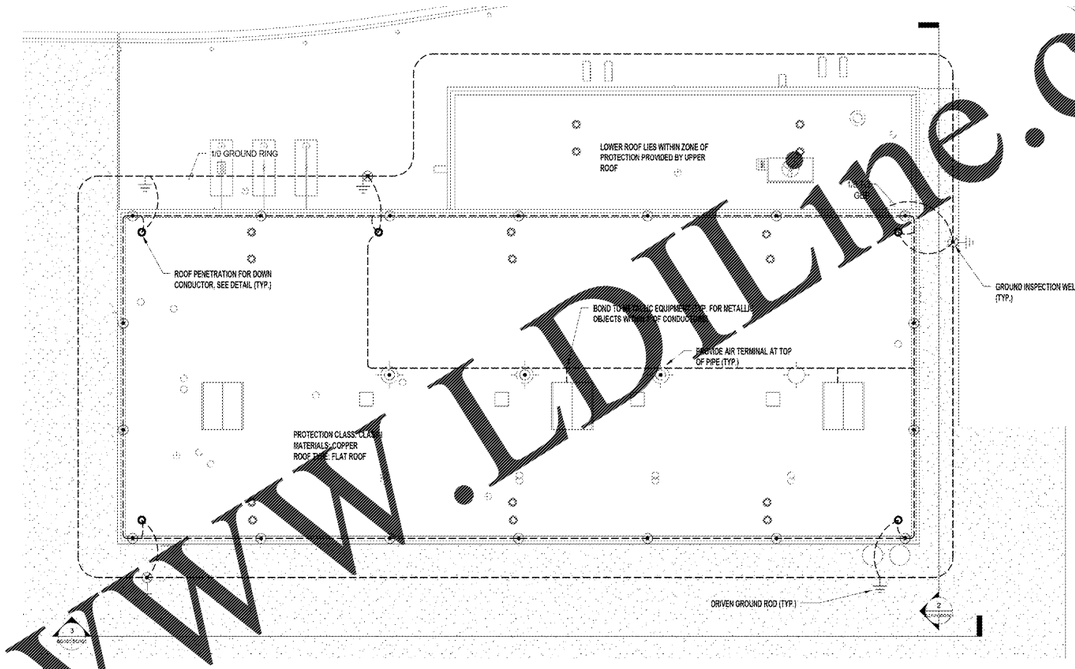

3 BOILER PLANT - ROOF - LIGHTNING PROTECTION
1/16" = 1'-0"

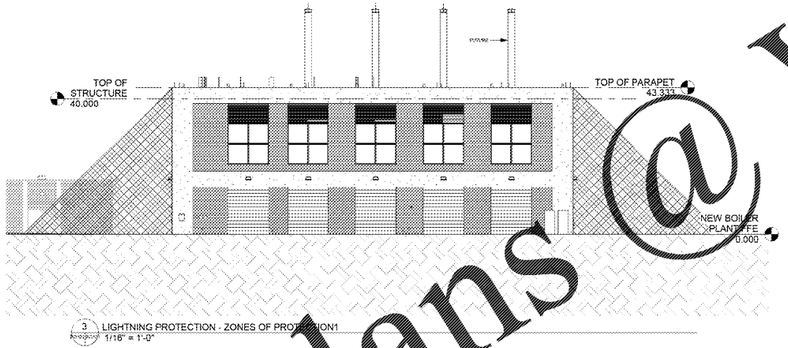

3 LIGHTNING PROTECTION - ZONES OF PROTECTION1
1/16" = 1'-0"

Order Plans @ WWW.LDILine.com

FINAL DESIGN
APPROVED FOR CONSTRUCTION

Revisions:	Date

CONSULTANTS:

DRAWN BY: CHAD X. FRALICK | CHKD BY: CJF | DATE OF RECORD: | FILE NO.: 73611

CHAD X. FRALICK LICENSE No. 75611 STATE OF FLORIDA REGISTERED PROFESSIONAL ENGINEER

ARCHITECT/ENGINEERS:

AKEA INC.
3803 NW 98th Street, Suite B
Gainesville, FL 32606
Phone: (352) 474-6124
Fax: (352) 553-4437
COA: FI #26663
AKEA Project No. 063-14

Drawing Title: BOILER PLANT - LIGHTNING PROTECTION

Approved: Project Director

Project Title: REPLACE BOILERS - FCA D, ENERGY AT THE MALCOM RANDALL VAMC

Location: GAINESVILLE, FLORIDA

Date: MARCH 9, 2018 | Checked: CJF | Drawn: CJF

Project Number: 573-14-600

Building Number:

Drawing Number: EQ101

124 OF 127

Office of Construction and Facilities Management

Department of Veterans Affairs

VA FORM 08-6231