Order Plans @ WWW.EDLine.com

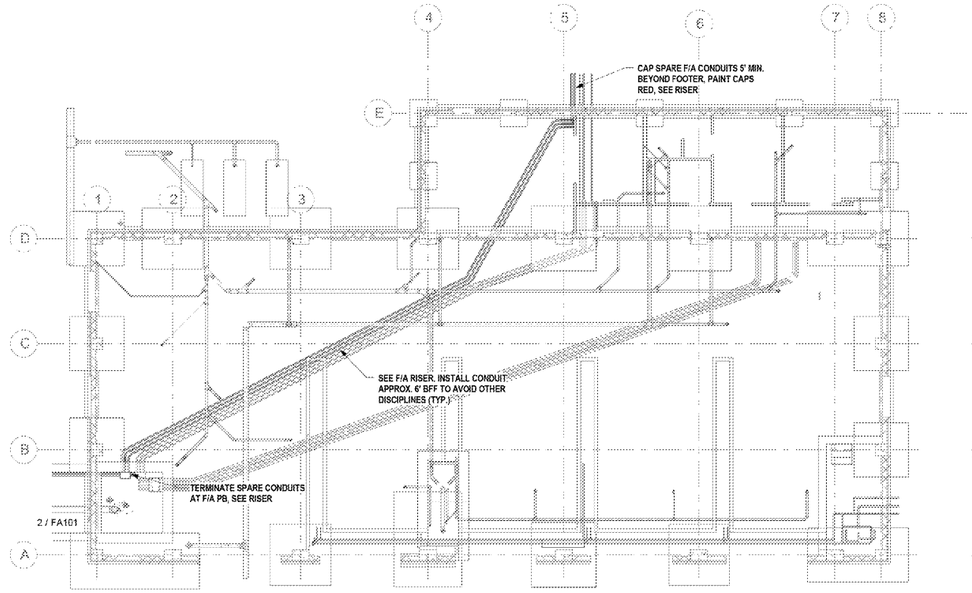

3 BOILER PLANT - BELOW GRADE - FIRE ALARM
1/8" = 1'-0"

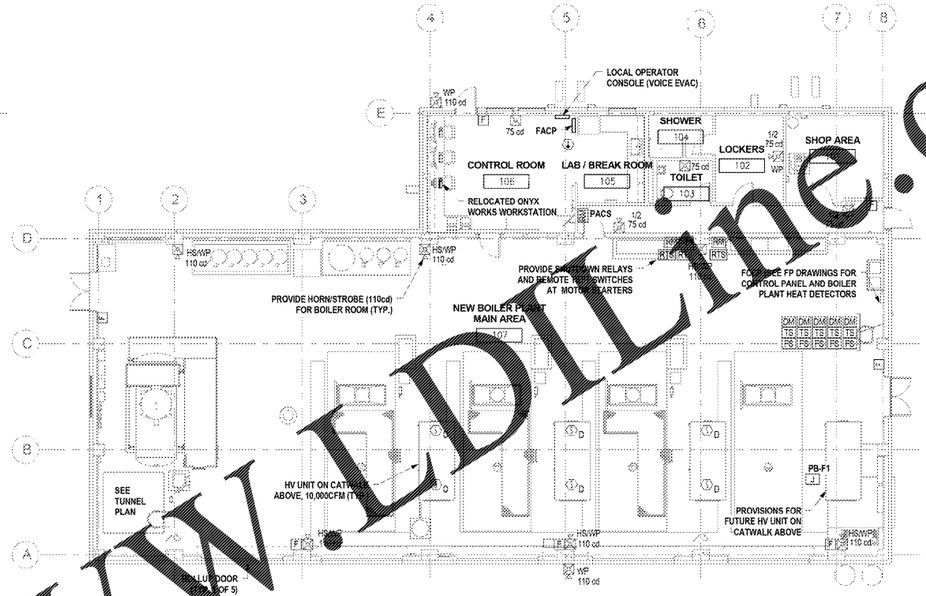

BOILER PLANT - FIRE ALARM
1/8" = 1'-0"

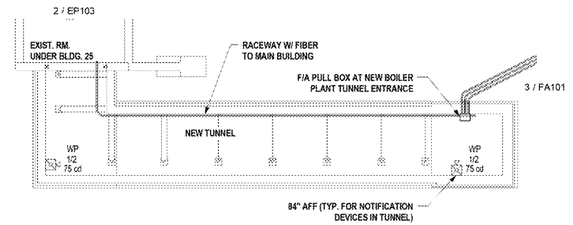

2 NEW TUNNEL - FIRE ALARM
1/8" = 1'-0"

FULLY SPRINKLERED BUILDING

FINAL DESIGN
APPROVED FOR CONSTRUCTION

Revisions:	Date

CONSULTANTS:

DRAWING RE-RECORD CHAD X TRAUB — P.E. NO. 75811

ARCHITECT/EDITORS:

AKEA INC
3803 NW 98th Street, Suite B
Gainesville, FL 32606
Phone: (352) 474-6124
Fax: (352) 553-4437
COA: FI #26663
AKEA Project No. 063-14

Drawing Title: FIRE ALARM FLOOR PLANS

Approved: Project Director

Project Title: REPLACE BOILERS - FCA D, ENERGY AT THE MALCOM RANDALL VAMC

Location: GAINESVILLE, FLORIDA

Date: MARCH 9, 2018 | Checked: CJF | Drawn: CJF

Project Number: 573-14-600

Building Number:

Drawing Number: FA101

127 OF 127

Office of Construction and Facilities Management

Department of Veterans Affairs

VA FORM 08-6231